

## CONCRETE

1. The contractor shall verify all dimensions prior to starting construction. The architect shall be notified of any discrepancies or inconsistencies.
2. Dimensions shall take precedence over scale shown on drawings.
3. Notes and details on drawings shall take precedence over general notes and typical notes.
4. All work shall conform to the minimum standards of the following code. The International Building Code, 2012 Edition, and any other regulating agencies which have authority over any portion of the work, and those codes and standards listed in these notes and specifications.
5. See architectural drawings for the following:
  - Size and location of all door and window openings, except as noted.
  - Size and location of all interior and exterior nonbearing partitions.
  - Size and location of all concrete curbs, floor drains, slopes, depressed areas, changes in level, chamfers, grooves, inserts, etc.
  - Size and location of floor and roof openings except as shown
  - Floor and roof finishes
  - Stair framing and details (except as shown)
6. See mechanical, plumbing, and electrical drawings for the following:
  - Pipe runs, sleeves, hangers, trenches, wall and slab openings, etc. Except as shown or noted.
  - Electrical conduit runs, boxes, outlets in walls and slabs.
  - Concrete inserts for electrical, mechanical or plumbing fixtures.
  - Size and location of machine or equipment bases, anchor bolts for mounts.
7. The contract structural drawings and specifications represent the finished structure. They do not indicate the method of construction. The contractor shall provide all measures necessary to protect the structure during construction. Such measure shall include, but not be limited to, bracing, shoring for loads due to construction equipment, etc. Observation visits to the site by the structural engineer shall not include inspection of the above structural members.
8. Openings, pockets, etc. larger than 6 inches shall not be placed in slabs, decks, beams, joists, columns, walls, etc. unless specifically detailed on the structural drawings. Notify the structural engineer when drawings by others show openings, pockets, etc. not shown on the structural drawings, but which are located on structural members.
9. ASTM specifications noted shall be the latest revision.
10. Contractor shall investigate site during clearing and earthwork operations for filled excavations or buried structures such as cesspools, cisterns, foundations, etc. If any such structures are found, the structural engineer shall be notified immediately.
11. Construction materials shall be spread out if placed on floors or roof. Load shall not exceed the design live load per square foot. Provide adequate shoring and/or bracing where structure has not attained design strength.
12. Design Loads:
  - Roof:
    - 24 psf DEAD
    - 20 psf LIVE
  - Floor:
    - 12 psf DEAD
    - 40 psf LIVE (Reducible)
  - Deck:
    - 12 psf DEAD
    - 40 psf LIVE
  - Wind:
    - Velocity 120 mph (3 sec. Gust)
    - Exposure "C"
    - Risk Category = II
  - Seismic:
    1. Importance Factor: I = 1
    2.  $S_s = 0.219$        $S_1 = 0.061$
    3. Site Class: "D"
    4.  $S_{DS} = 0.234$        $S_{D1} = 0.098$
    5. Seismic Design Category "B"
    6. Seismic Force Resisting System: Timber roof & floor diaphragms with wood shear walls.
    7. Base Shear:
      - $V = 4.7$  kips (House)
      - $V = 0.8$  kips (Garage)
      - $V = 0.9$  kips (Ohana)
    8.  $C_s = 0.036$
    9.  $R = 6.5$
    10. Analysis Procedure: Equivalent lateral force procedure.
    11. Risk Category: "II"

1. Footings are designed based on an allowable soil pressure of 1500 PSF. Vector Structural Engineering strongly recommends independent soils testing be performed by a licensed geotechnical engineer to verify soil bearing capacity, slope stability, and any other related soil parameters, as required.
2. Contractor shall provide for proper de-watering of excavations from surface water, ground water, seepage, etc.
3. Footings shall be placed according to depths shown on the drawings.
4. Footing back fill and utility trench back fill within building area shall be mechanically compacted in layers. Flooding will not be permitted.
5. All abandoned footings, utilities, etc. that interfere with new construction shall be removed.
6. The soil under perimeter beams and slabs shall be above optimum moisture prior to concrete placement.
7. Holdown anchor bolts shall meet the requirements of detail 11S/10.
8. All Ø1/2" anchor bolts may be replaced with ICC approved Ø1/2" Tied HD screws or Ø1/2" all thread rod in Ø5/8" hole with 4" embedded using Simpson SET-XP epoxy at the spacing indicated below.

WALL TYPE	RETROFIT Ø1/2" TITEN OR ALL-THREAD ROD SPACING
S1, S2, NON-SHEAR	SAME AS Ø1/2" A.B.
S3 & S4	12" O.C.

1. All phases of work pertaining to the concrete construction shall conform to the "Building Code Requirements for Reinforced Concrete" (ACI 318 latest approved edition) with modifications as noted in the drawings and specifications.
2. Reinforced concrete design is by the "Ultimate Strength Design Method", ACI 318-(latest edition)
3. Schedule of structural concrete 28-day strengths and types:

Location in structure	Strength PSI	Type
Slabs on Grade	3000	Hard rock
Footings	3000	Hard rock

Design based on 2500 PSI, 28-day strength, special inspection is not required unless noted otherwise in note M/S01.
4. Concrete mix design shall be submitted to the engineer for approval with the following requirements:
  - a. Compressive strength at age 28 days as specified above.
  - b. Large aggregate-hardrock, ¾" maximum size conforming to ASTM C-33
  - c. Cement-ASTM C-150, Type I or II Portland cement
  - d. Maximum slump 5-inches, max water cement ratio: 0.5
  - e. No admixtures, except for entrained air, and as approved by the engineer.
5. Concrete mixing operations, etc. shall conform to ASTM C-94
6. Placement of concrete shall conform to ACI standard 514 and project specifications.
7. Clear coverage of concrete over outer reinforcing bars shall be as follows: Concrete poured directly against earth - 3 inches clear, structural slabs - 3/4 inches clear (top and bottom), formed concrete with earth back fill - 2 inches clear.
8. All reinforcing bars, anchor bolts and other concrete inserts shall be well secured in position prior to placing concrete.
9. Provide sleeves for plumbing and electrical openings in concrete before placing. Do not cut any reinforcing that may conflict. Coring in concrete is not permitted except as shown. Notify the structural engineer in advance of conditions not shown on the drawings.
10. Conduit or pipe size (O.D.) shall not exceed 30% of slab thickness and shall be placed between the top and bottom reinforcing, unless specifically detailed otherwise. Concentrations of conduits or pipes shall be avoided except where detailed openings are provided.
11. Modulus of elasticity of concrete, when tested in accordance with ASTM C-460, shall be at least the value given by the equations in section 8.5.1 of ACI 318 for the specified 28-day strength.
12. Shrinkage of concrete, when tested in accordance with ASTM C-157, shall not exceed 0.0004 inches/inch.

1. Reinforcing bars shall conform to the requirements of ASTM A-615 grade 60.
2. All reinforcing bar bends shall be made cold
3. Minimum lap of welded wire fabric shall be 6 inches or one full mesh and one half, whichever ever is greater.
4. All bars shall be marked so their identification can be made when the final in-place inspection is made.
5. Rebar splices are to be: Class "B"
6. Reinforcing splices shall be made only where indicated on the drawings.
7. Dowels between footings and walls or columns shall be the same grade, size and spacing or number as the vertical reinforcing, respectively.

1. Framing Lumber
  - a. Douglas fir larch No. 2 grade for 2x and 4x framing except for 2x4, 2x6 studs use Douglas fir stud grade, U.N.O.
  - b. 6x framing DFL No. 1 grade
2. Bolt holes shall be 1/16" maximum larger than the bolt size. Re-tighten all nuts prior to closing in.
3. Standard cut washers shall be used under all sill plate anchor bolts, U.N.O. at shear walls. See the Shear Wall Schedule on sheet S02 for anchor bolt spacing and washer requirements at shear walls.
4. All sills or plates resting on concrete or masonry shall be pressure treated Douglas Fir. Bolts shall be placed 9 inches from the end of a plate, or from a notch greater than 1/2 the width of the plate, and spaced at intervals noted.
5. Do not notch joists, rafters or beams except where shown in details. Obtain engineer's approval for any holes or notches not detailed. Holes through sills, plates, studs and double plates in interior, bearing and shear walls shall conform with detail 6/S03.
6. Connection hardware shall be by USP or Simpson Strong-Tie, or ICC approved equal.

DUAL SPECIFICATION TABLE				
SIMPSON CONNECTOR		USP CONNECTOR	SIMPSON CONNECTOR	USP CONNECTOR
CS16		RS150	HDU2	PHD2A
ST6224		KST224	HDU4	PHD4A
A35		MPA1	HDU5	PHD5A
LUS24—2		JUS24—2	HDU8	PHD8
H1		RT15	HDU11	UPHD11
H10		RT16A		
LTP4		MP4F	STD10	STAD10
LSSU		LSSH	STD14	STAD14

7. Fastening schedule per International Building Code, 2012 Edition, table No. 2304.10.1. Unless noted otherwise.
8. All nails, bolts, holdowns, straps or other steel fasteners in contact with pressure treated timber shall be hot-dipped galvanized, stainless steel or otherwise treated or isolated to prevent chemical attack. Contractor shall verify treatment method and confirm appropriate corrosion resistance be provided in accordance with hardware supplier recommendations.
9. Non-bearing, non-shear interior walls to be anchored to floor and /or roof as indicated on detail 10/S02.

1. Prefabricated wood roof trusses shall be as designed by the truss manufacturer. Bridging size and spacing by truss manufacturer unless noted otherwise. Contractor shall submit shop drawings, erection drawings and design calculations sealed by an engineer, registered in the state of Hawaii, for review prior to manufacture. Calculations and shop drawings shall show any special details required at bearing points. All connectors shall be Simpson or equivalent with current ICC approval.
2. Truss manufacturer to design trusses for lateral load (LAT. = xxxx) in pounds, as shown on plans. Lateral loads are ASD level loads.
3. Additional trusses shall be supplied as required to support mechanical equipment.
4. All truss-to-truss and truss-to-beam connectors per truss manufacturer.

1. Glue laminated beams shall be 24F-V4 (cantilevers and continuous beams shall be 24F-V8) and have the following minimum properties: fb=2400 psi, Fv=265 psi, Fc (perpendicular)=650 psi, E=1,800,000 psi. All beams shall be fabricated using waterproof glue. Fabrication and handling per latest AITC and WCCA standards. Beams to bear grade stamp and AITC stamp and certificate. Moisture content shall be limited to 12% or less.

1. Masonry units shall conform to the latest ASTM designation C-90 (Design Fm = 2000 psi).
2. Portland cement shall conform to ASTM designation C-150 & be as specified for concrete.
3. Mortar mix shall be type S (1900 psi) per ASTM designation C-270.
4. Grout shall conform to the requirements of section 2103 of I.B.C. for coarse grout. Use sufficient water for grout to flow into all joints of the masonry without segregation. Grout shall attain a compressive strength of 2000 psi at 28 days.
5. Provide a minimum of 1/2" grout between main reinforcing & masonry units.
6. Low lift construction, maximum grout pour height is 4 feet.
7. Cells shall be in vertical alignment. Dowels in footings shall be set to align with cores containing reinforcing steel.
8. Refer to architectural drawings for surface & height of units, laying pattern & joint type.
9. Special inspection is required for all CMU walls per I.B.C. section 1704.

1. All wood structural panels shall be plywood or APA rated oriented strand board. Panels shall bear the stamp of an approved agency. Panels shall be of the span/index rating shown on the plans. Fastening shall be indicated on the plans.
2. All plywood shall be C-D interior sheathing with exterior glue. Plywood shall be 4-ply, minimum.

1. Shop drawings shall be submitted for all structural items in addition to items required by architectural specifications.
2. The contractor shall review all shop drawings prior to submittal. Items not in accordance with contract drawings shall be flagged for review.
3. Verify all dimensions with architect.
4. Any changes, substitutions, or deviations from original contract drawings shall be redlined or flagged by submitting parties, shall be considered approved after engineers review, unless noted otherwise.
5. The engineer has the right to approve or disapprove any changes to the original drawings at anytime before or after shop drawings review.
6. The shop drawings do not replace the original contract drawings. Items omitted or shown incorrectly and are not flagged by the structural engineer or architect are not to be considered changes to the original contract drawings.
7. The adequacy of engineering designs and layout performed by the others rests with the designing or submitting authority.
8. Reviewing is intended only as an aid to the contractor in obtaining correct shop drawings. Responsibility for corrections shall rest with the contractor.

1. Roof sheathing  
15/32" wood structural panel: plywood or oriented strand board (O.S.B.) panel index = 32/16, unblocked nail with 8d common nails at 6" O.C. at all boundaries and supported edges, 12" O.C. field. Minimum penetration 1" in supporting member (NER 272).
2. Floor sheathing  
3/4" (min.) wood structural panel: plywood or oriented strand board (O.S.B.) T & G, panel index = 48/16, unblocked, nail with 10d common nails at 6" O.C. at all boundaries and supported edges, 12" O.C. field.
3. Shear wall sheathing  
Sheathing for shear walls shall be as indicated on the shear wall plans and schedules. Sheathing at shear walls may be installed with panels horizontal or vertical. All shear wall panels shall have minimum wood structural panel span rating of 24/0 or "Wall-16."


1. Hot-rolled structural steel shapes & plates shall be per ASTM A36 with the following exception. All W-Flange shapes shall be per ASTM A992.
2. Structural steel pipe shall be per ASTM A53 grade B, Tube steel per ASTM A500 Grade B.
3. Nuts & bolts in structural steel connections shall be per ASTM 325N, with hardened washers. Design is based upon bearing type connections with thread not excluded, therefore, no special inspection required, U.N.O. in note M below.
4. Anchor bolts shall be per ASTM F1554, U.N.O.
5. Welds shall be by E70XX, low hydrogen electrodes, all welding shall be performed in a shop approved by the building official.
6. Grout material for base plates shall be non-metallic, non-shrink, pre-packaged grout conforming to ASTM C 1107.

1. The seismic lateral load resisting system consists of timber roof diaphragm with wood shear walls.
2. Special inspections shall be required:
  - All post-installed anchorage to concrete (periodic)
    - a. The owners shall employ special inspectors who shall provide additional inspections during construction in accordance with IBC section 17.
    - b. All special inspections shall be performed by an independent certified inspector from an established testing agency, licensed and approved by the building department.
    - c. The testing agency shall send copies of all structural testing and inspection reports directly to Vector Structural Engineering and all interested parties.
3. Structural testing is not required.
4. All reports shall be distributed on a monthly basis to the engineer of record, owner, contractor, and to the building official.
5. No structural observation is required. However, the engineer of record reserves the right to make field observations during construction approximately once per week.

[illegible]

ABBREVIATIONS			
A.B.	ANCHOR BOLT	LVL	LAMINATED VENEER LUMBER
ARCH'L	ARCHITECTURAL DRAWINGS	MFR	MANUFACTURED
BLDG	BUILDING	N.T.S.	NOT TO SCALE
BLK	BLOCK	o/	OVER
BLK'G	BLOCKING	O.C.	ON CENTER
BM	BEAM	OPT'L	OPTIONAL
CANT'L	CANTILEVERED	O.S.B.	ORIENTED STRAND BOARD
C.L.	CENTER LINE	PSL	PARALLEL STRAND LUMBER
CLG	CEILING	PL	PLATE
CMU	CONCRETE MASONRY UNIT	REQ'D	REQUIRED
COL	COLUMN	SHTH'G	SHEATHING
CONT	CONTINUOUS	SHT	SHEET
DBL	DOUBLE	SIM	SIMILAR
DTL	DETAIL	STL	STEEL
EL	ELEVATION	SW	STRONG-WALL
EOR	ENGINEER OF RECORD	T.O.F.	TOP OF FOOTING
FND	FOUNDATION	T.O.W.	TOP OF WALL
FTG	FOOTING	T&B	TOP AND BOTTOM
GL	GLUE LAMINATED (BEAM)	TYP.	TYPICAL
HDR	HEADER	U.N.O.	UNLESS NOTED OTHERWISE
HORIZ.	HORIZONTAL	VERT.	VERTICAL
H.D.	HOLD DOWN	w/	WITH
LSL	LAMINATED STRAND LUMBER	u/	UNDER

**RELEASE DATE: AUGUST 26, 2021**

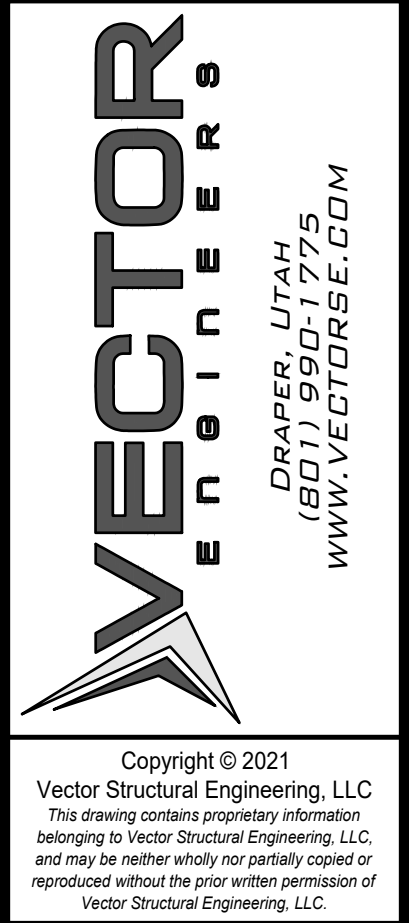[illegible]

# STRUCTURAL GENERAL NOTES


24/2025 10:13:22 AM  
 Review

THIS WORK WAS PREPARED BY  
ME OR UNDER MY SUPERVISION.  
CONSTRUCTION OF THIS  
PROJECT WILL BE UNDER MY  
OBSERVATION WHEN REQUIRED  
BY H.A.R. 16-115-9.  
EXPIRATION DATE OF LICENSE:  
04/30/2022

**U3360-010-211**

# S01




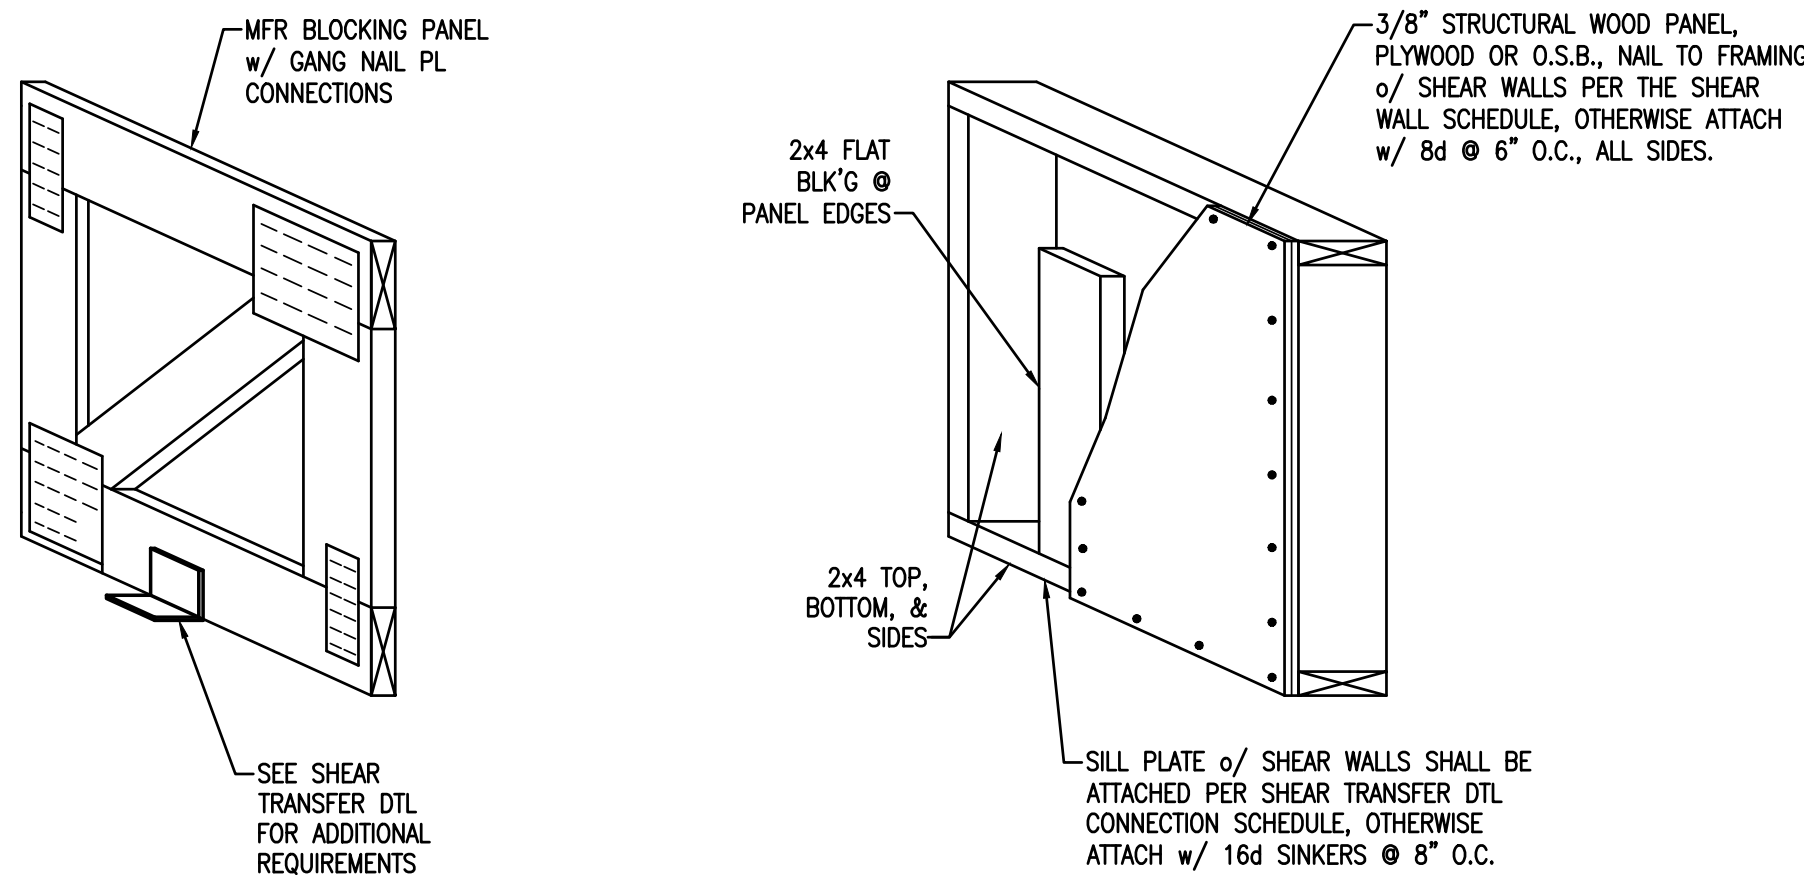

**TYPICAL BLOCKING PANEL**

N.T.S.


7

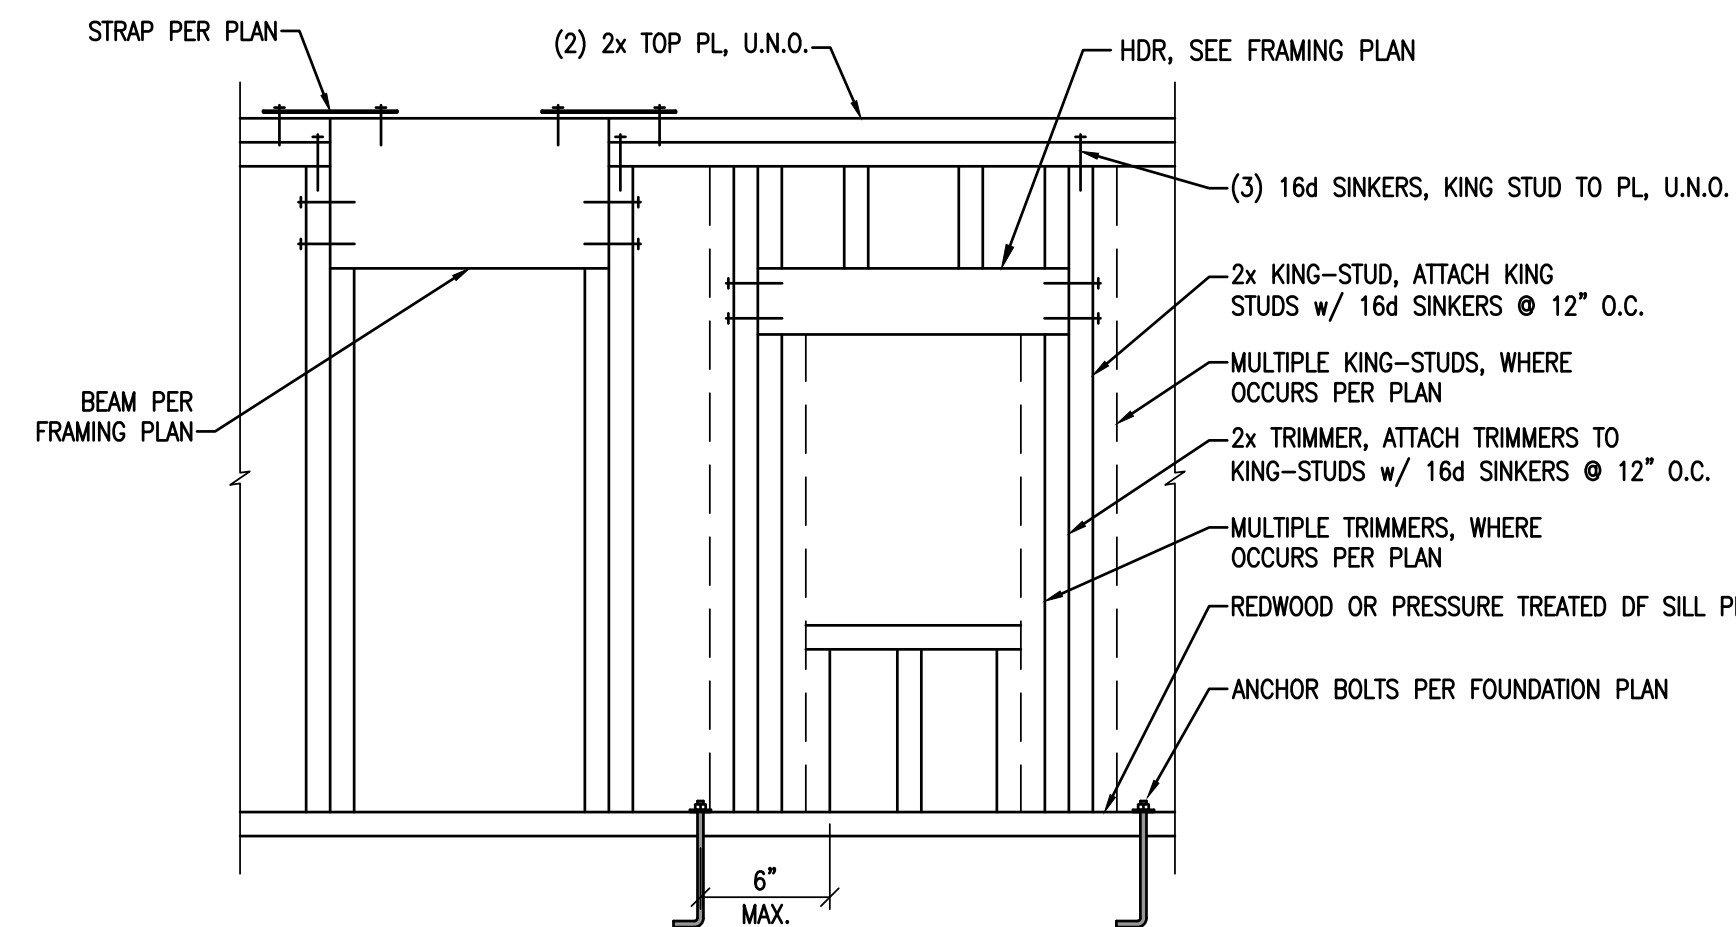

**TYPICAL WALL FRAMING**

N.T.S.

8

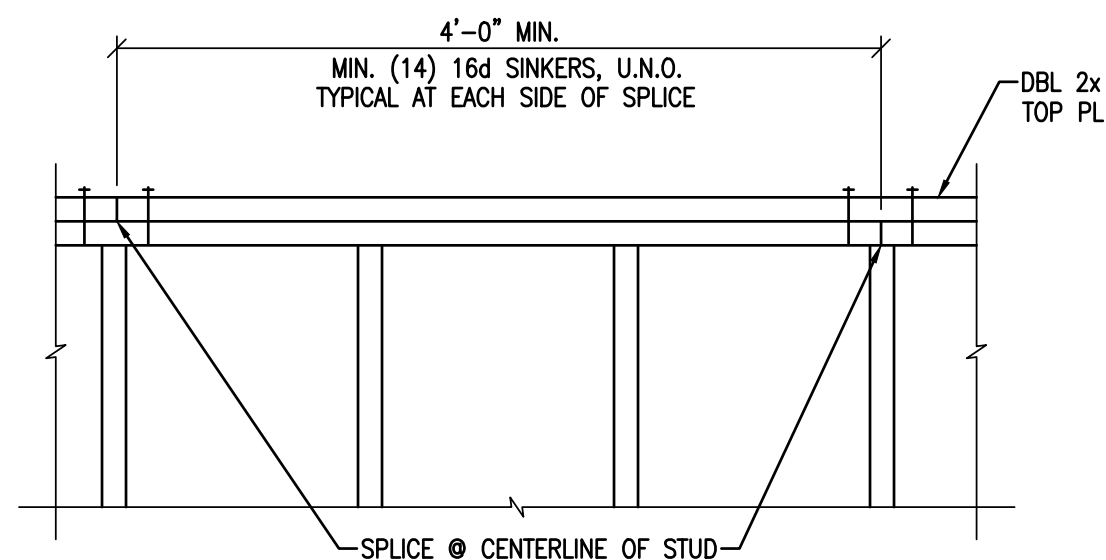


**NOTE:**  
WHERE SPLICE LENGTH IS LESS THAN 4'-0" INSTALL ST6224 STRAP AT PL SPLICES. STRAPS ARE NOT REQUIRED WHERE ONE OF THE PLATES IS CONTINUOUS FOR AT LEAST 4'-0" IN EACH DIRECTION.

**TYPICAL TOP PLATE SPLICE**

N.T.S.

9

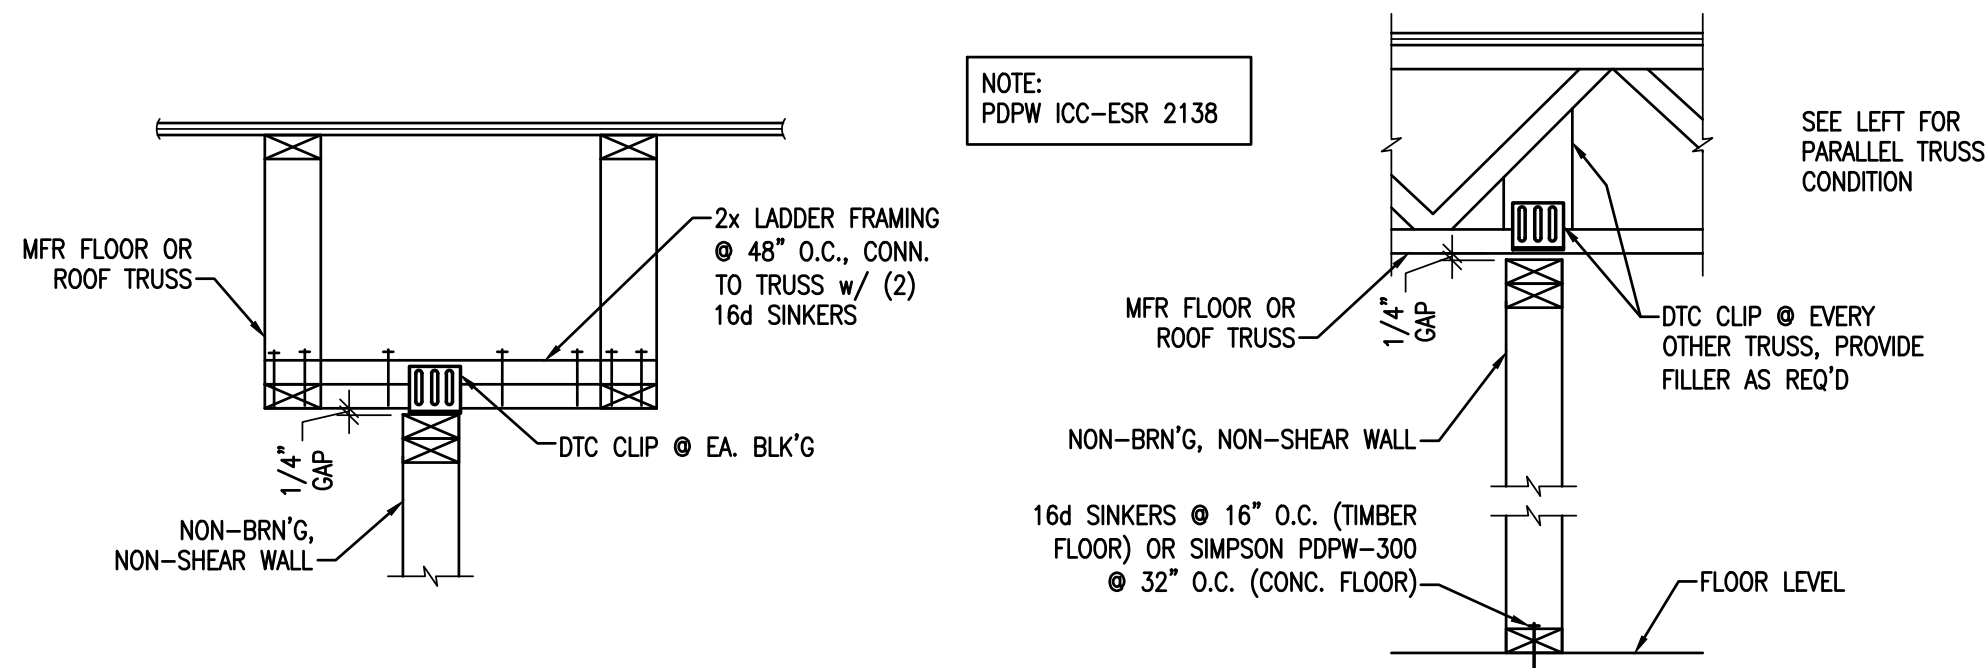

**NON-BRN'G & NON-SHEAR WALL CONN.**

N.T.S.

10


STUD HEIGHT TABLE			
STUD WALL TYPE	BEARING AND/OR SHEAR WALLS (MAX. HEIGHT)		NON-BEARING AND NON-SHEAR WALLS (MAX. HEIGHT)
	EXTERIOR	INTERIOR	INTERIOR ONLY
2x4 STUD @ 16" O.C.	8'-6"	10'-0"	13'-0"
2x4 STUD @ 12" O.C.	9'-6"	11'-6"	14'-0"
(2) 2x4 STUD @ 16" O.C.	12'-0"	13'-6"	14'-0"
2x4 DFL #2 @ 16" O.C.	9'-0"	11'-0"	13'-0"
2x4 DFL #2 @ 12" O.C.	10'-6"	13'-0"	14'-0"
(2) 2x4 DFL #2 @ 16" O.C.	13'-0"	13'-6"	14'-0"
2x6 STUD @ 16" O.C.	14'-6"	19'-0"	20'-0"
2x6 STUD @ 12" O.C.	17'-0"	21'-0"	22'-0"
(2) 2x6 STUD @ 16" O.C.	21'-0"	22'-0"	22'-6"
2x6 DFL #2 @ 16" O.C.	16'-6"	19'-6"	20'-0"
2x6 DFL #2 @ 12" O.C.	18'-6"	21'-6"	22'-0"
(2) 2x6 DFL #2 @ 16" O.C.	22'-6"	22'-6"	22'-6"
2x8 DFL #2 @ 16" O.C.	22'-0"	26'-6"	27'-0"
2x8 DFL #2 @ 12" O.C.	25'-6"	28'-0"	30'-0"
(2) 2x8 DFL #2 @ 16" O.C.	29'-6"	29'-6"	30'-0"
1-3/4 x 7-1/4 LVL STUDS @ 16" O.C.	27'-0"	30'-0"	30'-0"
1-3/4 x 5-1/2 LVL STUDS @ 16" O.C.	20'-6"	21'-6"	22'-0"

**NOTES:**  
1. THIS TABLE ASSUMES IBC WIND LOADS w/ 115 mph, EXP. "C" AT EXTERIOR WALLS & 5 psf LATERAL LOAD AT INTERIOR WALLS.  
2. THIS TABLE ASSUMES AXIAL DL = 710 lb/ft, LL = 760 lb/ft. AT EXTERIOR AND INTERIOR WALLS.  
3. THIS TABLE ASSUMES IBC 5psf LATERAL LOAD @ INTERIOR WALLS.

**STANDARD STUD TABLE**

N.T.S.

4

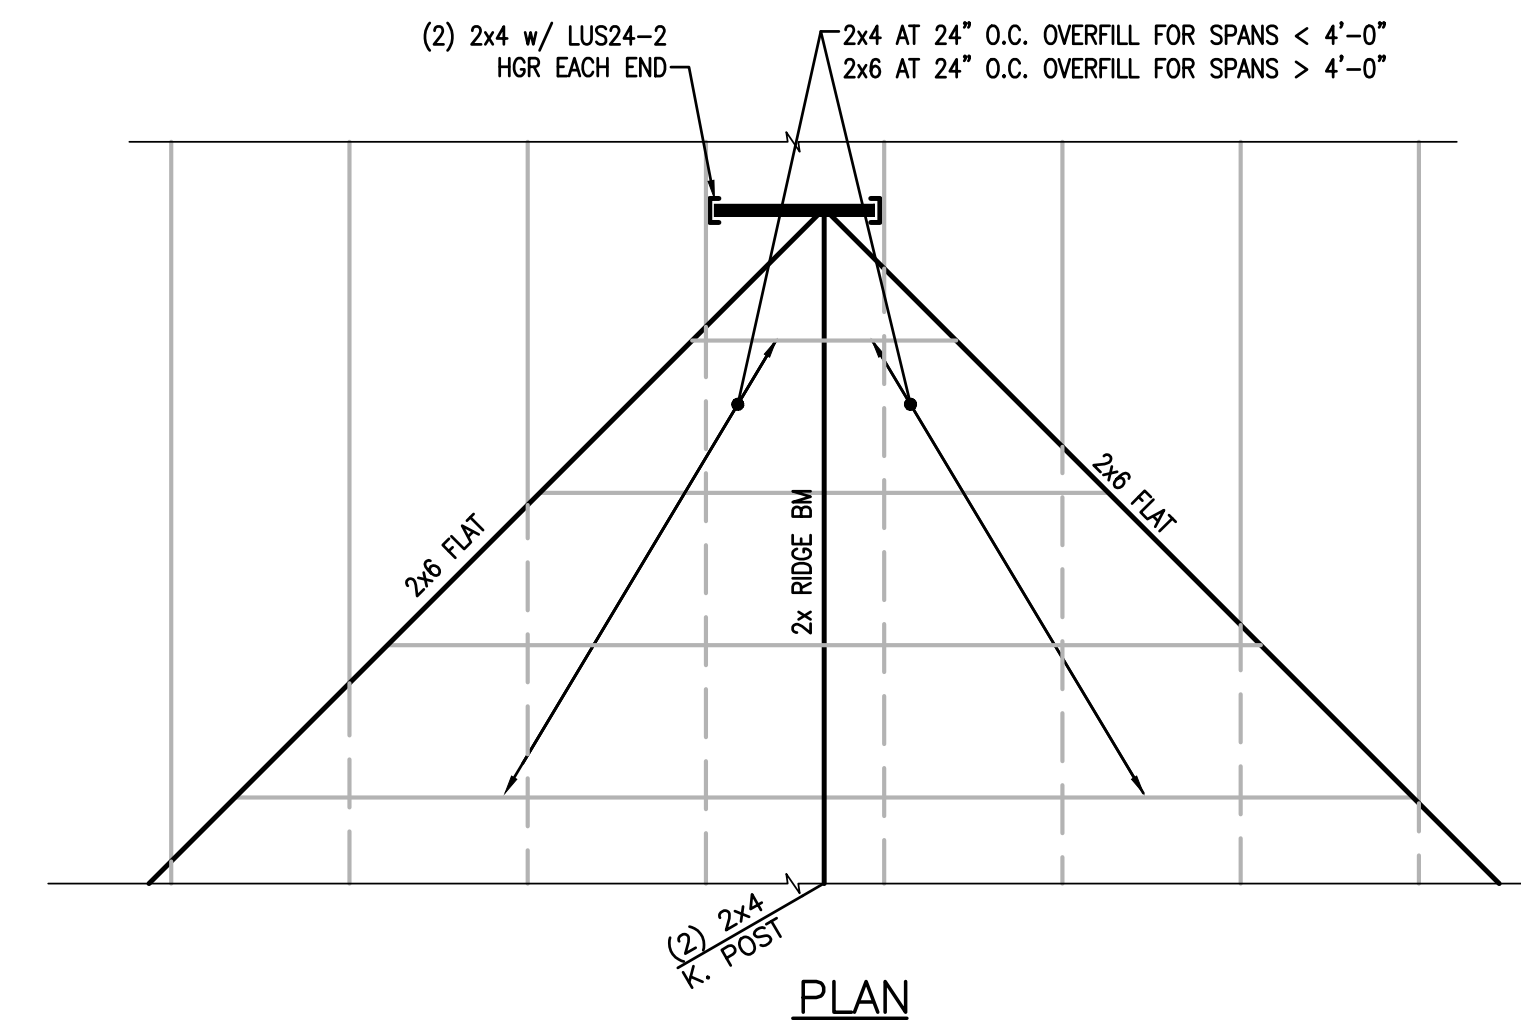

**TYPICAL OVERBUILD**

N.T.S.

6

SHEAR WALL SCHEDULE						
MARK	MIN. BLOCKED MATERIAL	EDGE / BOUNDARY NAILING	FIELD NAILING	SOLE PL. NAILING, WHERE OCCURS	WALL CAPACITY SEISMIC WIND	DEFAULT SILL ANCHORAGE, U.N.O.
$\Delta_1$	3/8" PLYWOOD OR O.S.B.	8d COMMON NAILS @ 6" O.C.	8d COMMON NAILS @ 12" O.C.	16d SINKERS @ 8" O.C.	260 plf 365 plf	$\Delta_1$
$\Delta_2$	3/8" PLYWOOD OR O.S.B.	8d COMMON NAILS @ 4" O.C.	8d COMMON NAILS @ 12" O.C.	16d SINKERS @ 4" O.C.	350 plf 520 plf	$\Delta_2$
$\Delta_3$	3/8" PLYWOOD OR O.S.B.	8d COMMON NAILS @ 3" O.C.	8d COMMON NAILS @ 12" O.C.	16d SINKERS @ 3" O.C.	490 plf 685 plf	$\Delta_3$
$\Delta_4$	3/8" PLYWOOD OR O.S.B.	8d COMMON NAILS @ 2" O.C.	8d COMMON NAILS @ 12" O.C.	16d SINKERS @ 2" O.C.	640 plf 895 plf	$\Delta_4$

SILL ANCHORAGE SCHEDULE			
MARK	NOMINAL SILL PL THICKNESS	$\phi$ 1/2" A.B. SPACING	$\phi$ 5/8" A.B. SPACING
$\Delta_1$	2x	32" O.C.	48" O.C.
$\Delta_2$	2x	24" O.C.	32" O.C.
$\Delta_3$	2x	16" O.C.	24" O.C.
$\Delta_4$	2x	12" O.C.	16" O.C.


SHEAR WALL LENGTH TOLERANCES	
SPECIFIED SHEAR WALL LENGTH	ACCEPTABLE SHEAR WALL TOLERANCE
UP TO 3'-0"	$\pm$ 2"
OVER 3'-0" AND UP TO 5'-0"	$\pm$ 3"
OVER 5'-0" AND UP TO 7'-0"	$\pm$ 4"
OVER 7'-0" AND UP TO 10'-0"	$\pm$ 6"
OVER 10'-0"	$\pm$ 8"

- ALL SHEAR WALLS SHALL BE FRAMED TO THE MINIMUM LENGTHS SHOWN ON THE PLANS WITH THE TOLERANCES INDICATED ON THE TABLE ABOVE, U.N.O. ON PLAN w/ MINIMUM WALL LENGTH.
- ALL SHEAR WALLS SHALL TERMINATE ON AT LEAST (1) FULL HEIGHT STUD. ADDITIONAL STUDS OR SOLID POSTS SHALL BE INSTALLED AS REQUIRED FOR HOLDDOWNS WHERE THEY OCCUR.
- 8d COMMON NAIL SHANK DIAMETER = .131", 16d SINKER SHANK DIAMETER = .148"
- FOR "P3" AND "P4" SHEAR WALLS, ALL FRAMING RECEIVING EDGE NAILING FROM ADJOINING PANEL EDGES SHALL BE 3-INCH NOMINAL OR WIDER AND NAILS SHALL BE STAGGERED. AS AN ALTERNATE, (2) 2x STUDS MAY BE USED PROVIDED THEY ARE NAILED TOGETHER w/ (2) 16d SINKERS @ 6" O.C. FULL HEIGHT.
- FOR "P2", "P3" AND "P4" DOUBLE-SIDED SHEAR WALLS, PANEL JOINTS SHALL BE OFFSET TO FALL ON DIFFERENT FRAMING MEMBERS, OR FRAMING SHALL BE 3-INCH NOMINAL OR WIDER AT ADJOINING PANEL EDGES AND NAILS ON EACH SIDE SHALL BE STAGGERED.
- ALL ANCHOR BOLTS SHALL HAVE 7" MINIMUM EMBEDMENT.
- ALL SHEAR WALL ANCHOR BOLTS SHALL INCLUDE A STEEL 3"x3"x0.229" PLATE WASHER BETWEEN THE SILL PL & NUT. THE HOLE IN THE PLATE WASHER IS PERMITTED TO BE DIAGONALLY SLOTTED WITH A WIDTH OF UP TO 3/4" LARGER THAN THE BOLT DIAMETER AND A SLOT LENGTH NOT TO EXCEED 1 1/4". PROVIDED A STANDARD CUT WASHER IS PLACED BETWEEN THE PLATE WASHER AND THE NUT. ANCHOR BOLTS & PLATE WASHERS ARE TO BE OFFSET TOWARD THE SHEATHED WALL EDGE TO LIMIT THE GAP BETWEEN THE EDGE OF WASHER TO SHEATHING TO A MAXIMUM OF 1/2". WHERE BOTH SIDES OF A 2x6 WALL IS SHEATHED A STEEL 4-1/2"x3"x0.229" PLATE WASHER SHALL BE CENTERED ON THE SILL PLATE, PER DTL 2/-.

**STANDARD SHEAR WALL SCHEDULE**

N.T.S.

1

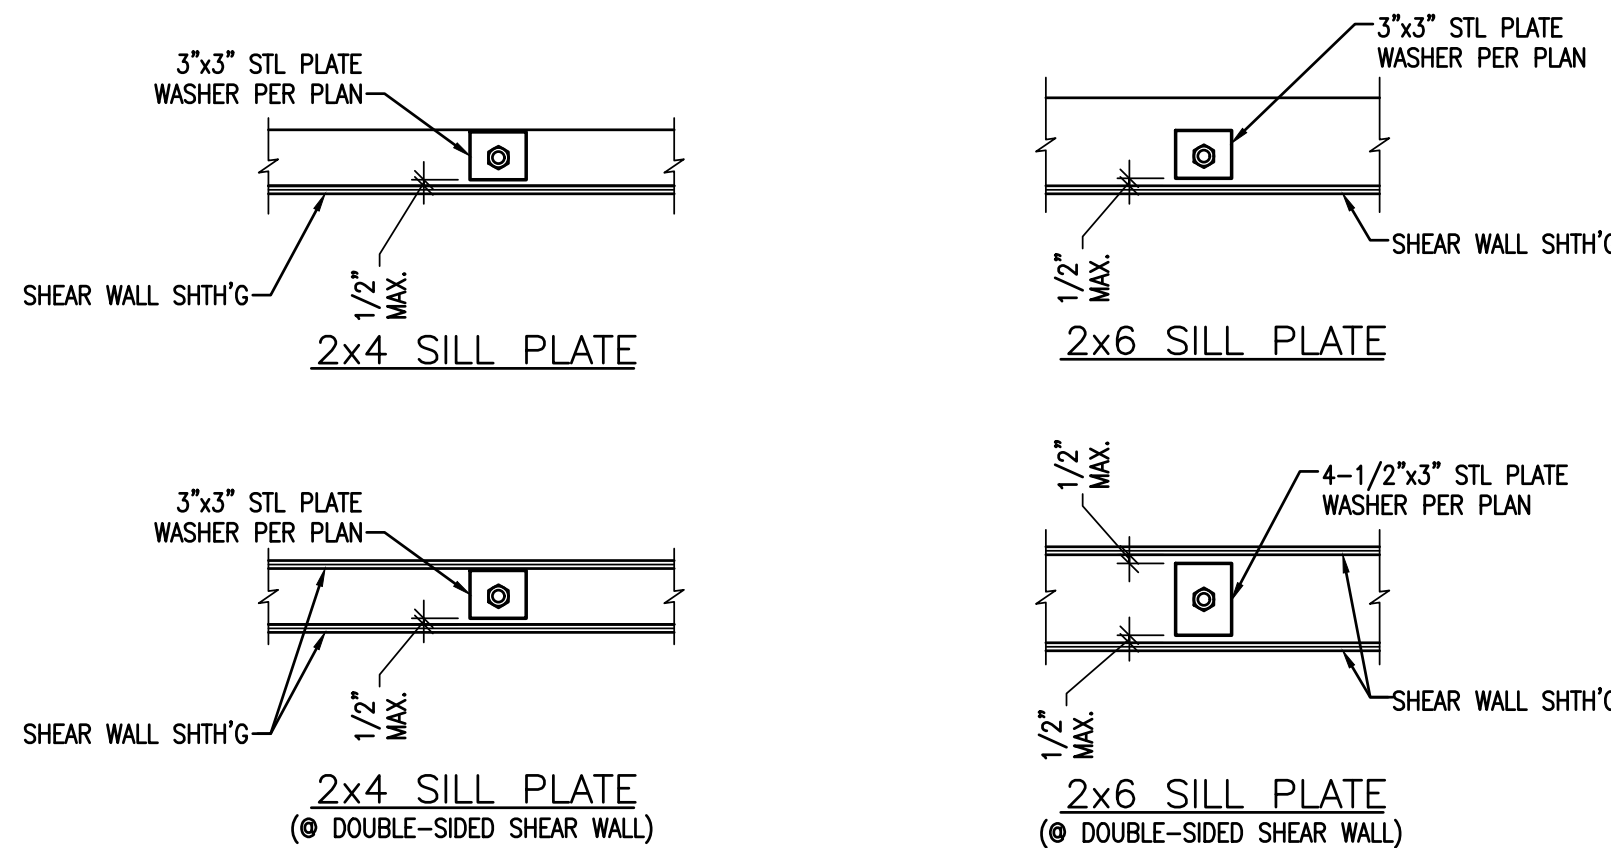

**TYP. SHEAR WALL WASHERS**

N.T.S.

2

FOOTING SCHEDULE		
MARK	SIZE	REINFORCING, BOTTOM
F2.0	2'-0" SQ. x 12" THICK	(3) #4 EACH WAY
F2.5	2'-6" SQ. x 12" THICK	(4) #4 EACH WAY
F3.0	3'-0" SQ. x 12" THICK	(4) #4 EACH WAY
F3.5	3'-6" SQ. x 12" THICK	(5) #4 EACH WAY
F4.0	4'-0" SQ. x 12" THICK	(6) #4 EACH WAY
F4.5	4'-6" SQ. x 12" THICK	(6) #4 EACH WAY
F5.0	5'-0" SQ. x 12" THICK	(7) #4 EACH WAY
F5.5	5'-6" SQ. x 12" THICK	(8) #4 EACH WAY

**STANDARD FOOTING SCHEDULE**

N.T.S.

3



Copyright © 2021  
Vector Structural Engineering, LLC  
This drawing contains proprietary information  
belonging to Vector Structural Engineering, LLC,  
and may be neither wholly nor partially copied or  
reproduced without the prior written permission of  
Vector Structural Engineering, LLC.

**STANDARD DETAILS & SCHEDULES**

For Review

12/24/2025 10:13:22 AM


THIS WORK WAS PREPARED BY ME OR UNDER MY SUPERVISION. CONSTRUCTION OF THIS PROJECT WILL BE UNDER MY OBSERVATION WHEN REQUIRED BY H.A.R. 16-115-9 EXPIRATION DATE OF LICENSE: 04/30/2022

U3360-010-211

**S02**




PLATE NOTCHES OR HOLES

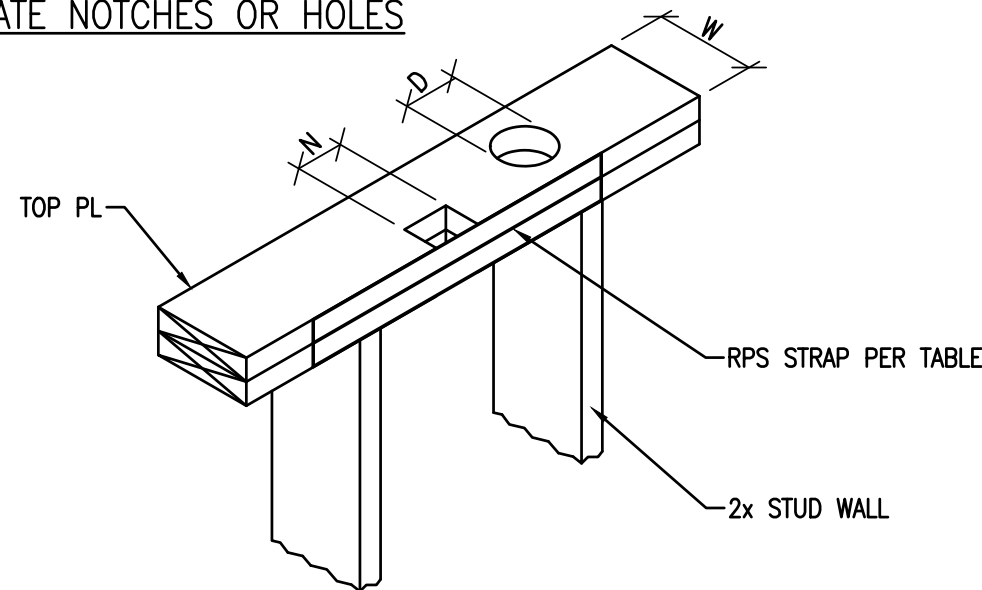

2x4 STUD HOLE DIA. 'd'	2x6 STUD HOLE DIA. 'd'	2x4 & 2x6 PLATE NOTCH WIDTH 'N' (MAX. NOTCH DEPTH = W/2)	RPS STRAP
≤ 7/8"	≤ 1"	≤ 1"	NONE
≤ 1"	≤ 1 3/8"	≤ 2 1/2"	(1) RPS18
≤ 1 3/8"	≤ 2 1/8"	≤ 5 1/2"	(2) RPS18
≤ 2"	≤ 3 1/4"	≤ 12"	(2) RPS28

- NOTES:
- USE RPS2Z FOR SILL PLATE.
  - CENTER STRAPS @ NOTCH OR HOLE.
  - WHERE ROOF TRUSS OR FLOOR JOIST IS BEARING WITHIN STUD BAY OF THE HOLE OR NOTCH, INSTALL AN ADDITIONAL STUD DIRECTLY BELOW THE TRUSS OR JOIST UNLESS NO RPS STRAP IS REQUIRED OR WHERE EXISTING STUD FACE IS WITHIN 3" OF TRUSS OR JOIST FACE.
  - NOTCHES & HOLES MUST BE SEPARATED BY "2x0" OR "2xN".
  - WHERE MULTIPLE HOLES ARE LOCATED ADJACENT TO EACH OTHER, THE STRAP REPAIR MAY BE WITH A CS16 STRAP ON EACH SIDE OF THE UPPER PLATE. THE STRAPS AND NAILING SHALL EXTEND AT LEAST 9" BEYOND EACH END OF THE WHOLE GROUP. NAILING BETWEEN THE HOLES IS NOT REQUIRED. NAILS IN THE CS16 STRAPS MAY BE N8'S OR N10'S.

STUD NOTCHES OR HOLES

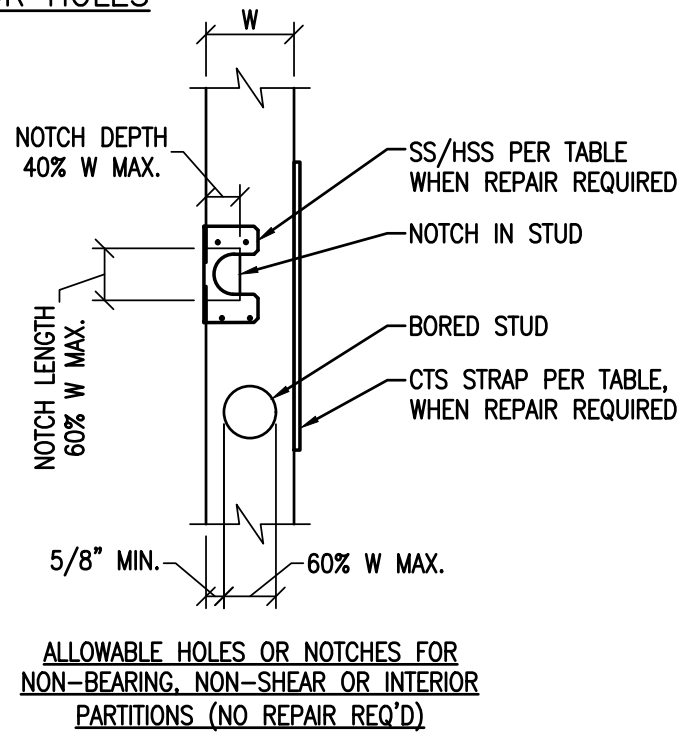

HOLE / NOTCH SCHEDULE			
HOLE / NOTCH % OF 'W'	2x4 STUD	2x6 STUD	
25%	3/4"	1-3/8"	
40%	1-3/8"	2-1/8"	
60%	2"	3-1/4"	

- NOTES:
- HOLES & NOTCHES SHALL NOT OCCUR IN THE SAME STUD.
  - WHERE HOLES OR NOTCHES EXCEED THOSE SHOWN ABOVE, REPAIR PER TABLE BELOW.
  - ALL NOTCHES IN BEARING OR SHEAR OR EXTERIOR WALLS REQUIRE REPAIRS.

STUD HOLE REPAIR			
	2x4 STUD HOLE DIA. 'd'	2x6 STUD HOLE DIA. 'd'	REPAIR
NON-BEARING & NON-SHEAR & INTERIOR	≤ 2 3/4"	≤ 4 1/2"	(1) CTS218 w/ 10d
BEARING OR SHEAR OR EXTERIOR WALL	≤ 3/4"	≤ 1 3/8"	(1) CTS218 w/ 10d
BEARING OR SHEAR OR EXTERIOR	≤ 2 3/4"	≤ 4 1/2"	(2) CTS218 TWO-SIDED w/ 10d


STUD NOTCH REPAIR					
	2x4 STUD	2x4 STUD	2x6 STUD	2x6 STUD	REPAIR
	NOTCH DEPTH	NOTCH LENGTH	NOTCH DEPTH	NOTCH LENGTH	
NON-BEARING & NON-SHEAR & INTERIOR	≤ 2 1/2"	≤ 4 1/2"	≤ 3 3/4"	≤ 4 1/2"	(1) CTS218 w/ 10d
BEARING OR SHEAR OR EXTERIOR WALL	≤ 1 1/2"	≤ 2 1/2"	≤ 2 1/2"	≤ 2 1/2"	SS w/ 10d
BEARING OR SHEAR OR EXTERIOR	≤ 2 3/4"	≤ 4 1/2"	≤ 4 1/2"	≤ 4 1/2"	(2) CTS218 TWO-SIDED w/ 10d

DRILLING & NOTCHING OF PLATES & STUDS

N.T.S.

MFR TRUSS TO BEAM HANGERS				
CARRYING MEMBER	CARRIED MBR WIDTH	HANGER TYPE	MAX. REACTION (FROM TRUSS CALCS.) (LBS)	NOTES
STEEL OR TIMBER	1-1/2"	LUS210	1275	FACE MOUNT
STEEL OR TIMBER	1-1/2"	HUS26	2565	FACE MOUNT
STEEL OR TIMBER	1-1/2"	HGUS26	3750	FACE MOUNT
STEEL OR TIMBER	1-1/2"	HGUS28	5720	FACE MOUNT
STEEL OR TIMBER	3"	LUS26-2	1000	FACE MOUNT
STEEL OR TIMBER	3"	HHUS26-2	2580	FACE MOUNT
STEEL OR TIMBER	3"	HGU26-2	3940	FACE MOUNT
STEEL OR TIMBER	3"	HGUS28-2	6805	FACE MOUNT
STEEL OR TIMBER	3"	HGUS210-2	8650	FACE MOUNT
STEEL OR TIMBER	3-1/2"	LUS46	1000	FACE MOUNT
STEEL OR TIMBER	3-1/2"	HHUS46	2580	FACE MOUNT
STEEL OR TIMBER	3-1/2"	HGUS46	3940	FACE MOUNT
STEEL OR TIMBER	3-1/2"	HGUS48	6805	FACE MOUNT
STEEL OR TIMBER	6"	HGUS26-4	3940	FACE MOUNT
STEEL OR TIMBER	6"	HGUS210-4	8780	FACE MOUNT
STEEL OR TIMBER	6"	HGUS212-4	9155	FACE MOUNT

- NOTES:
- FOR STEEL BEAMS CARRYING FLOOR TRUSSES, PROVIDE TIMBER FILLER PER DTL BELOW.
  - ALTERNATE HANGERS MAY BE USED AT THE CONTRACTOR'S OPTION. SUBMIT TO ENGINEER OF RECORD FOR APPROVAL.
  - HANGERS APPLICABLE FOR TIMBER BEAMS.

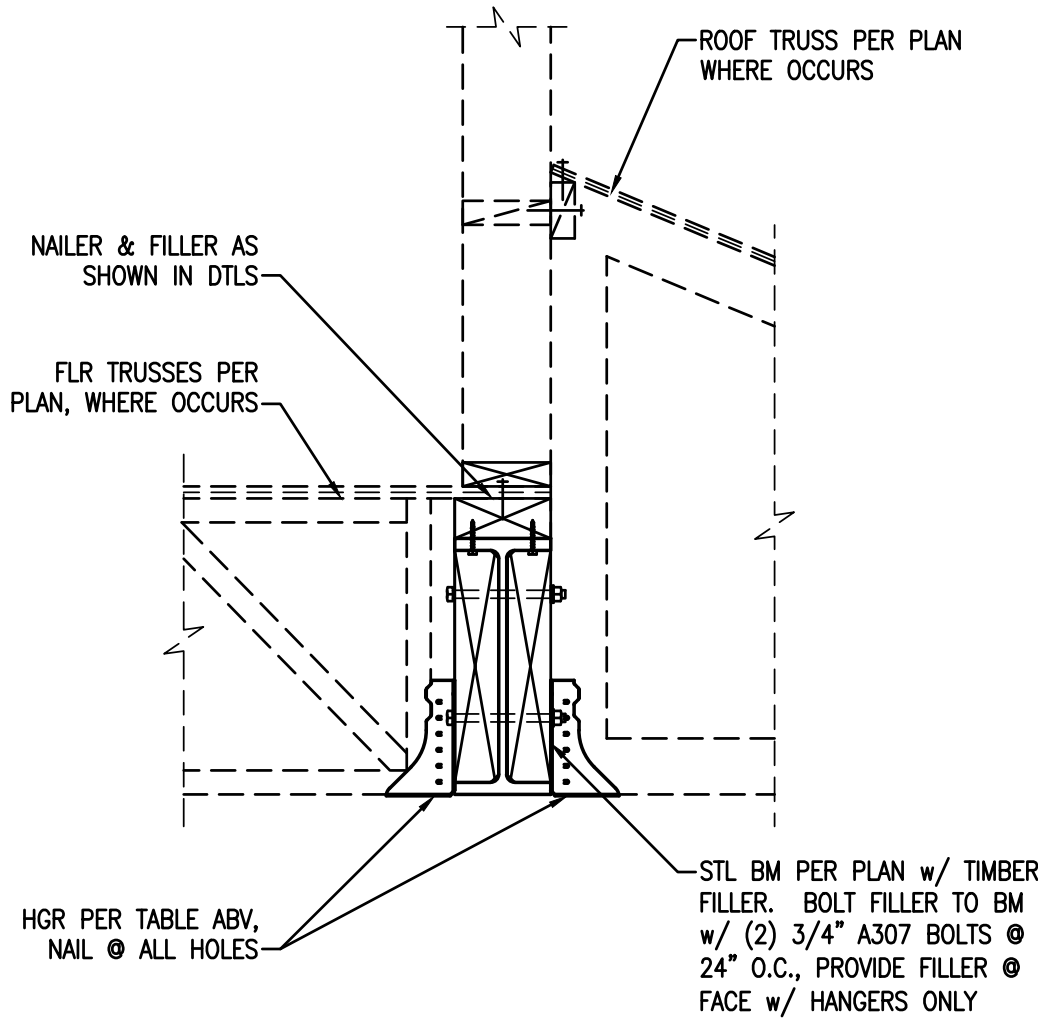

TYPICAL STEEL BEAM

TYPICAL TRUSS HANGERS

N.T.S.


4

STANDARD TRUSS TIE-DOWNS		
UPLIFT LOAD PER TRUSS MANUFACTURER	SIMPSON TIE-DOWN	REQ'D ALIGNED HOLDOWN & POST
200 TO 365 LBS	H2.5 OR CS16	NOT REQ'D
< 400 LBS	H1 OR CS16	NOT REQ'D
< 845 LBS	H10 OR H7Z OR CS16	NOT REQ'D
< 1265 LBS	H16 OR CS16	HDU2 & (2) 2x4 POST
< 1785 LBS	LGT2	HDU2 & (2) 2x4 POST
<6485 LBS	HGT-2	(2) 2x4 POST w/HDU4 @ BASE & (2) HDU2 @ TOP TO HGT-2. AT (1) PLY TRUSS, INSTALL 2x SHAPED FILLER ADJACENT TO TRUSS AT BEARING

- NOTES:
- TIE-DOWN CAPACITIES ARE BASED ON SPRUCE PINE FIR.
  - TRUSS UPLIFT OF LESS THAN 200lbs: TIE-DOWN NOT REQ'D.
  - SEE TYPICAL HOLDOWN ANCHORAGE DETAIL FOR HDU HOLDOWN INSTALLATION.

STANDARD FLOOR-TO-FLOOR STRAP		
UPLIFT LOAD PER TRUSS MANUFACTURER	SIMPSON TIE-DOWN	REQ'D ALIGNED POST
< 1705 LBS	CS16	2x4 POST
< 3410 LBS	(2) CS16	(2) 2x4 POST


- NOTES:
- INSTALL CS16 STRAPS TO 2x STUDS ABOVE AND BELOW FLOOR FRAMING. NAIL EACH END w/ (11) 10d NAILS. (STRAP LENGTH = 48").
  - WHERE UPLIFT OCCURS ABOVE HDR OR BM, INSTALL STRAP PER SCHEDULE AT EACH TRIMMER OR POST.
  - FLOOR TO FLOOR STRAPS REQ'D ALIGNED WITH ROOF TRUSS ABV.

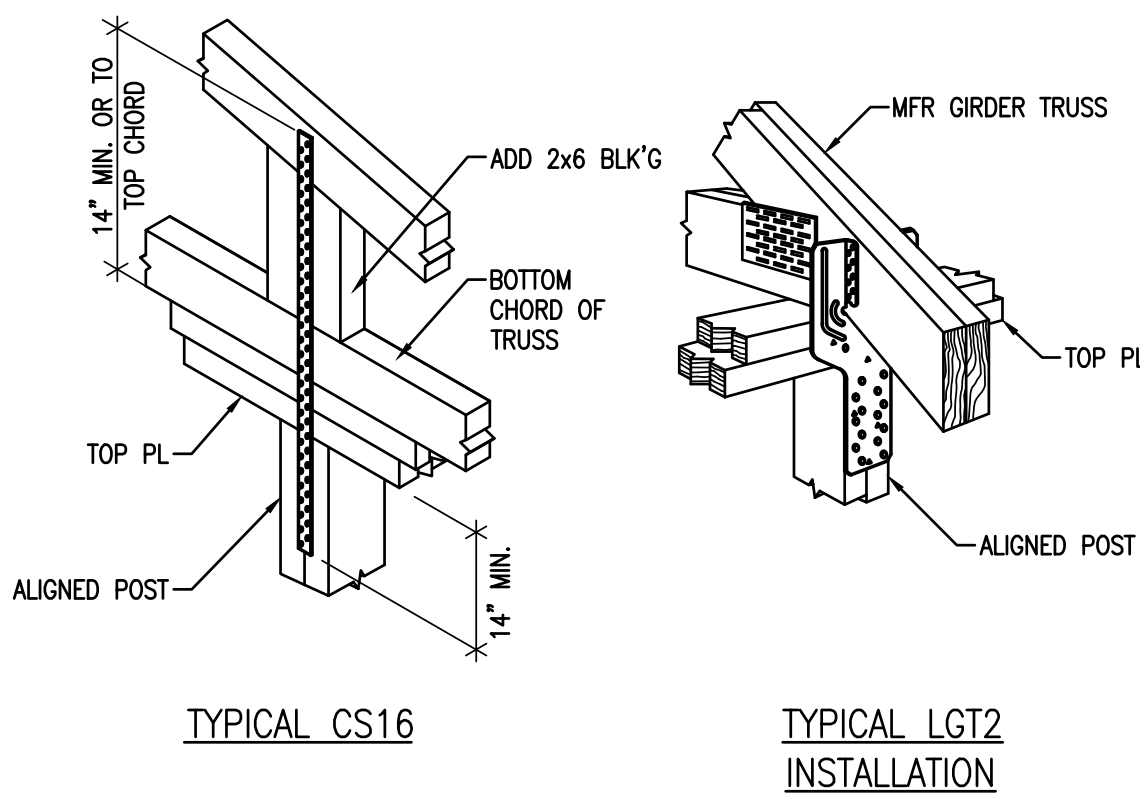


TYPICAL TRUSS ANCHORAGE

N.T.S.


2

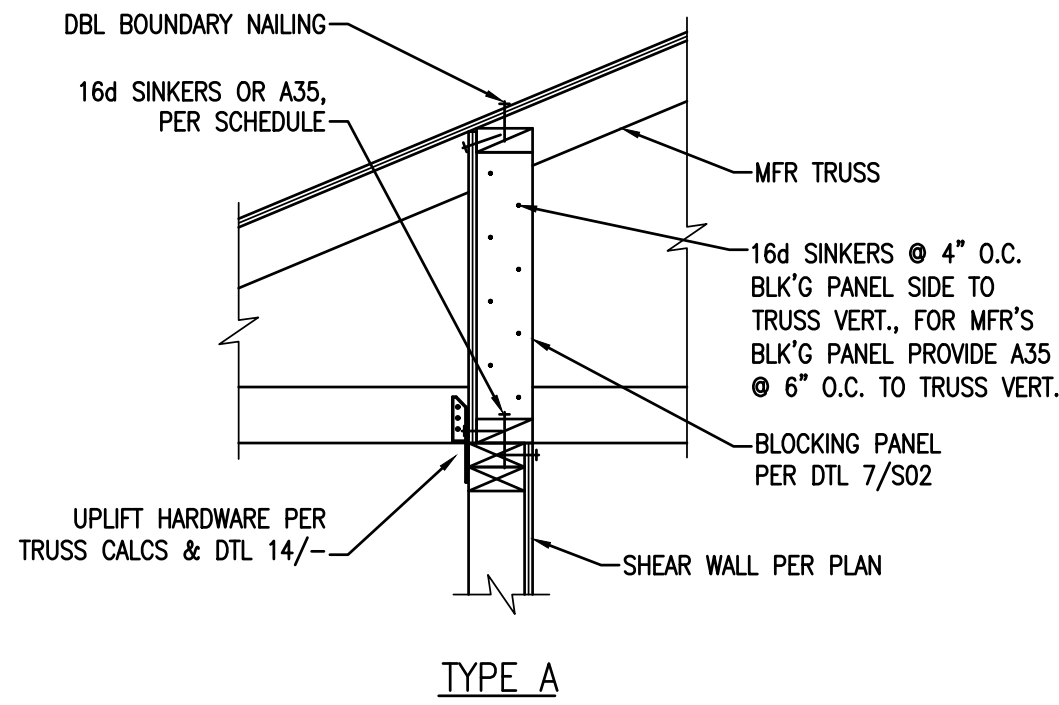


TYPE A

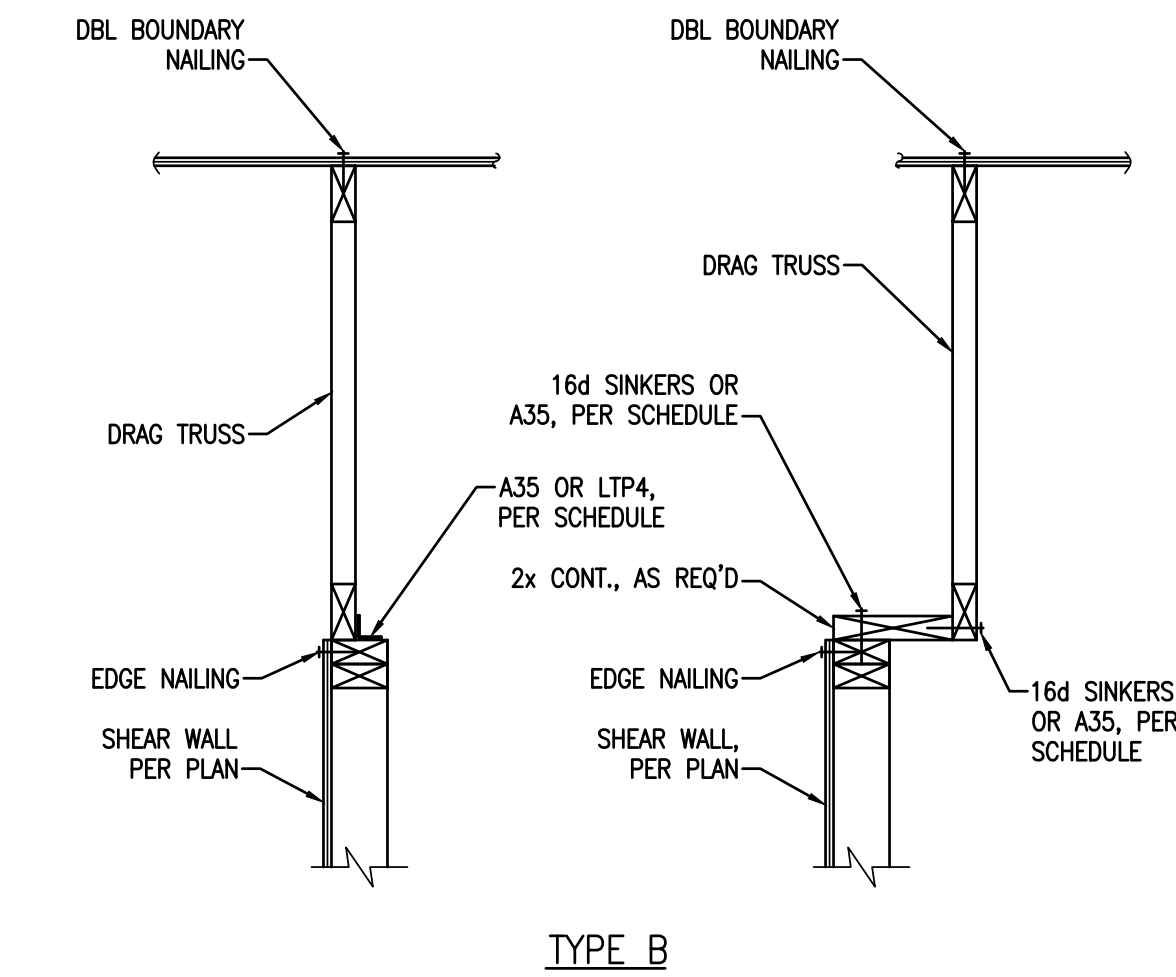

TYPE B

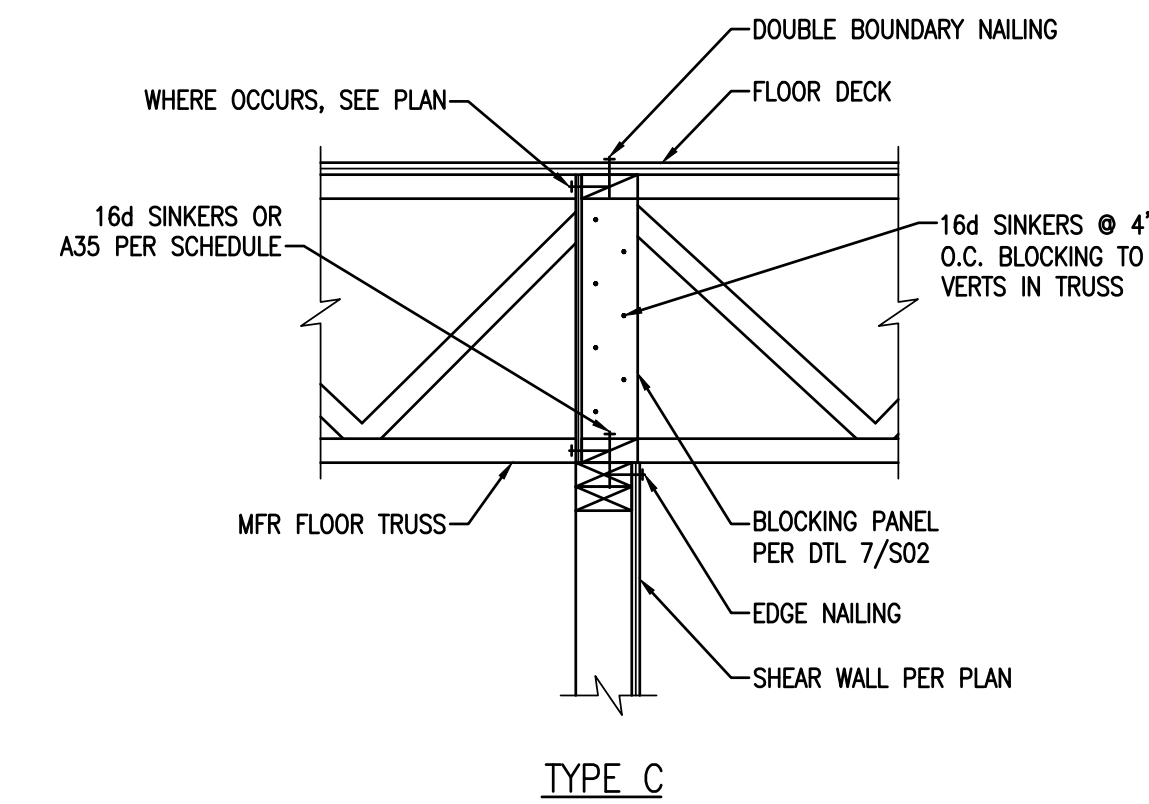

TYPE C

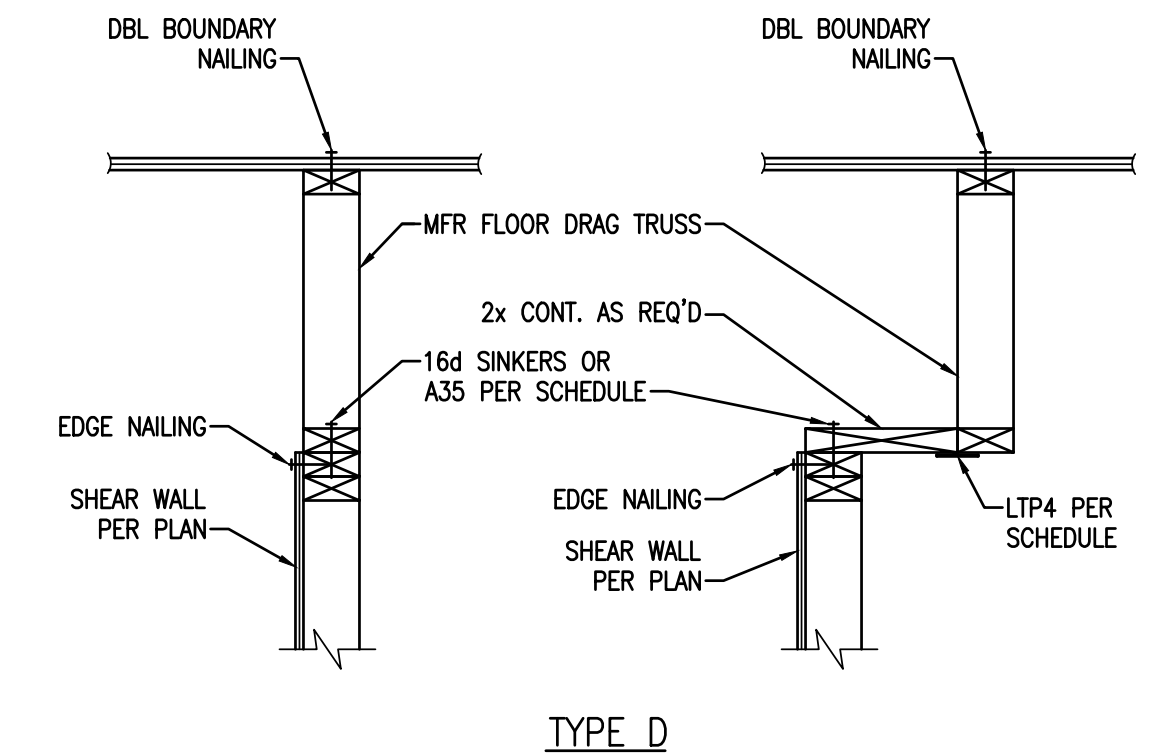

TYPE D

CONNECTION SCHEDULE		
SHEAR WALL	A35 OR LTP4	16d SINKERS
P1	18" O.C.	6" O.C.
P2	12" O.C.	4" O.C.
P3	10" O.C.	3" O.C. (STAGGERED)
P4	8" O.C.	2" O.C. (STAGGERED)

SHEAR TRANSFER

N.T.S.

1

DATE	REV	#	DATE	BY	DESCRIPTION
08-26-21					



Copyright © 2021  
Vector Structural Engineering, LLC  
This drawing contains proprietary information  
belonging to Vector Structural Engineering, LLC,  
and may be neither wholly nor partially copied or  
reproduced without the prior written permission of  
Vector Structural Engineering, LLC.

STANDARD DETAILS & SCHEDULES

For Review


2/24/2025 10:13:22 AM

THIS WORK WAS PREPARED BY ME OR UNDER MY SUPERVISION. CONSTRUCTION OF THIS PROJECT WILL BE UNDER MY OBSERVATION WHEN REQUIRED BY H.A.R. 16-115-9 EXPIRATION DATE OF LICENSE: 04/30/2022


U3360-010-211

S03





12/9/2021 8:39 AM

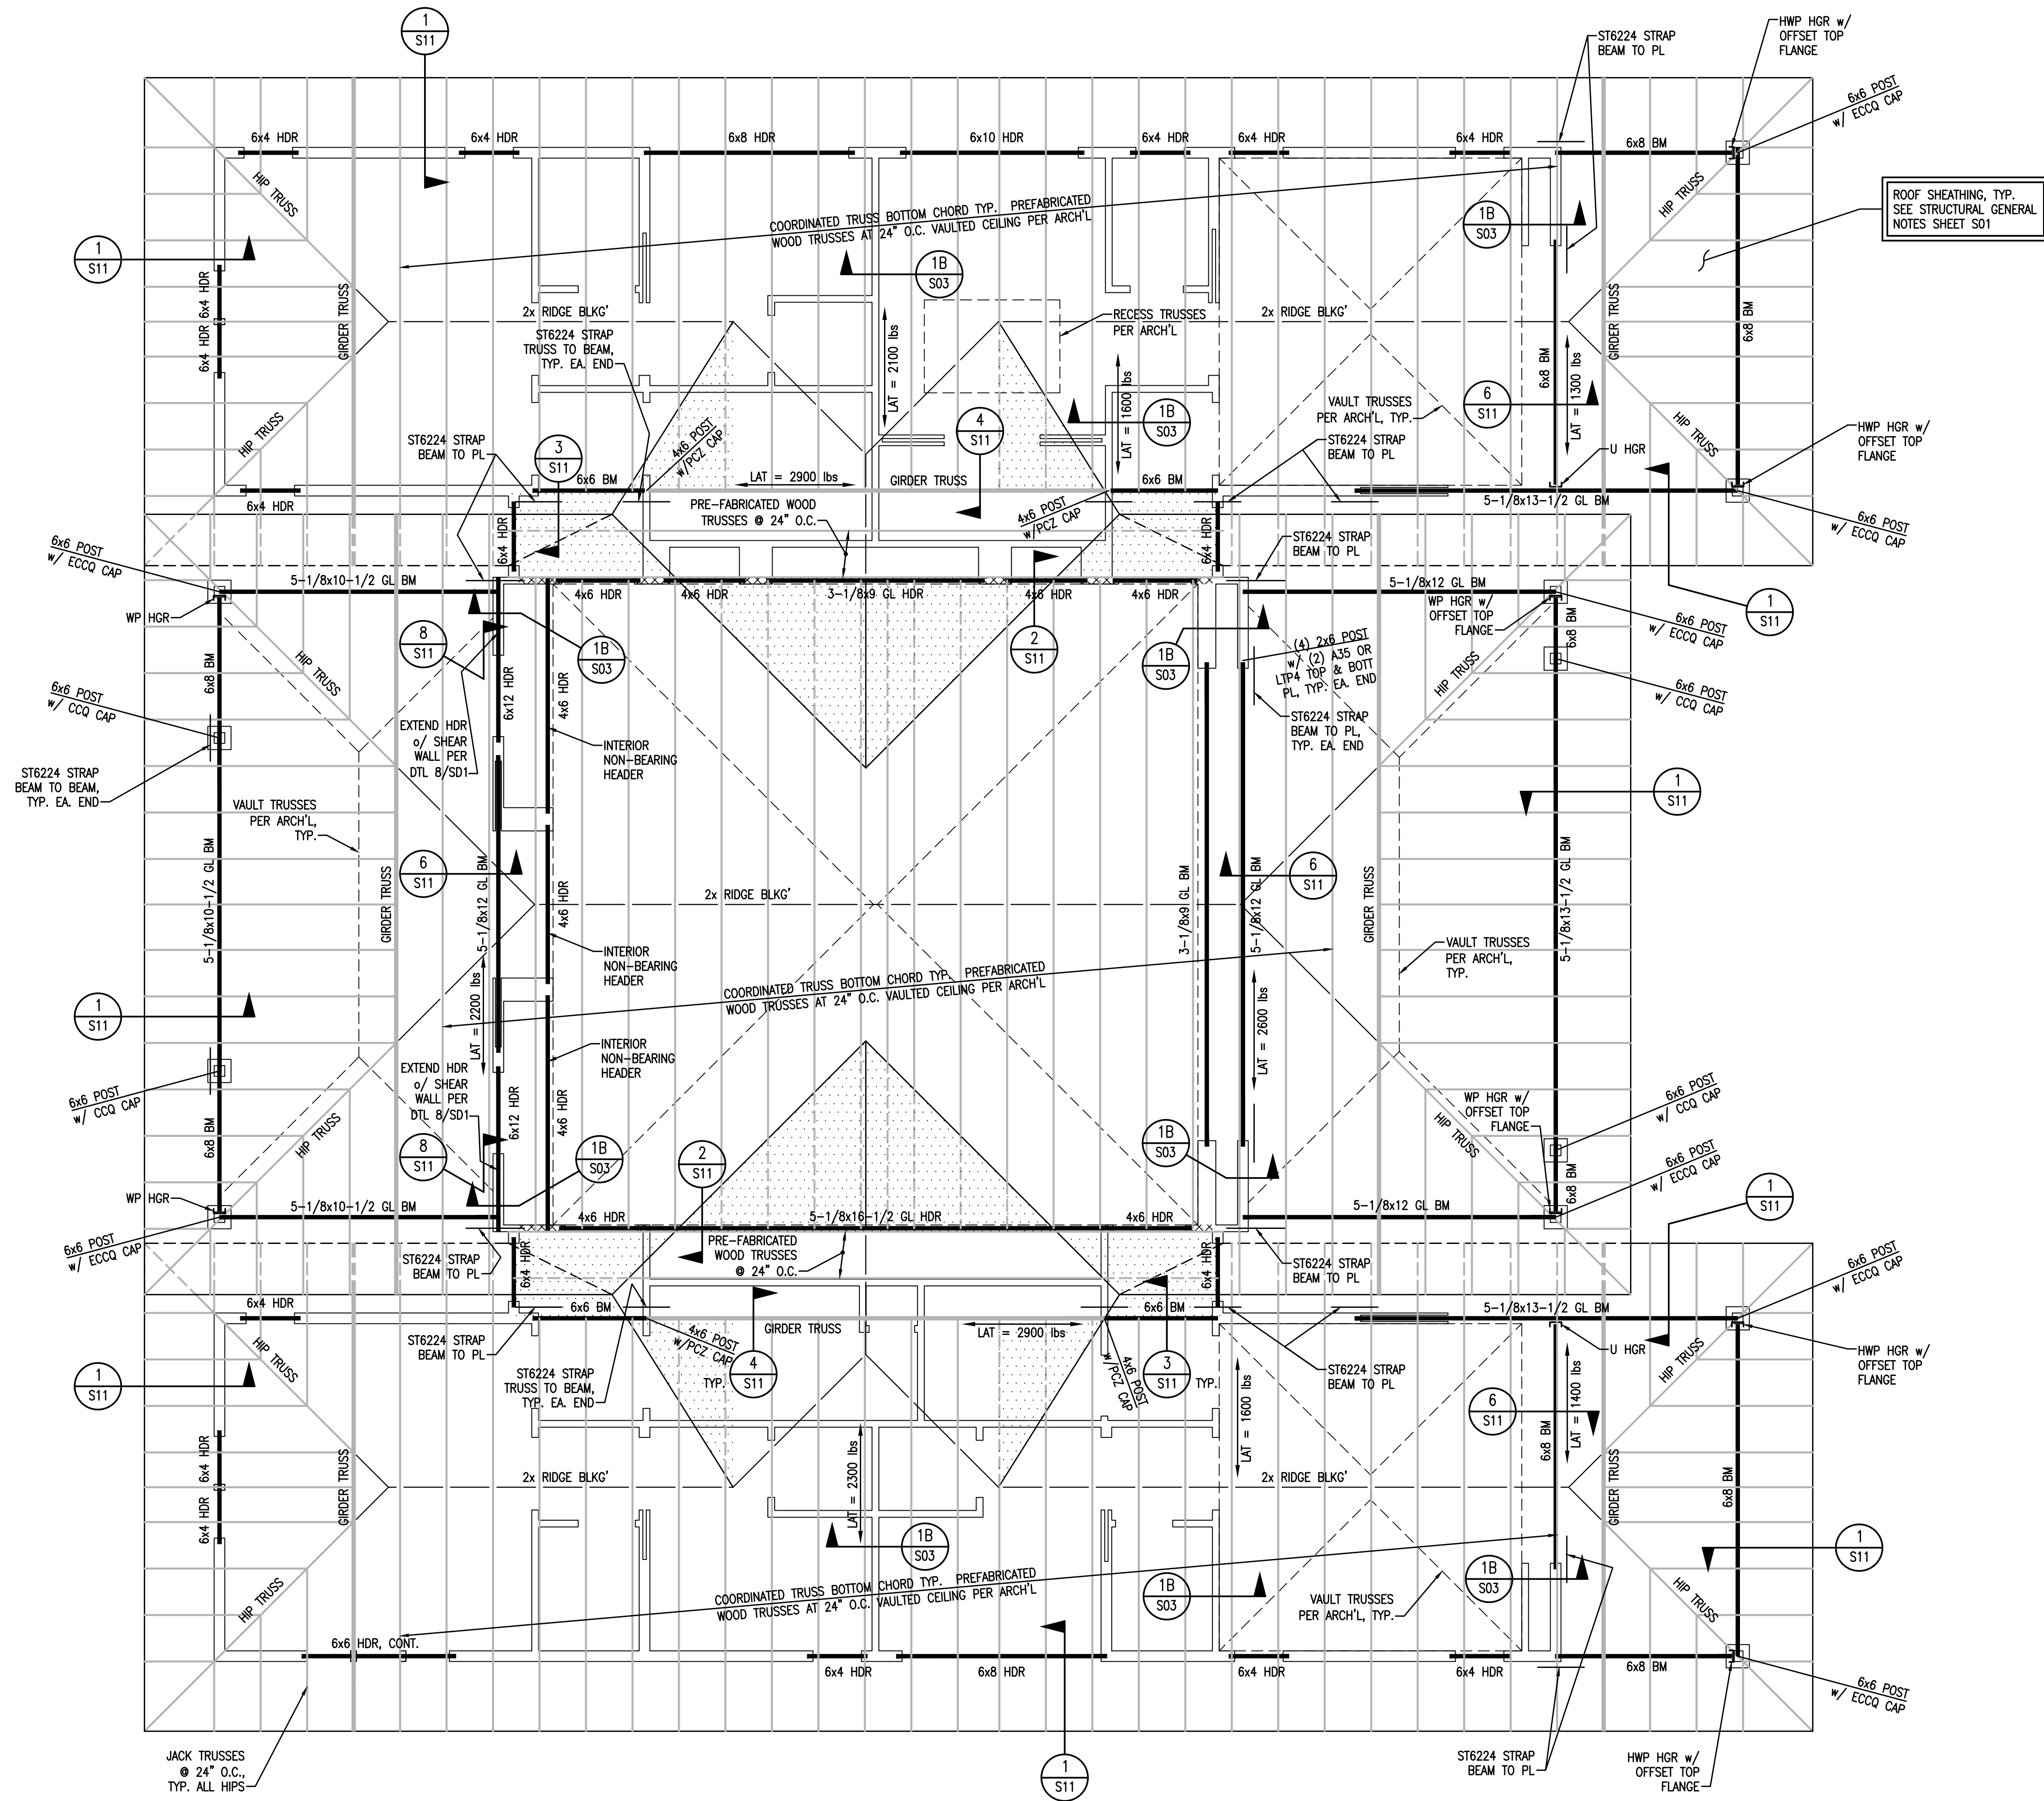

- FRAMING NOTES:
- ALL FRAMED WALLS TO BE 2x @ 16" O.C. (MAX) PER ARCHITECTURAL PLANS AND SHALL MEET REQUIREMENTS OF WALL TABLE ON SHEET S02.
  - FOR 2x4 FRAMED WALLS AT HEADERS (HDR):
    - PROVIDE (1) 2x4 TRIMMER & (1) 2x4 KING STUD AT OPENINGS < 6'-0" U.N.O.
    - PROVIDE (2) 2x4 TRIMMERS & (2) 2x4 KING STUDS AT OPENINGS ≥ 6'-0" & ≤ 10'-0" U.N.O.
    - PROVIDE (2) 2x4 TRIMMERS & (3) 2x4 KING STUDS AT OPENINGS ≥ 10'-0" & ≤ 18'-0" U.N.O. (1) KING STUD REQUIRED AT BAY WINDOW OPENINGS & AT GARAGE OPENINGS WHERE ADDITIONAL KING STUDS WOULD NOT FIT. NOTE: KINGSTUDS NOT REQUIRED AT BEAMS (BM)
  - FOR 2x6 FRAMED WALLS AT HEADERS (HDR):
    - PROVIDE (1) 2x6 TRIMMER & (1) 2x6 KING STUD AT OPENINGS < 8'-0" U.N.O.
    - PROVIDE (2) 2x6 TRIMMERS & (2) 2x6 KING STUDS AT OPENINGS ≥ 8'-0" & ≤ 12'-0" U.N.O.
    - PROVIDE (2) 2x6 TRIMMERS & (3) 2x6 KING STUDS AT OPENINGS ≥ 12'-0" & ≤ 20'-0" U.N.O. NOTE: KINGSTUDS NOT REQUIRED AT BEAMS (BM)
  - FOR 2x8 FRAMED WALLS AT HEADERS (HDR):
    - PROVIDE (1) 2x8 TRIMMER & (1) 2x8 KING STUD AT OPENINGS < 8'-0" U.N.O.
    - PROVIDE (2) 2x8 TRIMMERS & (2) 2x8 KING STUDS AT OPENINGS ≥ 8'-0" & ≤ 12'-0" U.N.O.
    - PROVIDE (2) 2x8 TRIMMERS & (3) 2x8 KING STUDS AT OPENINGS ≥ 12'-0" & ≤ 20'-0" U.N.O. NOTE: KINGSTUDS NOT REQUIRED AT BEAMS (BM)
  - FACE NAIL MULTIPLE 2x POSTS WITH 16d SINKERS @ 6" O.C.
  - SHADED AREAS ARE TYPICAL OVERFILL, STICK FRAMED PER DETAIL 6/S02 OR OVERBUILD TRUSSES PER TRUSS MANUFACTURER
  - INTERIOR BEARING WALLS
  - ALL GLULAM BEAMS TO HAVE STANDARD CAMBER (R = 2000') U.N.O.
  - PROVIDE (2) 2x POST, EACH END OF ALL BEAMS & GIRDER TRUSSES, U.N.O. PROVIDE CONTINUOUS LOAD PATH TO FOUNDATION WITH POSTS, CRIPPLES, AND SQUASH BLOCKS AS REQUIRED.
  - BEAM AND HEADER SIZES INDICATED ON THE PLANS ARE MINIMUM SIZES. LARGER SIZES MAY BE INSTALLED AT THE CONTRACTOR'S OPTION.
  - CONTINUOUS TOP PLATE MAY BE USED IN LIEU OF ST6224 STRAP FROM BEAM TO PLATE.



Copyright © 2021  
Vector Structural Engineering, LLC  
This drawing contains proprietary information  
belonging to Vector Structural Engineering, LLC,  
and may be neither wholly nor partially copied or  
reproduced without the prior written permission of  
Vector Structural Engineering, LLC.

MAIN HOUSE  
ROOF FRAMING PLAN

PROPRIETARY DO NOT DISTRIBUTE


For Review  
02/24/2025 10:13:22 AM

THIS WORK WAS PREPARED BY  
ME OR UNDER MY SUPERVISION.  
CONSTRUCTION OF THIS  
PROJECT WILL BE UNDER MY  
OBSERVATION WHEN REQUIRED  
BY H.A.R. 16-115-9  
EXPIRATION DATE OF LICENSE:  
04/30/2022

U3360-010-211

S05



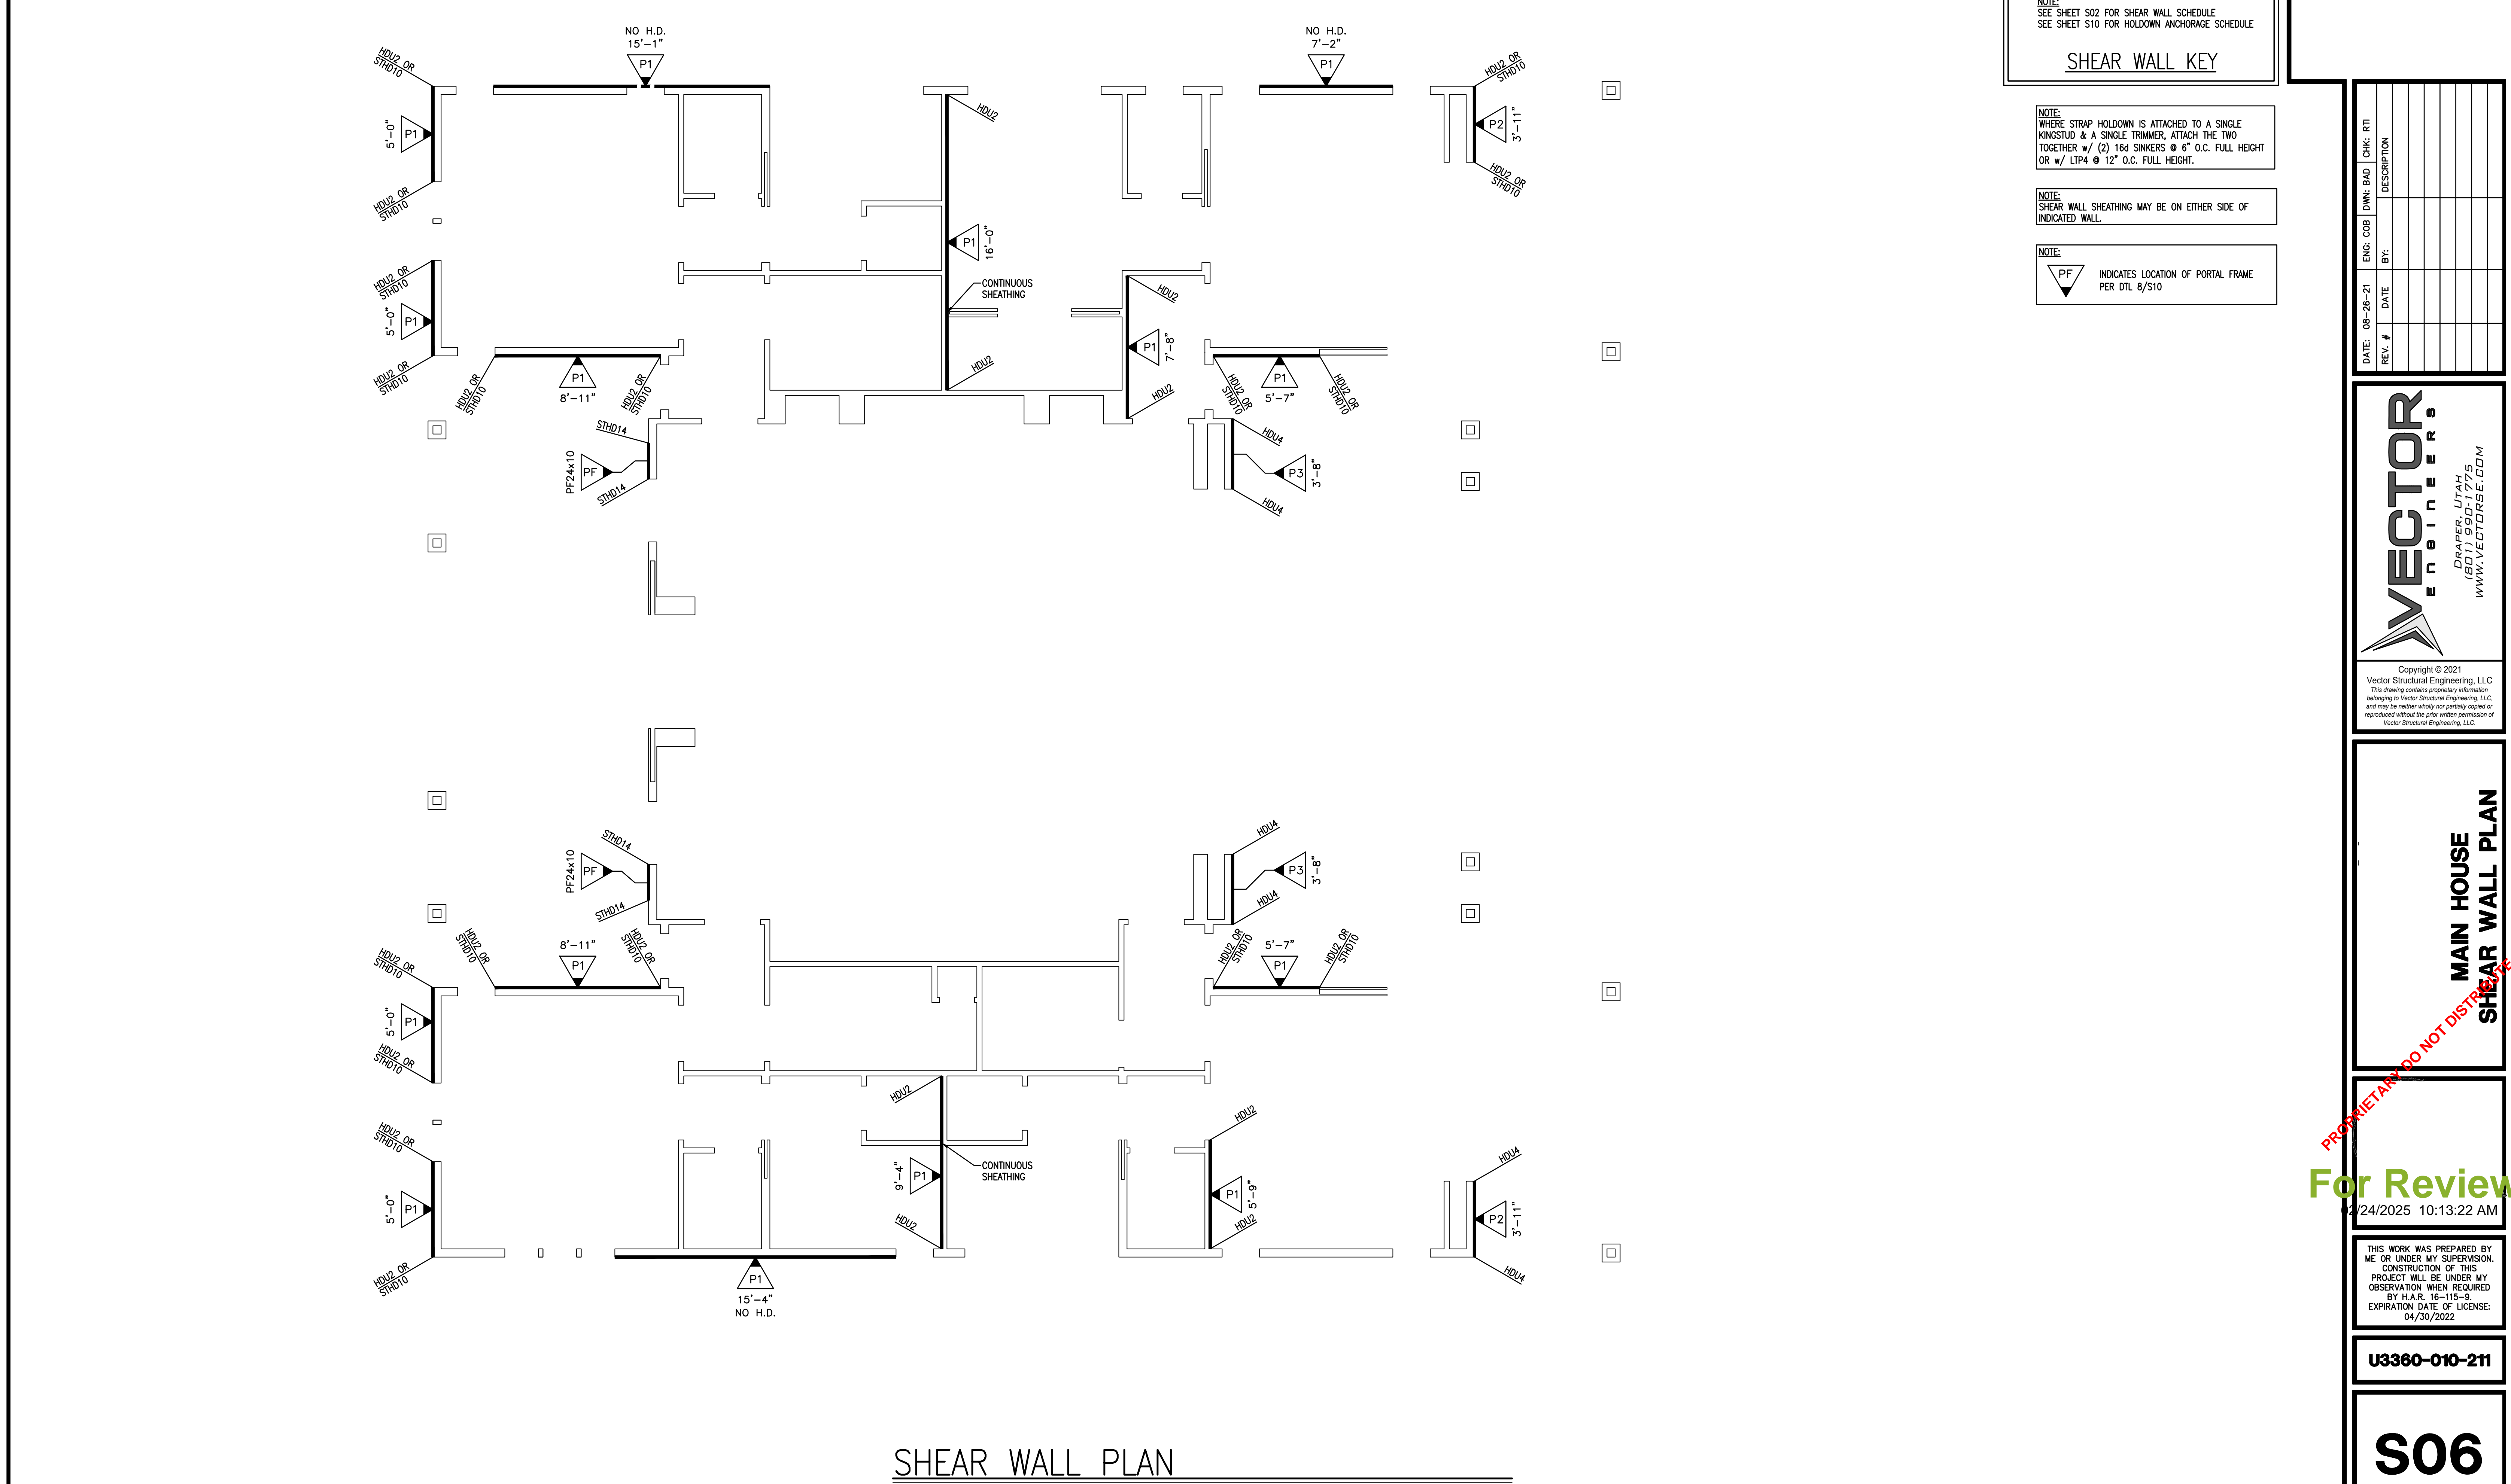

SHEAR WALL PLAN

DATE	REV. #	DATE	BY	ENG. COB	CHK. RTI	DESCRIPTION
08-26-21						

**VECTOR**  
ENGINEERS  
DRAPER, UTAH  
(801) 225-1111  
WWW.VECTORSE.COM

Copyright © 2021  
Vector Structural Engineering, LLC  
This drawing contains proprietary information  
belonging to Vector Structural Engineering, LLC,  
and may be neither wholly nor partially copied or  
reproduced without the prior written permission of  
Vector Structural Engineering, LLC.



MAIN HOUSE  
SHEAR WALL PLAN

02/24/2025 10:13:22 AM

THIS WORK WAS PREPARED BY  
ME OR UNDER MY SUPERVISION.  
CONSTRUCTION OF THIS  
PROJECT WILL BE UNDER MY  
OBSERVATION WHEN REQUIRED  
BY H.A.R. 16-115-9  
EXPIRATION DATE OF LICENSE:  
04/30/2022

U3360-010-211

S06

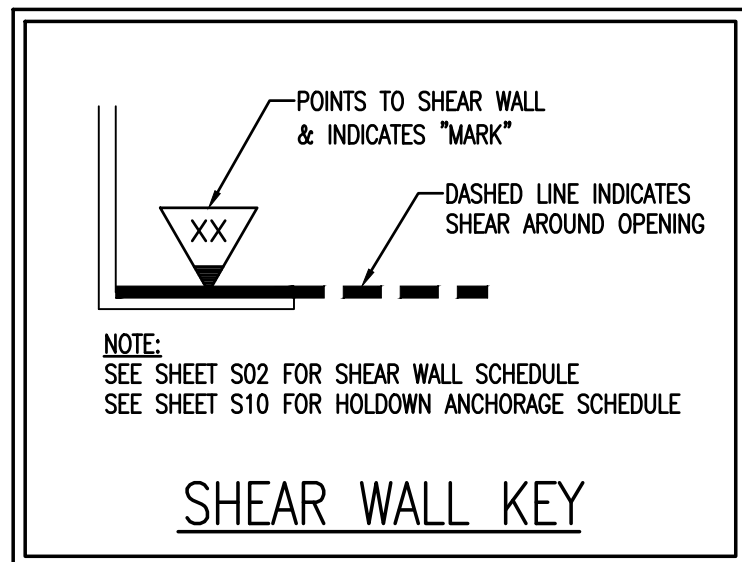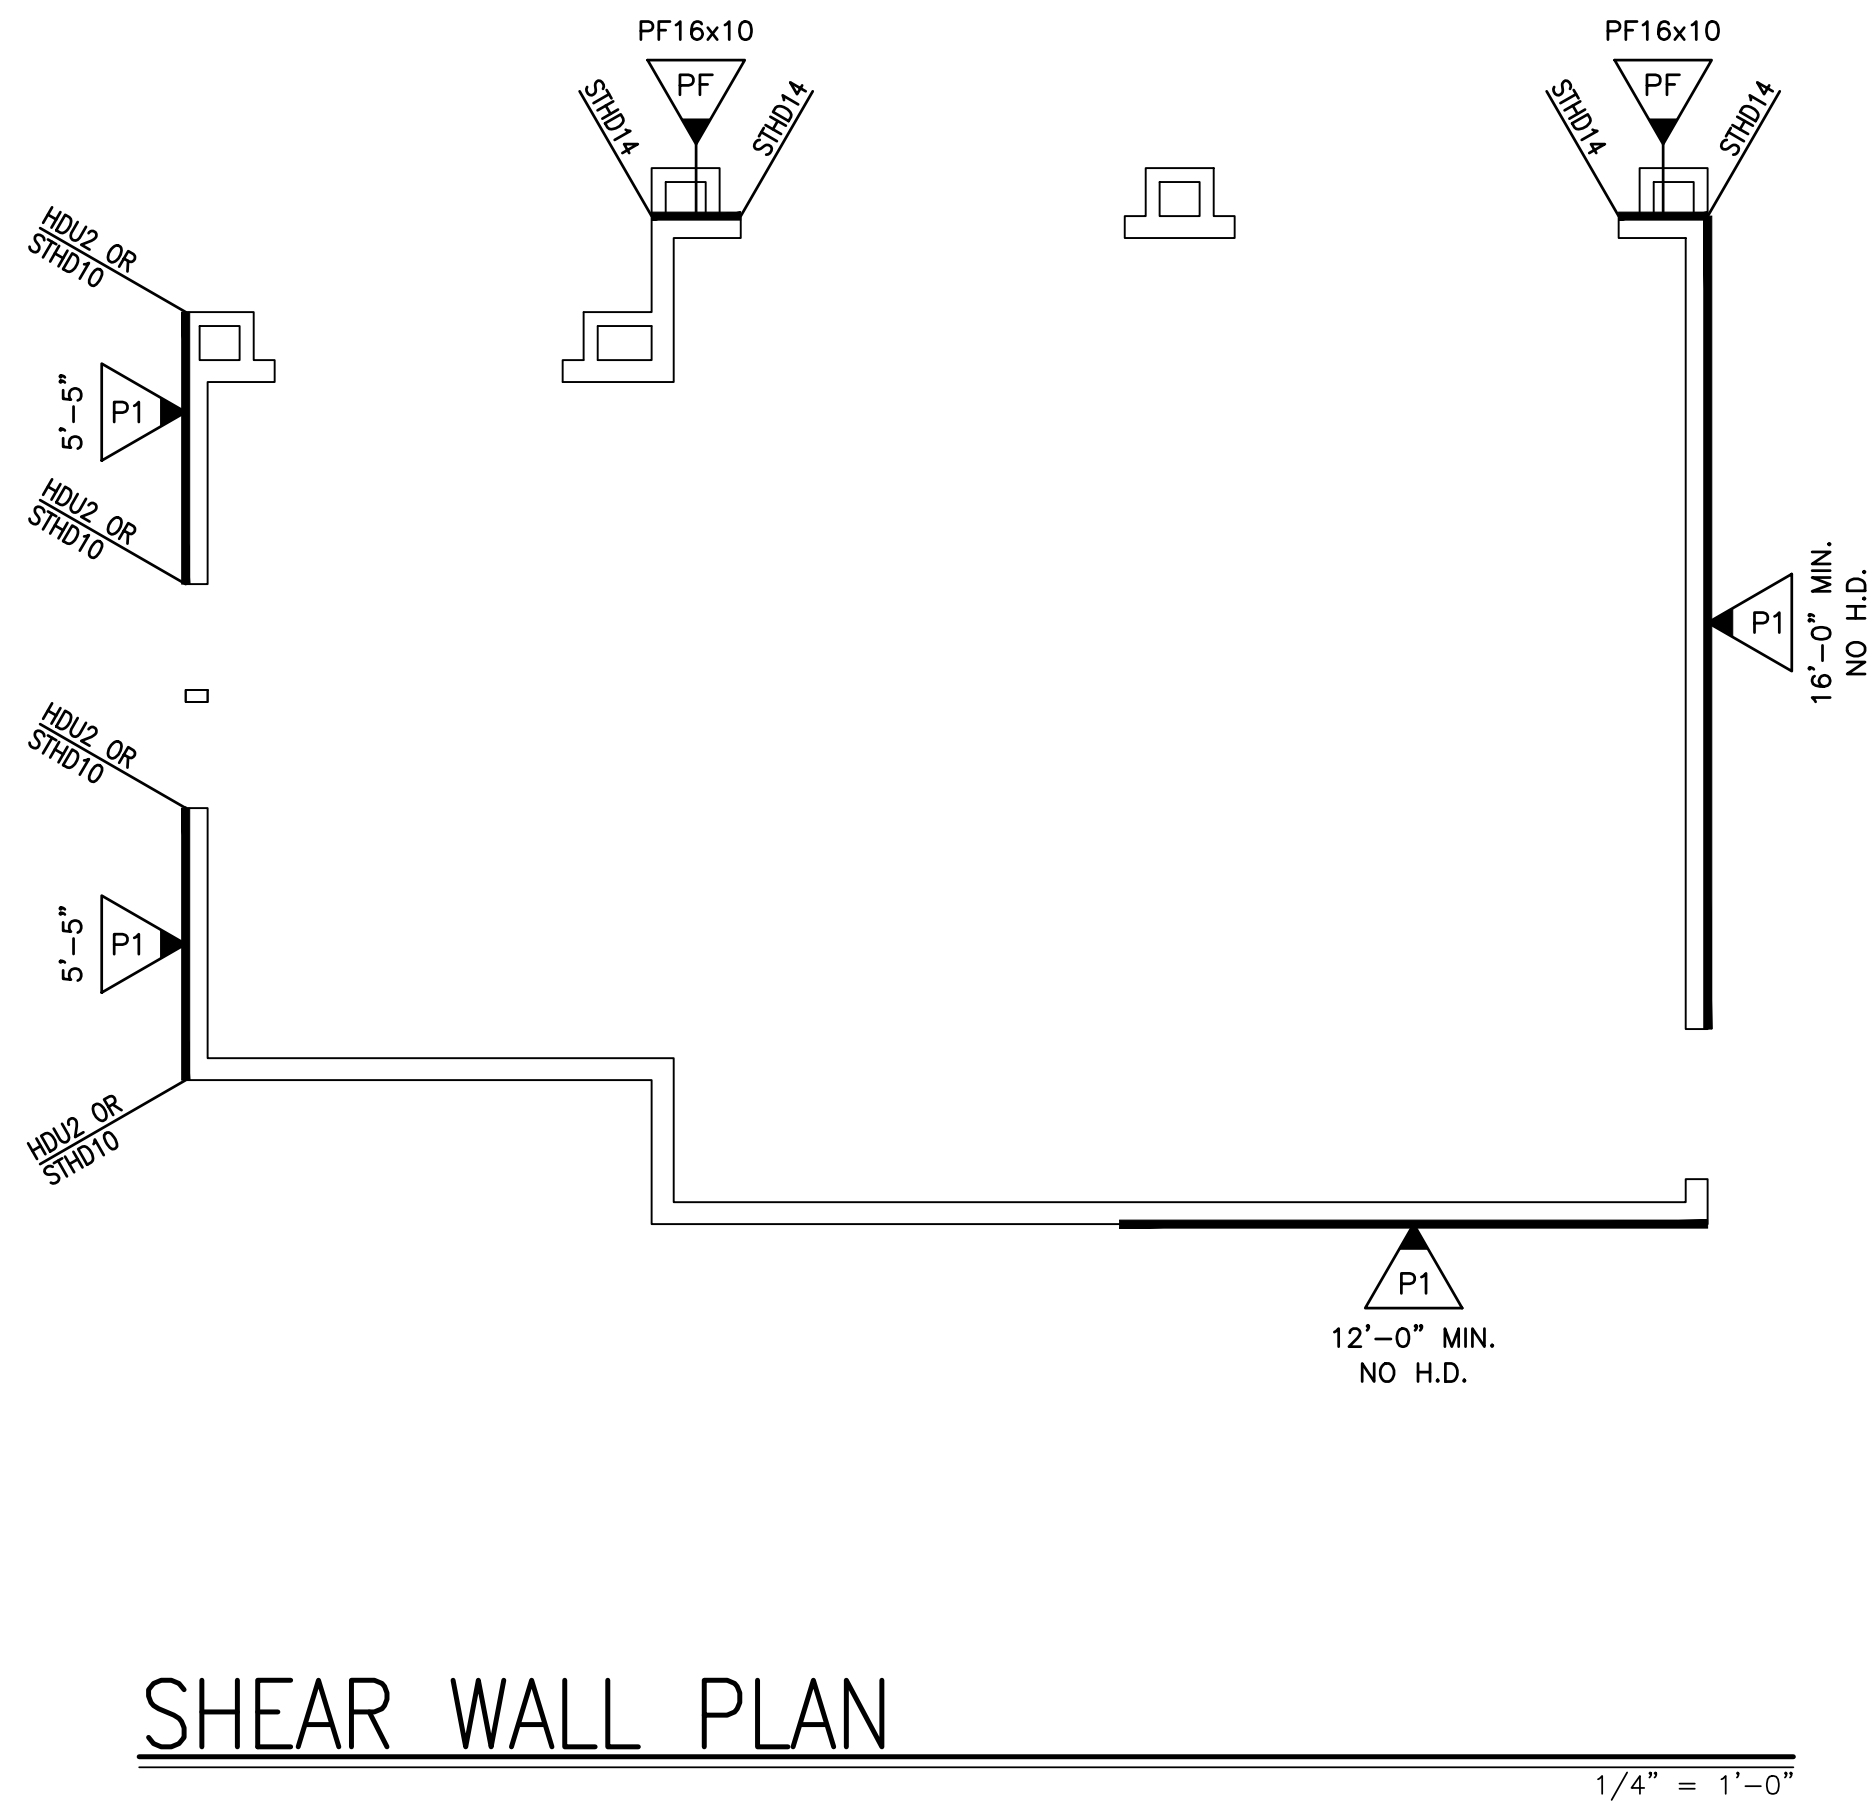




NOTE: WHERE STRAP HOLDOWN IS ATTACHED TO A SINGLE KINGSTUD & A SINGLE TRIMMER, ATTACH THE TWO TOGETHER w/ (2) 16d SINKERS @ 6" O.C. FULL HEIGHT OR w/ LTP4 @ 12" O.C. FULL HEIGHT.

NOTE: SHEAR WALL SHEATHING MAY BE ON EITHER SIDE OF INDICATED WALL.

NOTE: PF INDICATES LOCATION OF PORTAL FRAME PER DTL 8/S10

- FRAMING NOTES:**
- ALL FRAMED WALLS TO BE 2x @ 16" O.C. (MAX) PER ARCHITECTURAL PLANS AND SHALL MEET REQUIREMENTS OF WALL TABLE ON SHEET S02.
  - FOR 2x4 FRAMED WALLS AT HEADERS (HDR):
    - PROVIDE (1) 2x4 TRIMMER & (1) 2x4 KING STUD AT OPENINGS < 6'-0" U.N.O.
    - PROVIDE (2) 2x4 TRIMMERS & (2) 2x4 KING STUDS AT OPENINGS ≥ 6'-0" & ≤ 10'-0" U.N.O.
    - PROVIDE (2) 2x4 TRIMMERS & (3) 2x4 KING STUDS AT OPENINGS ≥ 10'-0" & ≤ 18'-0" U.N.O. (1) KING STUD REQUIRED AT BAY WINDOW OPENINGS & AT GARAGE OPENINGS WHERE ADDITIONAL KING STUDS WOULD NOT FIT. NOTE: KINGSTUDS NOT REQUIRED AT BEAMS (BM)
  - FOR 2x6 FRAMED WALLS AT HEADERS (HDR):
    - PROVIDE (1) 2x6 TRIMMER & (1) 2x6 KING STUD AT OPENINGS < 8'-0" U.N.O.
    - PROVIDE (2) 2x6 TRIMMERS & (2) 2x6 KING STUDS AT OPENINGS ≥ 8'-0" & ≤ 12'-0" U.N.O.
    - PROVIDE (2) 2x6 TRIMMERS & (3) 2x6 KING STUDS AT OPENINGS ≥ 12'-0" & ≤ 20'-0" U.N.O. NOTE: KINGSTUDS NOT REQUIRED AT BEAMS (BM)
  - FOR 2x8 FRAMED WALLS AT HEADERS (HDR):
    - PROVIDE (1) 2x8 TRIMMER & (1) 2x8 KING STUD AT OPENINGS < 8'-0" U.N.O.
    - PROVIDE (2) 2x8 TRIMMERS & (2) 2x8 KING STUDS AT OPENINGS ≥ 8'-0" & ≤ 12'-0" U.N.O.
    - PROVIDE (2) 2x8 TRIMMERS & (3) 2x8 KING STUDS AT OPENINGS ≥ 12'-0" & ≤ 20'-0" U.N.O. NOTE: KINGSTUDS NOT REQUIRED AT BEAMS (BM)
  - FACE NAIL MULTIPLE 2x POSTS WITH 16d SINKERS @ 6" O.C.
  - SHADED AREAS ARE TYPICAL OVERFILL, STICK FRAMED PER DETAIL 6/S02 OR OVERBUILD TRUSSES PER TRUSS
  - INTERIOR BEARING WALLS
  - ALL GLULAM BEAMS TO HAVE STANDARD CAMBER (R = 2000') U.N.O.
  - PROVIDE (2) 2x POST, EACH END OF ALL BEAMS & GIRDER TRUSSES, U.N.O. PROVIDE CONTINUOUS LOAD PATH TO FOUNDATION WITH POSTS, CRIPPLES, AND SQUASH BLOCKS AS REQUIRED.
  - BEAM AND HEADER SIZES INDICATED ON THE PLANS ARE MINIMUM SIZES. LARGER SIZES MAY BE INSTALLED AT THE CONTRACTOR'S OPTION.
  - CONTINUOUS TOP PLATE MAY BE USED IN LIEU OF ST6224 STRAP FROM BEAM TO PLATE.

- FOUNDATION NOTES:**
- ALL DIMENSIONS ARE PER ARCHITECTURAL DRAWINGS.
  - ALL EXTERIOR WALLS, INTERIOR BEARING WALLS & SHEAR WALLS TO BE ATTACHED TO THE FOUNDATION w/ #1/2" x 10" LONG ANCHOR BOLTS (7" EMBED.) AT 48" O.C. U.N.O. SEE THIS PLAN & SHEAR WALL SCHEDULE FOR ANCHOR BOLT REQUIREMENTS AT SHEAR WALLS. ANCHOR BOLTS AT SHEAR WALLS TO HAVE WASHERS PER SHEAR WALL SCHEDULE (S02). ALL OTHER ANCHOR BOLTS TO HAVE WASHERS PER NOTE "E" IN GENERAL NOTES (S01).
  - ALL HOLDOWNS SHALL BE INSTALLED AS SHOWN ON DETAIL 7/S10.
  - ISOLATED FOOTINGS & INTERIOR STRIP FOOTINGS TO BE CENTERED BELOW POSTS & BEARING/SHEAR WALLS, RESPECTIVELY.
  - SEE SHEET S02 FOR FOOTING SCHEDULE.
  - MSA MUDSILL ANCHORS MAY BE USED IN PLACE OF ANCHOR BOLTS, INSTALLED AT THE SAME SPACING INDICATED FOR ANCHOR BOLTS, INCLUDING REDUCED SPACING AT SHEAR WALLS.
  - STRIP & REMOVE EXISTING VEGETATION, REMOVE UNCONTROLLED FILL, OVEREXCAVATE AND REPLACE w/ PROPERLY COMPACTED FILL AS REQUIRED PER GEOTECHNICAL REPORT.
  - PF - INDICATES LOCATION OF PORTAL FRAME PER SHEAR WALL PLAN
  - FOR SITE RETAINING CMU WALLS, SEE DTL 1/S12

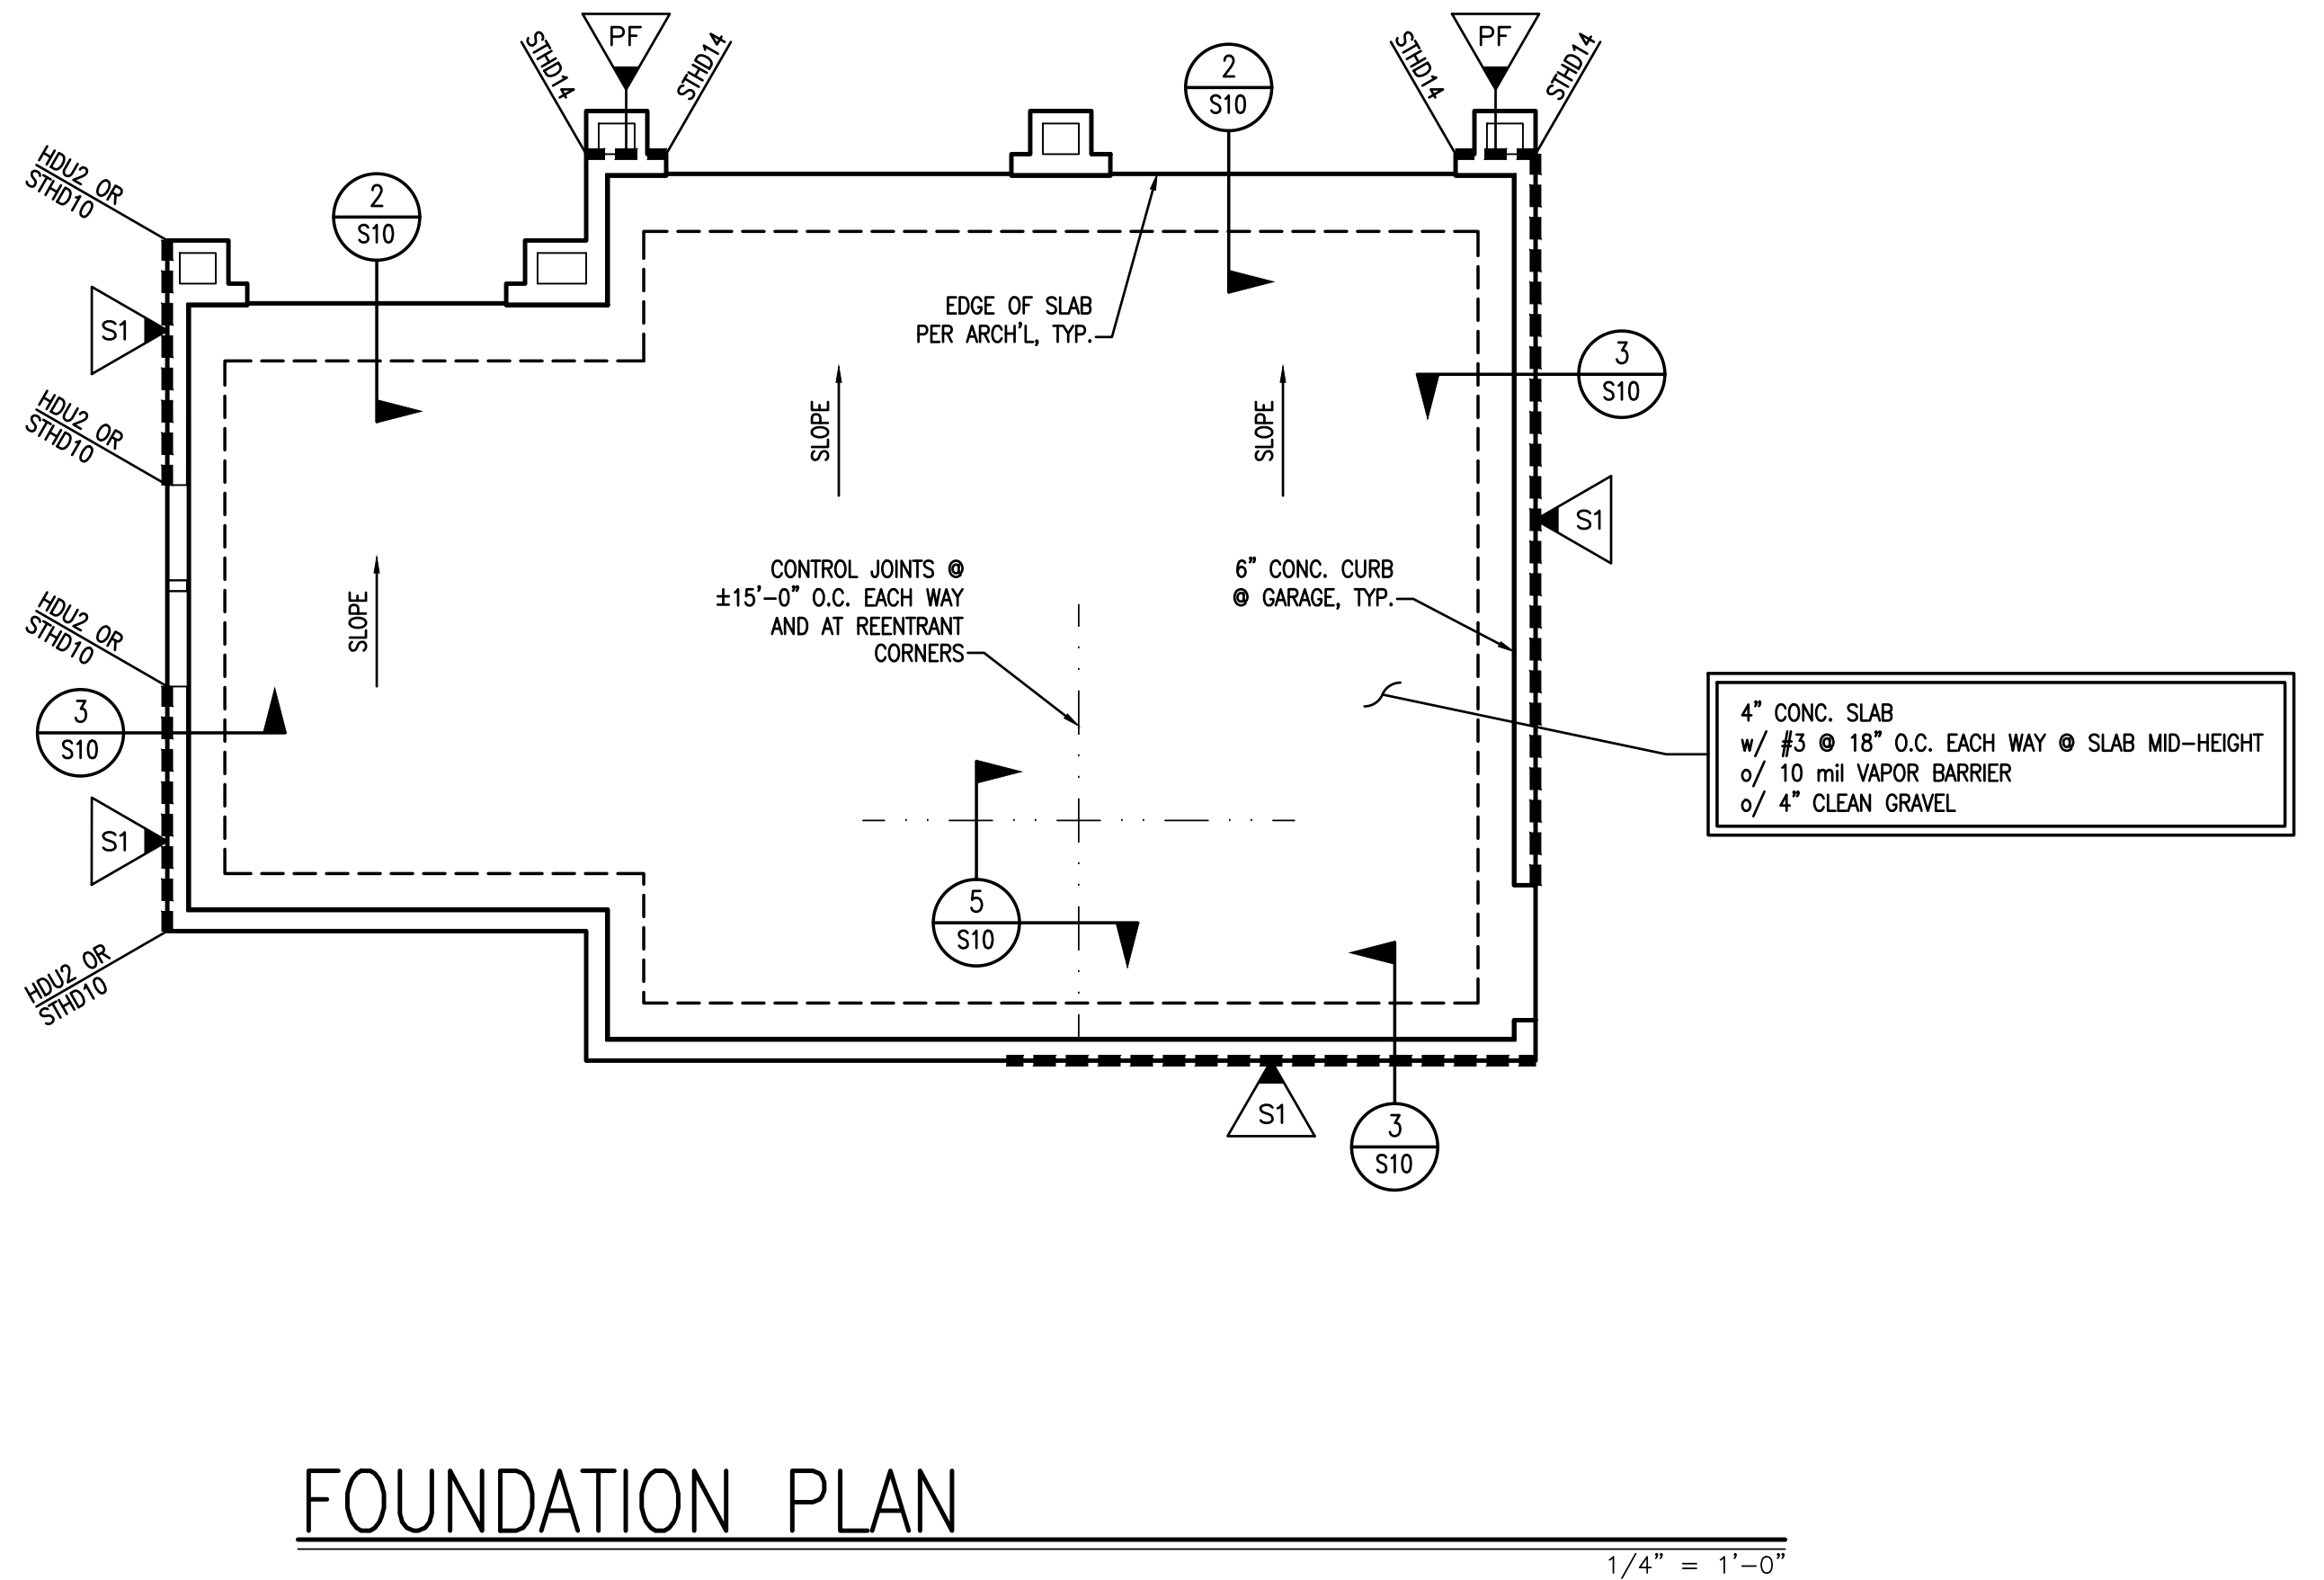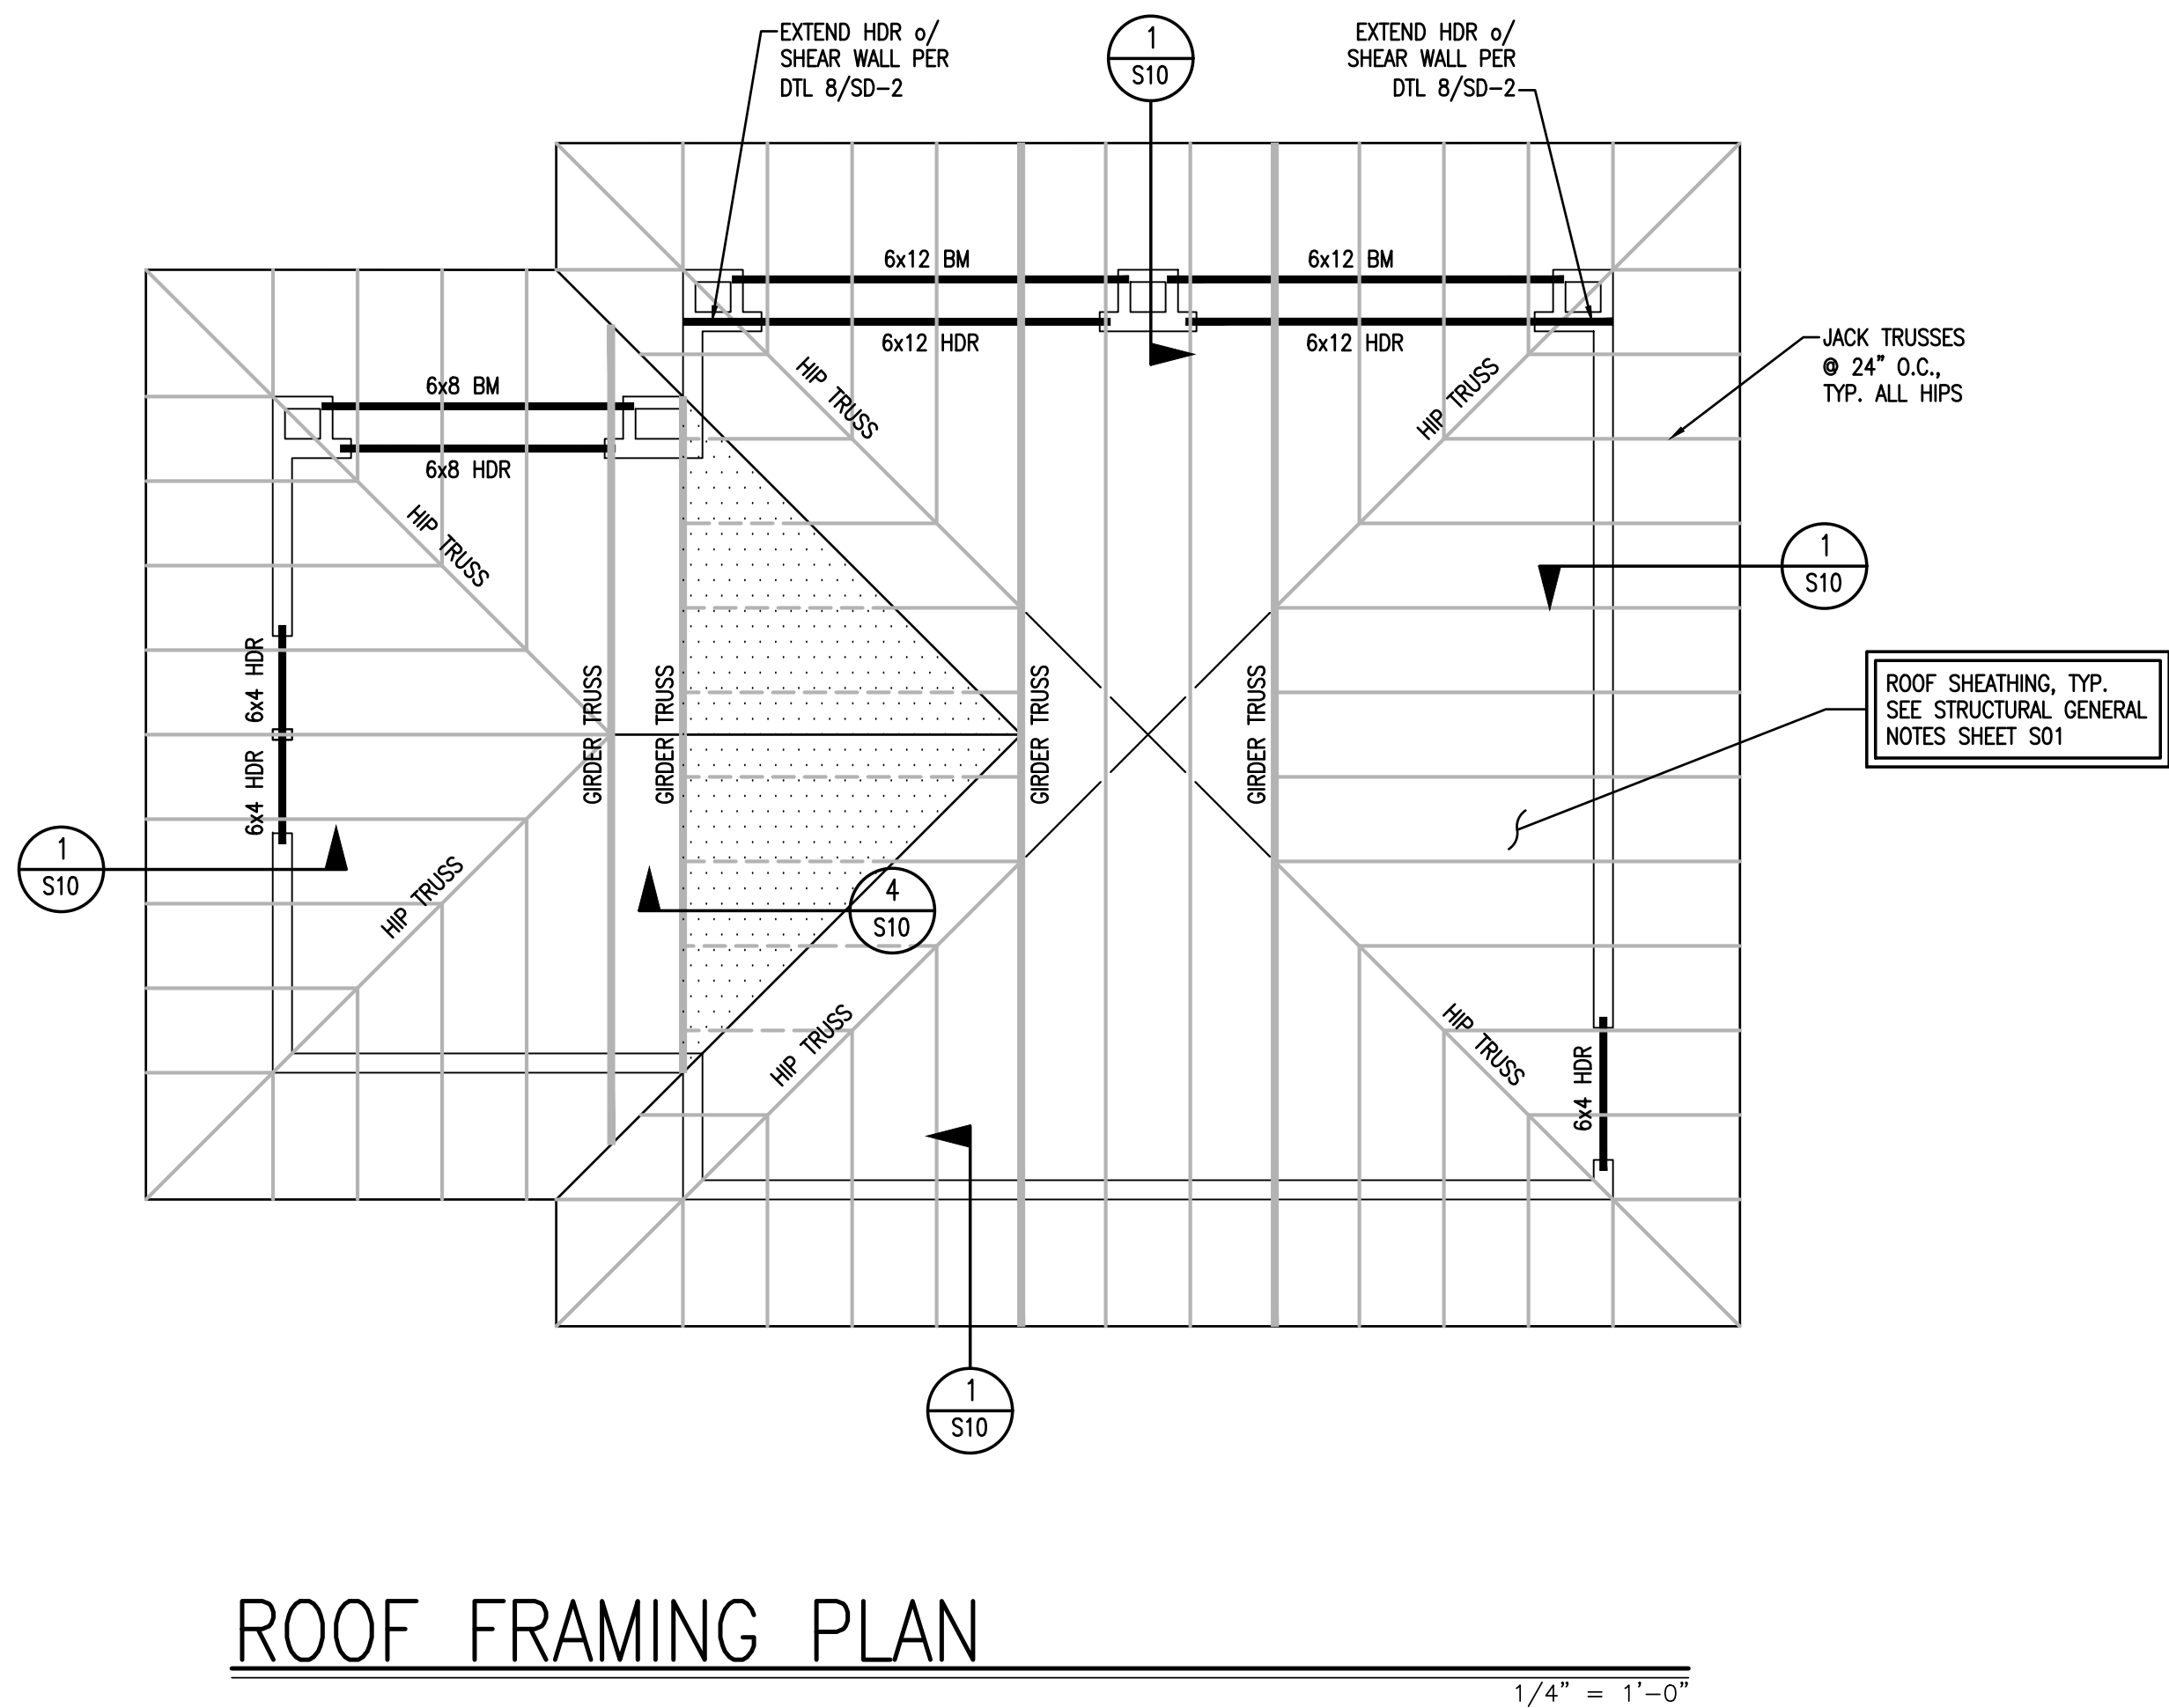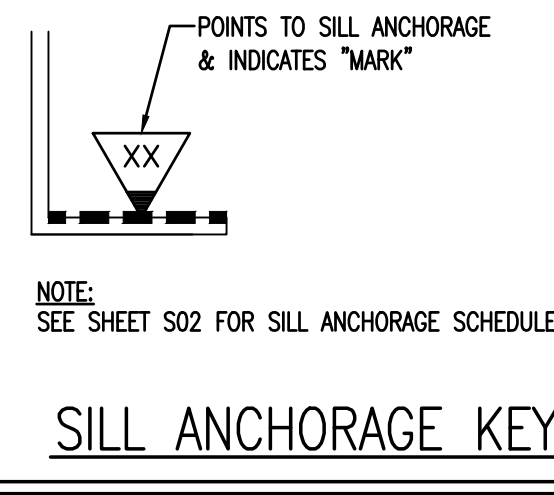

DATE	REV	BY	CHK	DESCRIPTION
08-26-21				

**VECTOR ENGINEERS**  
DRAPER, UTAH  
(801) 222-1000  
WWW.VECTORSE.COM

Copyright © 2021  
Vector Structural Engineering, LLC  
This drawing contains proprietary information belonging to Vector Structural Engineering, LLC, and may be neither wholly nor partially copied or reproduced without the prior written permission of Vector Structural Engineering, LLC.

**GARAGE STRUCTURAL PLANS**

**PROPRIETARY DO NOT DISTURB**


For Review  
12/24/2025 10:13:22 AM

THIS WORK WAS PREPARED BY ME OR UNDER MY SUPERVISION. CONSTRUCTION OF THIS PROJECT WILL BE UNDER MY OBSERVATION WHEN REQUIRED BY H.A.R. 16-115-9. EXPIRATION DATE OF LICENSE: 04/30/2022

**U3360-010-211**


**S07**



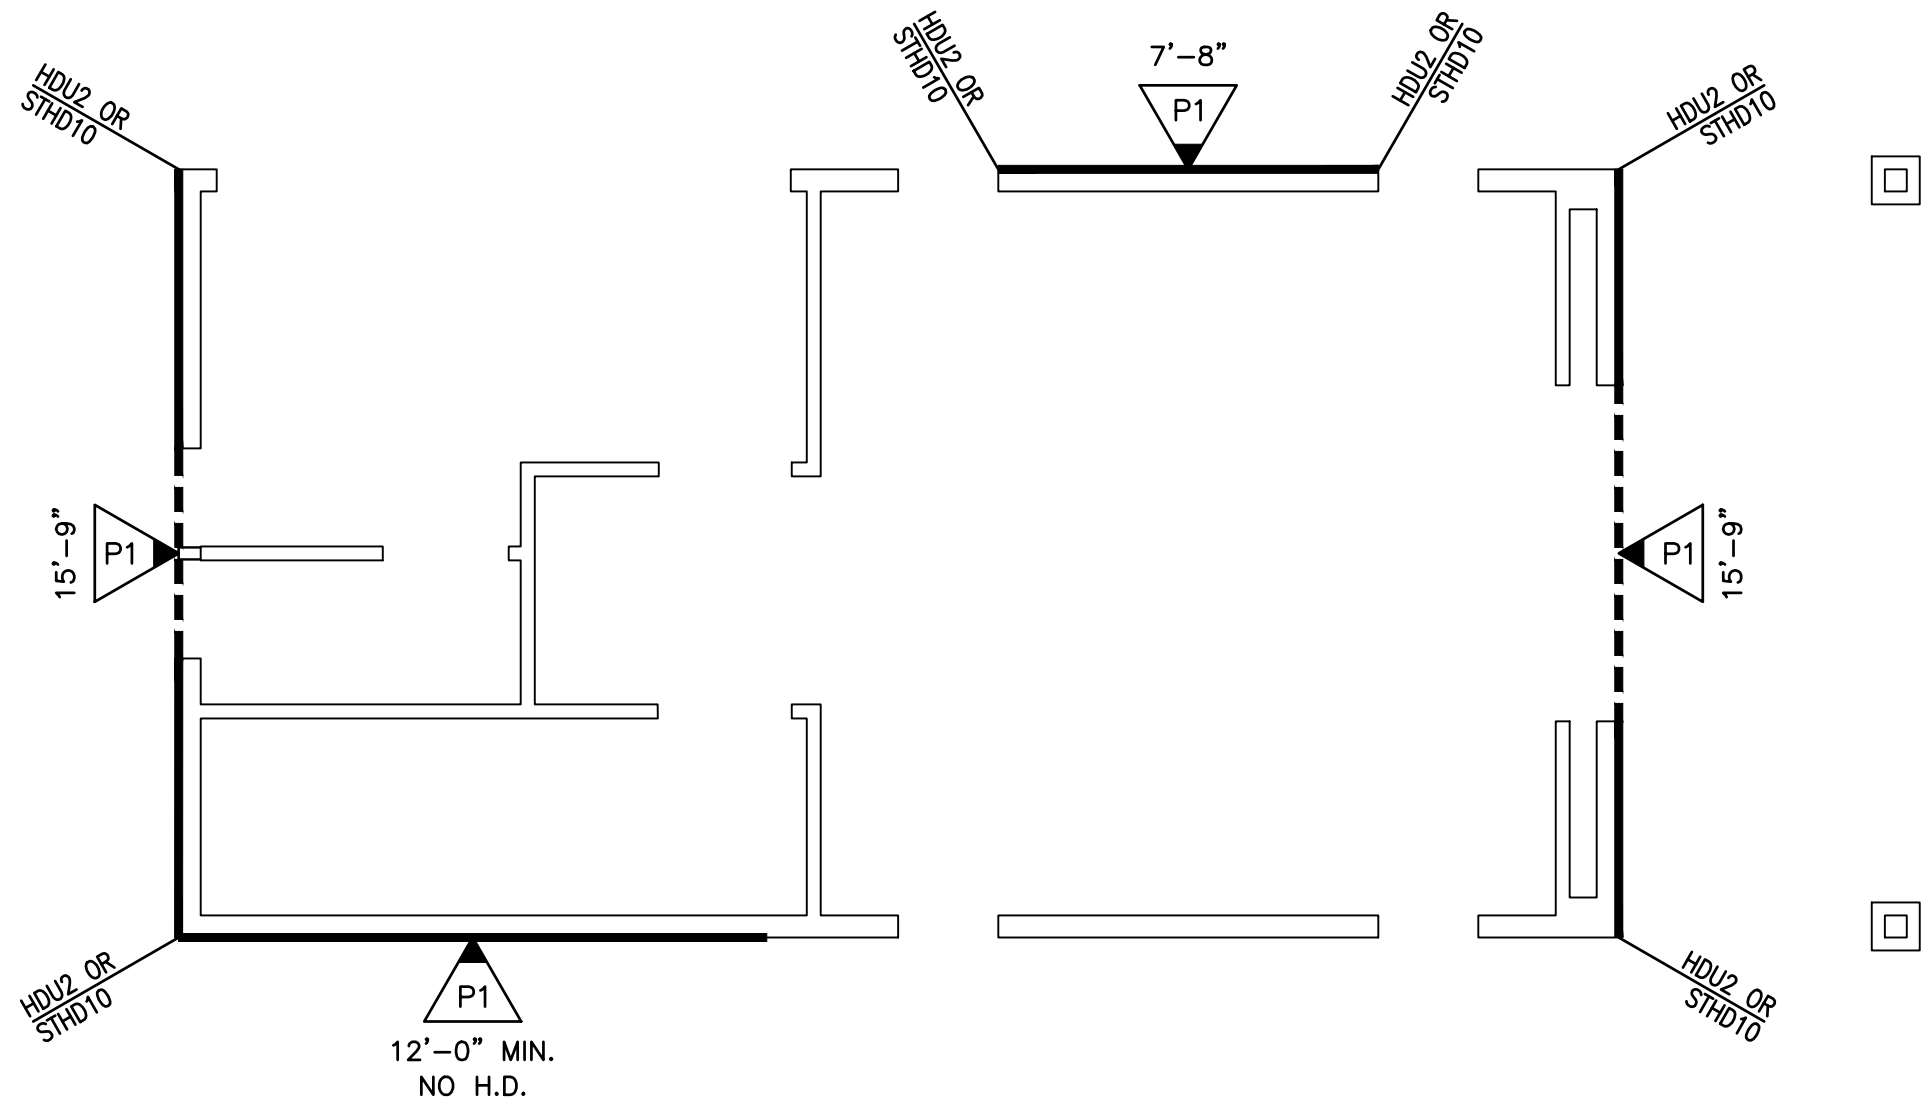

SHEAR WALL PLAN

1/4" = 1'-0"

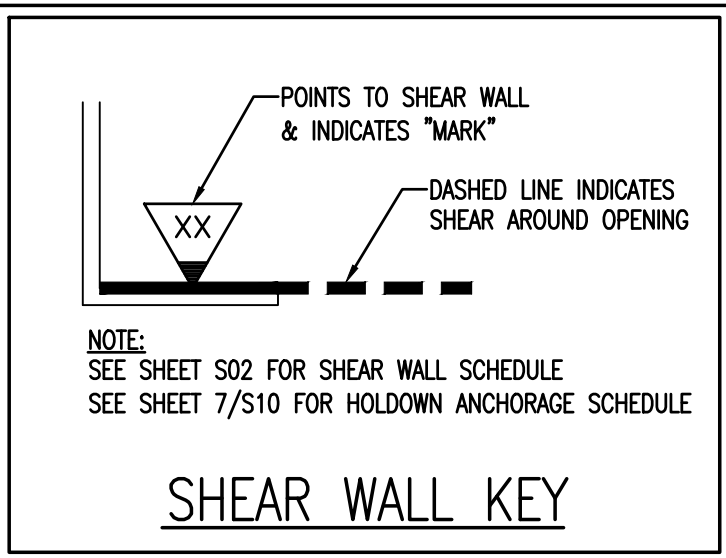


NOTE:  
WHERE STRAP HOLDOWN IS ATTACHED TO A SINGLE KINGSTUD & A SINGLE TRIMMER, ATTACH THE TWO TOGETHER w/ (2) 16d SINKERS @ 6" O.C. FULL HEIGHT OR w/ LTP4 @ 12" O.C. FULL HEIGHT.

NOTE:  
SHEAR WALL SHEATHING MAY BE ON EITHER SIDE OF INDICATED WALL.


- FRAMING NOTES:
- ALL FRAMED WALLS TO BE 2x @ 16" O.C. (MAX) PER ARCHITECTURAL PLANS AND SHALL MEET REQUIREMENTS OF WALL TABLE ON SHEET S02.
  - FOR 2x4 FRAMED WALLS AT HEADERS (HDR):
    - PROVIDE (1) 2x4 TRIMMER & (1) 2x4 KING STUD AT OPENINGS < 6'-0" U.N.O.
    - PROVIDE (2) 2x4 TRIMMERS & (2) 2x4 KING STUDS AT OPENINGS ≥ 6'-0" & ≤ 10'-0" U.N.O.
    - PROVIDE (2) 2x4 TRIMMERS & (3) 2x4 KING STUDS AT OPENINGS ≥ 10'-0" & ≤ 18'-0" U.N.O. (1) KING STUD REQUIRED AT BAY WINDOW OPENINGS & AT GARAGE OPENINGS WHERE ADDITIONAL KING STUDS WOULD NOT FIT. NOTE: KINGSTUDS NOT REQUIRED AT BEAMS (BM)
  - FOR 2x6 FRAMED WALLS AT HEADERS (HDR):
    - PROVIDE (1) 2x6 TRIMMER & (1) 2x6 KING STUD AT OPENINGS < 8'-0" U.N.O.
    - PROVIDE (2) 2x6 TRIMMERS & (2) 2x6 KING STUDS AT OPENINGS ≥ 8'-0" & ≤ 12'-0" U.N.O.
    - PROVIDE (2) 2x6 TRIMMERS & (3) 2x6 KING STUDS AT OPENINGS ≥ 12'-0" & ≤ 20'-0" U.N.O. NOTE: KINGSTUDS NOT REQUIRED AT BEAMS (BM)
  - FOR 2x8 FRAMED WALLS AT HEADERS (HDR):
    - PROVIDE (1) 2x8 TRIMMER & (1) 2x8 KING STUD AT OPENINGS < 8'-0" U.N.O.
    - PROVIDE (2) 2x8 TRIMMERS & (2) 2x8 KING STUDS AT OPENINGS ≥ 8'-0" & ≤ 12'-0" U.N.O.
    - PROVIDE (2) 2x8 TRIMMERS & (3) 2x8 KING STUDS AT OPENINGS ≥ 12'-0" & ≤ 20'-0" U.N.O. NOTE: KINGSTUDS NOT REQUIRED AT BEAMS (BM)
  - FACE NAIL MULTIPLE 2x POSTS WITH 16d SINKERS @ 6" O.C.
  - SHADED AREAS ARE TYPICAL OVERFILL, STICK FRAMED PER DETAIL 6/S02 OR OVERBUILD TRUSSES PER TRUSS MANUFACTURER
  - INTERIOR BEARING WALLS
  - ALL GLULAM BEAMS TO HAVE STANDARD CAMBER (R = 2000') U.N.O.
  - PROVIDE (2) 2x POST, EACH END OF ALL BEAMS & GIRDER TRUSSES, U.N.O. PROVIDE CONTINUOUS LOAD PATH TO FOUNDATION WITH POSTS, CRIPPLES, AND SQUASH BLOCKS AS REQUIRED.
  - BEAM AND HEADER SIZES INDICATED ON THE PLANS ARE MINIMUM SIZES. LARGER SIZES MAY BE INSTALLED AT THE CONTRACTOR'S OPTION.
  - CONTINUOUS TOP PLATE MAY BE USED IN LIEU OF ST6224 STRAP FROM BEAM TO PLATE.

- FOUNDATION NOTES:
- ALL DIMENSIONS ARE PER ARCHITECTURAL DRAWINGS.
  - ALL EXTERIOR WALLS, INTERIOR BEARING WALLS & SHEAR WALLS TO BE ATTACHED TO THE FOUNDATION w/ #1/2" x 10" LONG ANCHOR BOLTS (7" EMBED.) AT 48" O.C., U.N.O. SEE THIS PLAN & SHEAR WALL SCHEDULE FOR ANCHOR BOLT REQUIREMENTS AT SHEAR WALLS. ANCHOR BOLTS AT SHEAR WALLS TO HAVE WASHERS PER SHEAR WALL SCHEDULE (S02). ALL OTHER ANCHOR BOLTS TO HAVE WASHERS PER NOTE "E" IN GENERAL NOTES S01.
  - ALL HOLDOWNS SHALL BE INSTALLED AS SHOWN ON DETAIL 7/S10.
  - ISOLATED FOOTINGS & INTERIOR STRIP FOOTINGS TO BE CENTERED BELOW POSTS & BEARING/SHEAR WALLS, RESPECTIVELY.
  - SEE SHEET S02 FOR FOOTING SCHEDULE.
  - MSA MUJSILL ANCHORS MAY BE USED IN PLACE OF ANCHOR BOLTS, INSTALLED AT THE SAME SPACING INDICATED FOR ANCHOR BOLTS, INCLUDING REDUCED SPACING AT SHEAR WALLS.
  - STRIP & REMOVE EXISTING VEGETATION, REMOVE UNCONTROLLED FILL, OVEREXCAVATE AND REPLACE w/ PROPERLY COMPACTED FILL AS REQUIRED.
  - FOR SITE RETAINING CMU WALLS, SEE DTL 1/S12

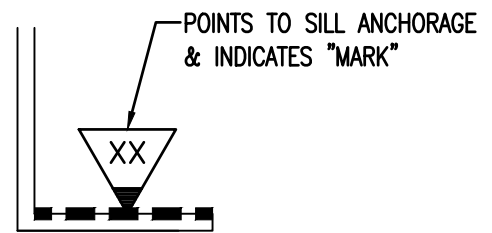


NOTE:  
SEE SHEET S02 FOR SILL ANCHORAGE SCHEDULE

SILL ANCHORAGE KEY

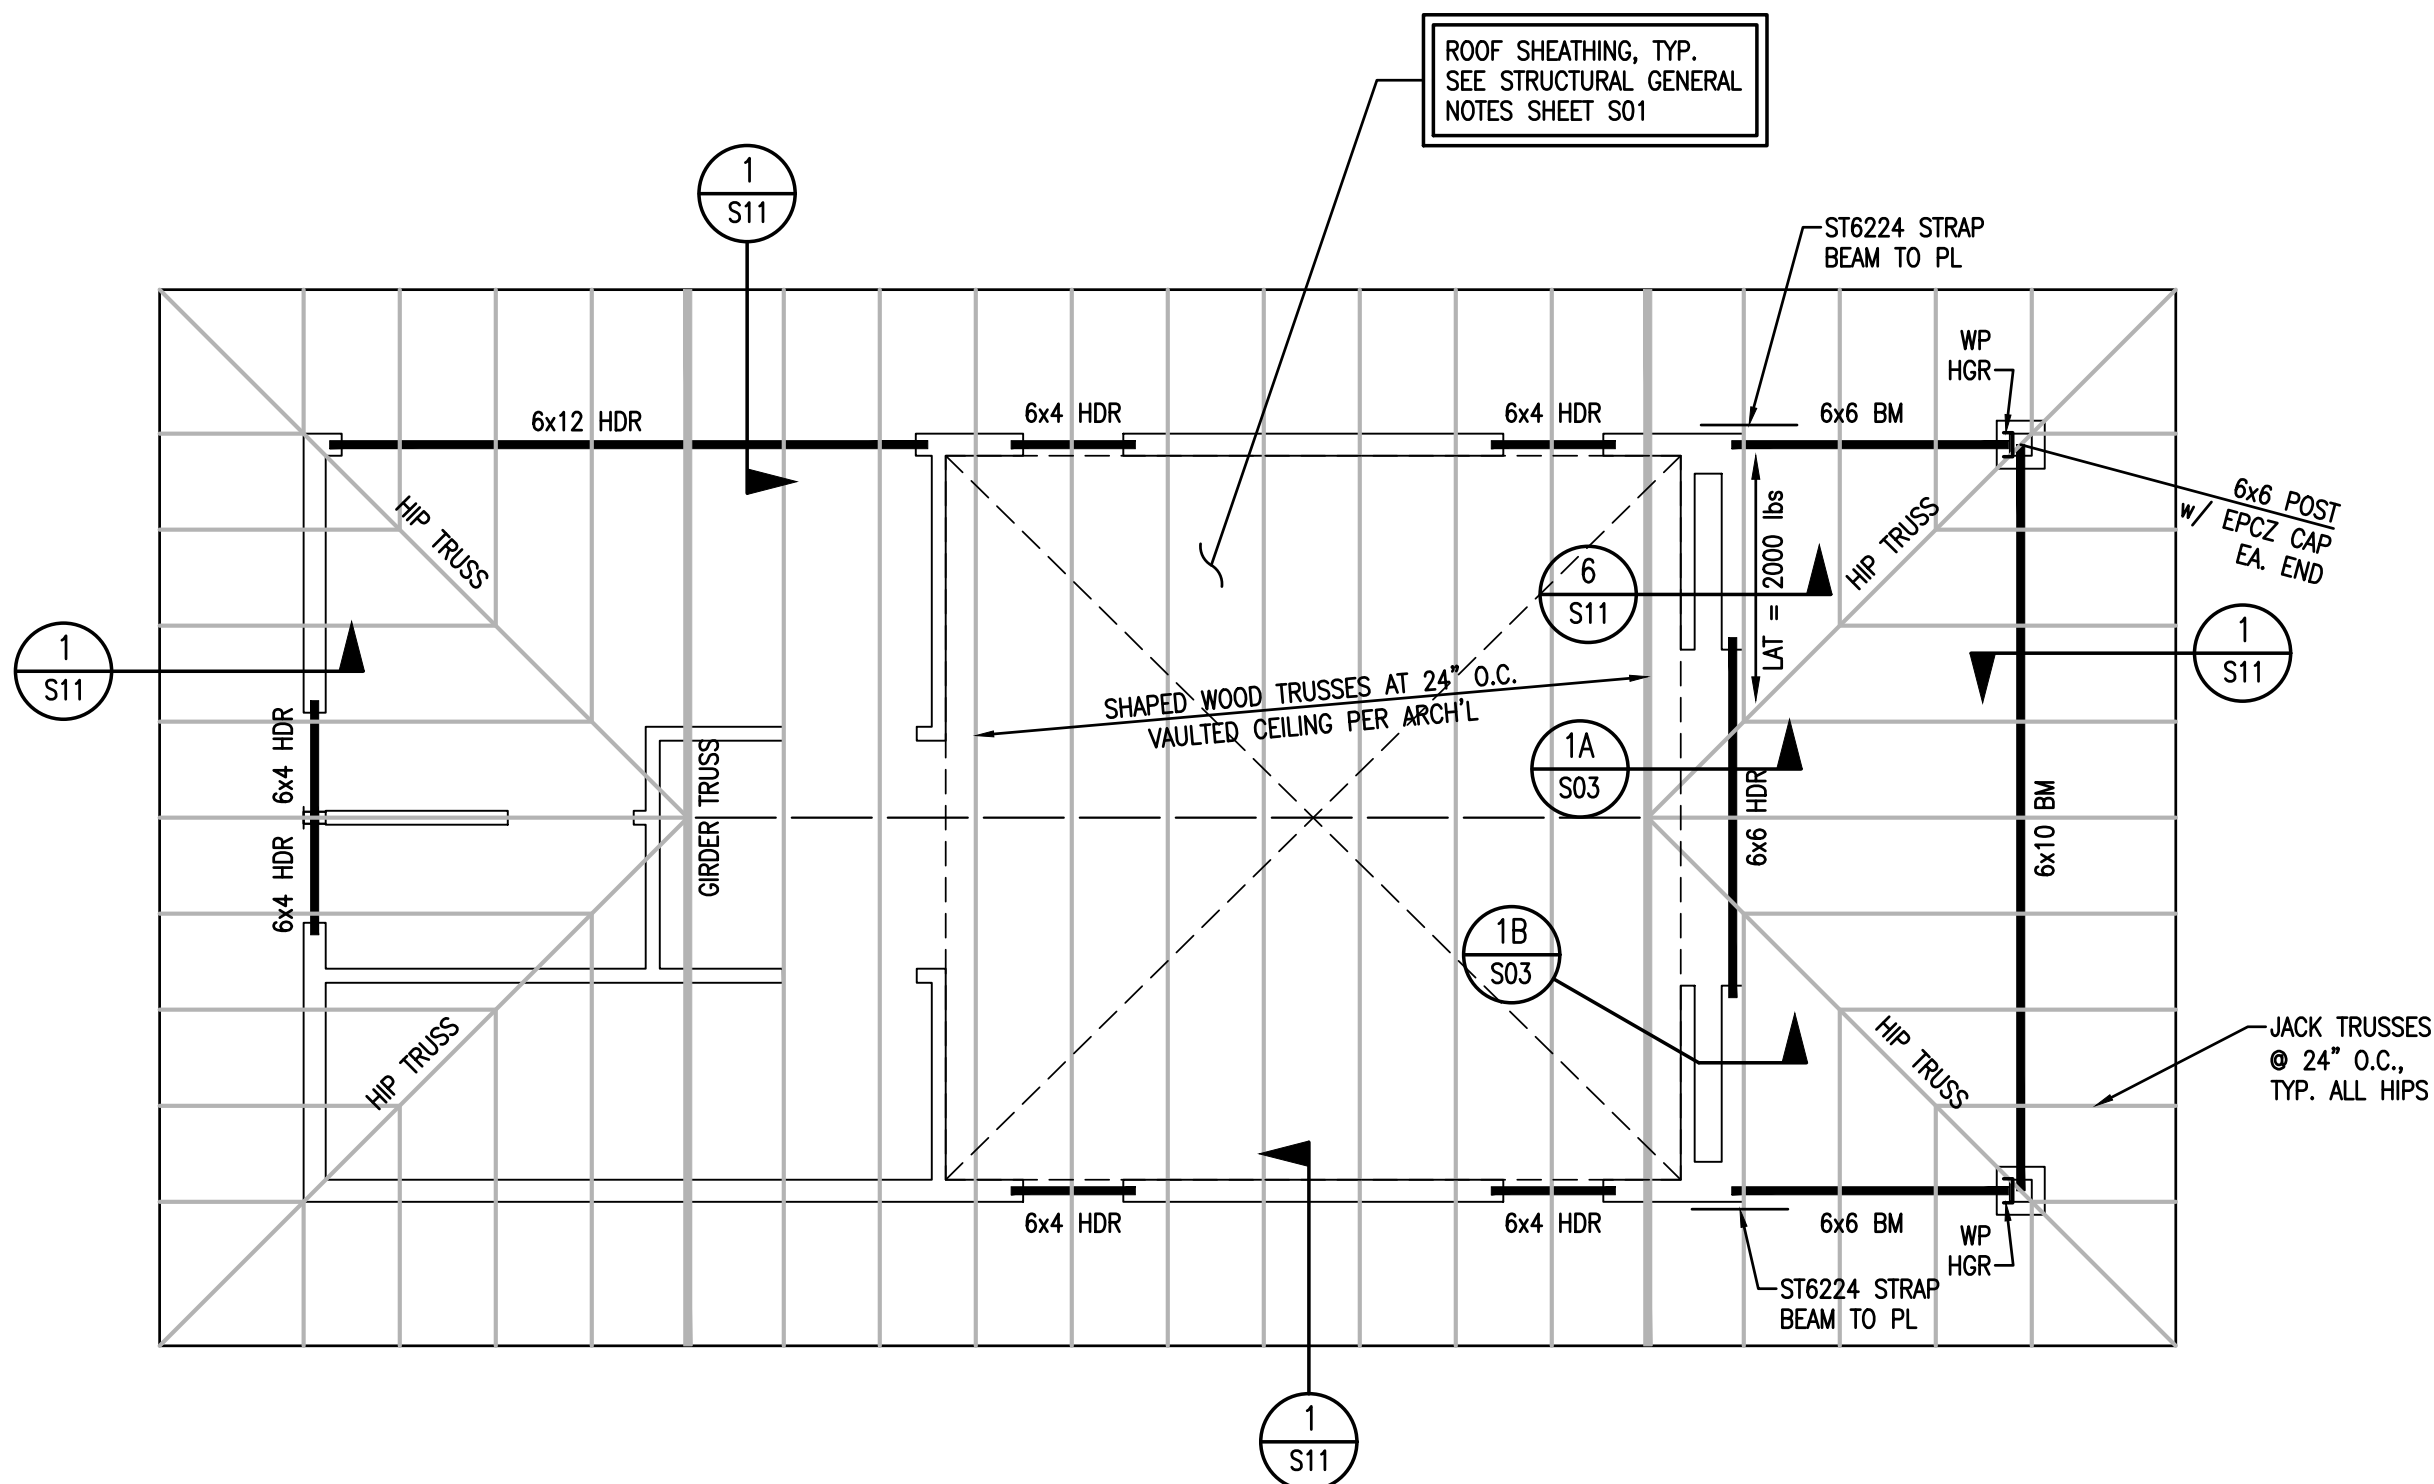

ROOF FRAMING PLAN

1/4" = 1'-0"

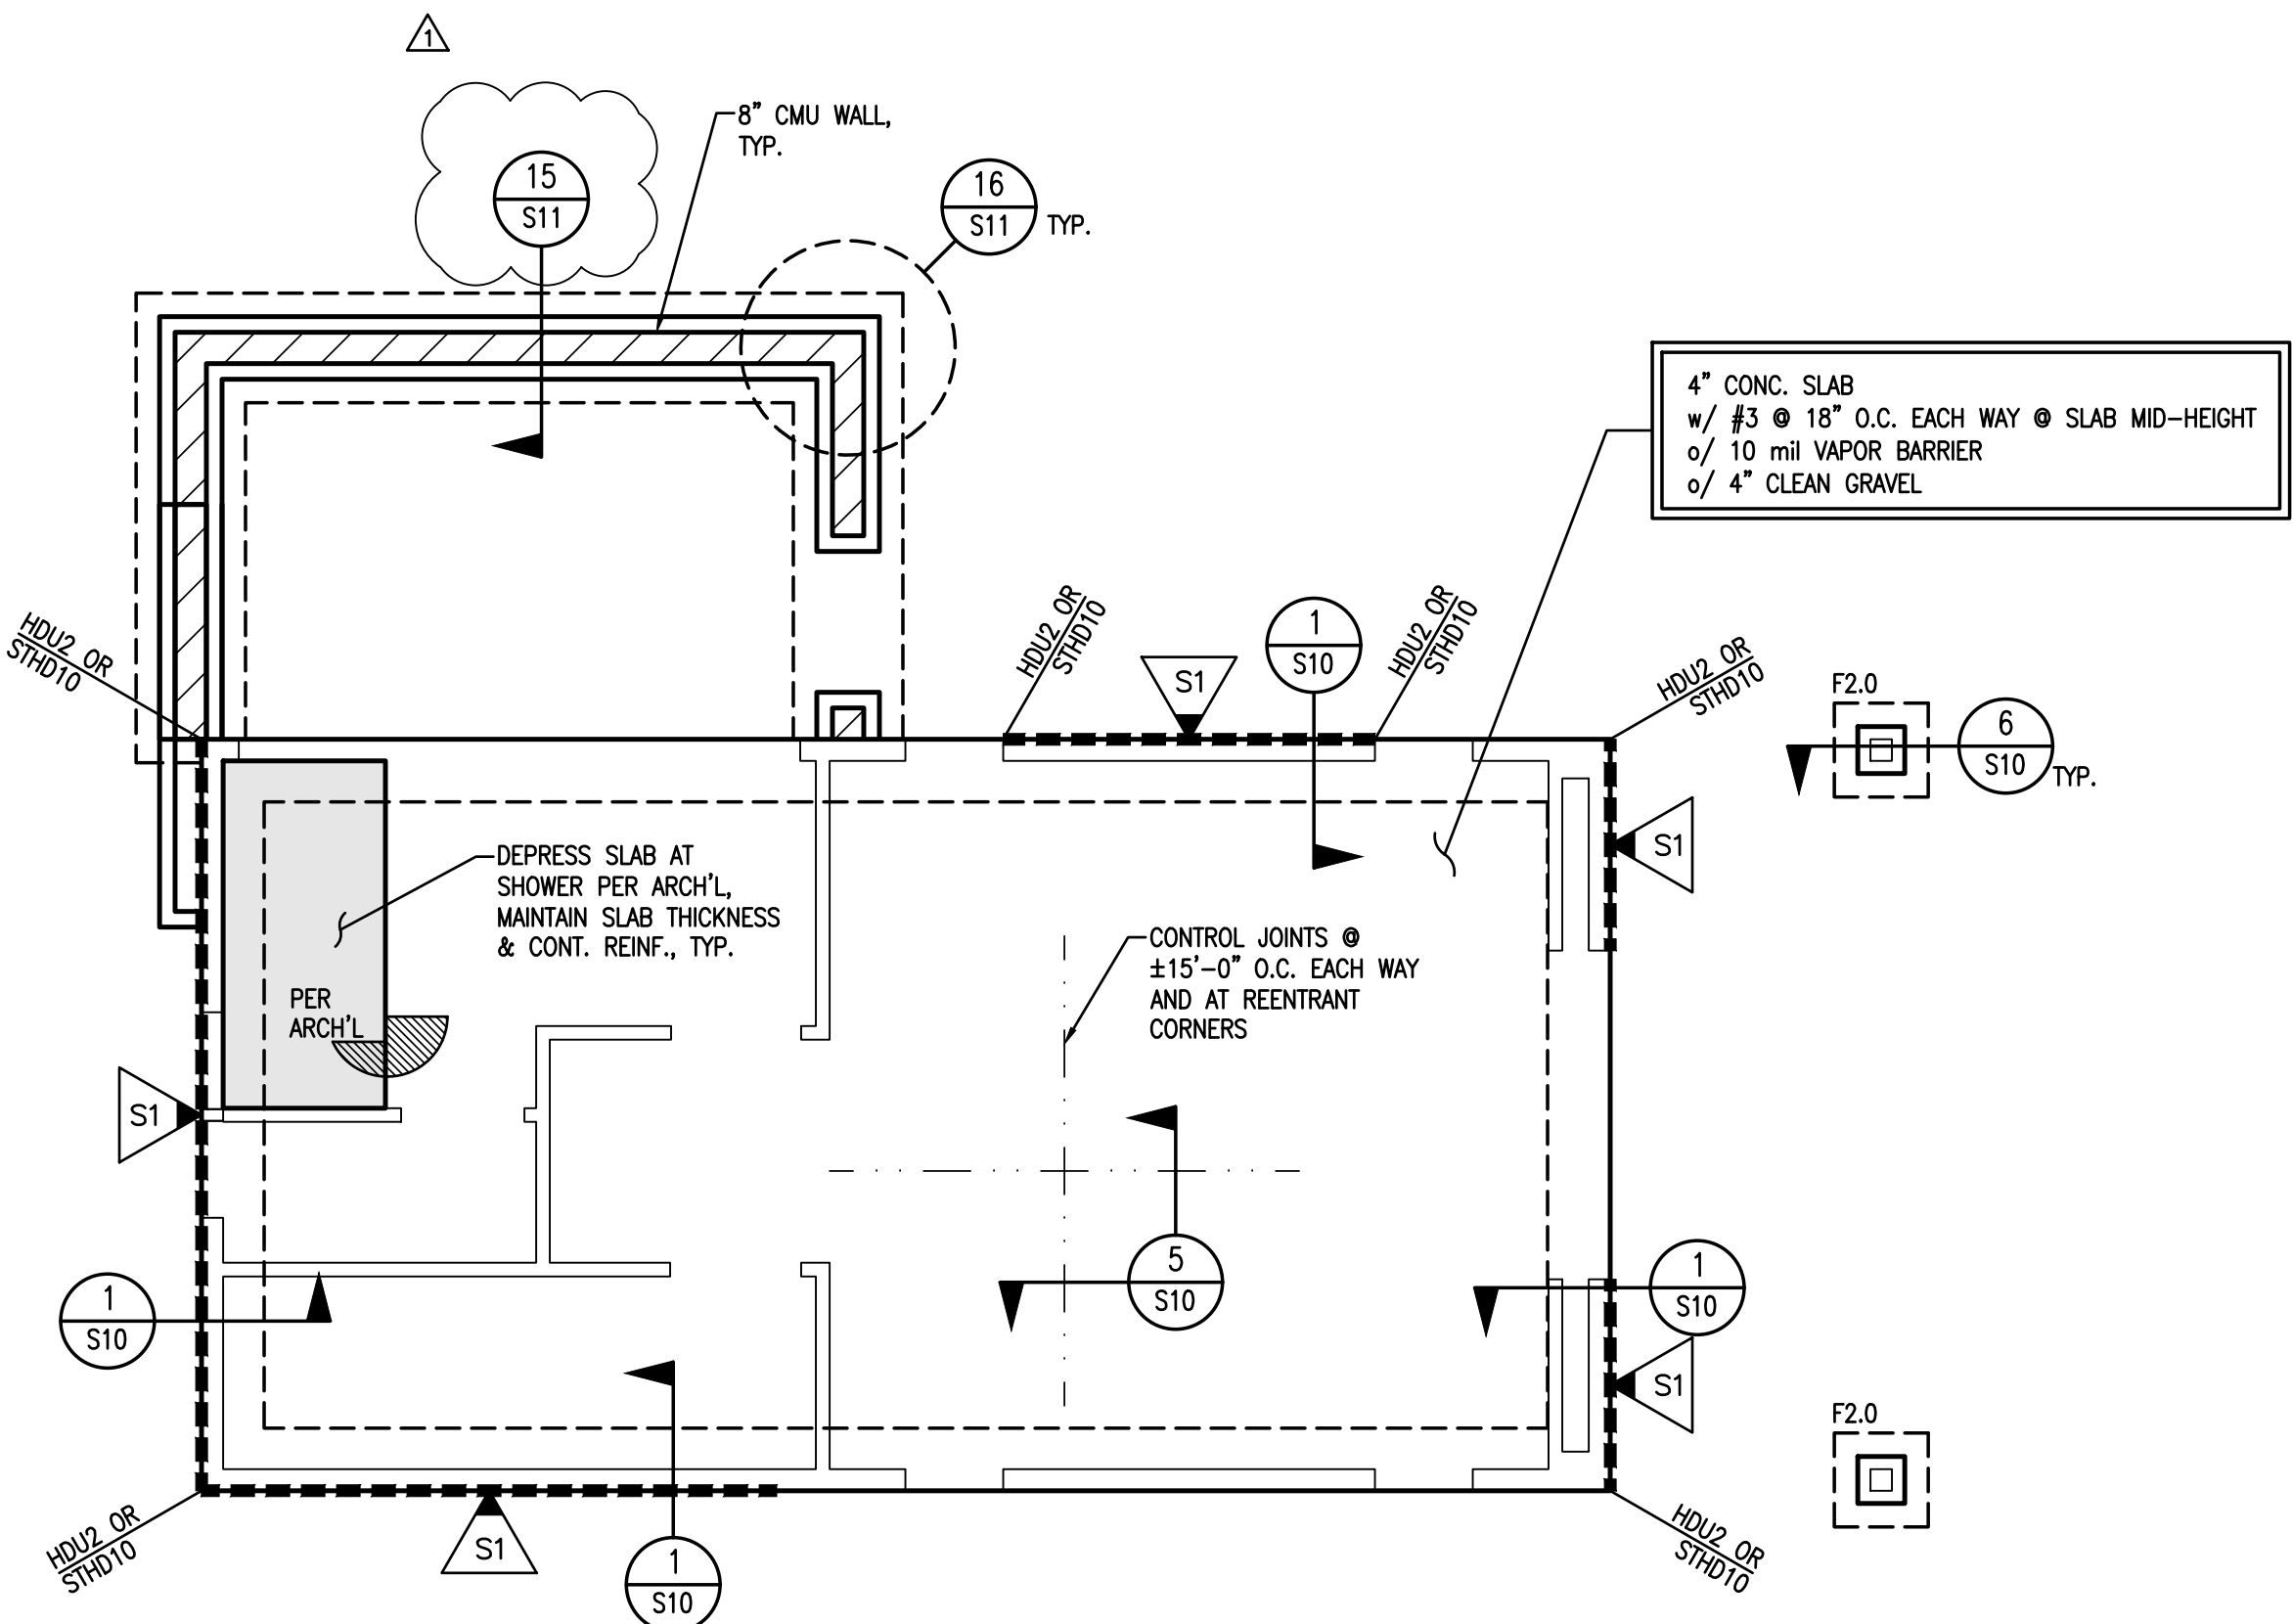

FOUNDATION PLAN

1/4" = 1'-0"

DATE	REV #	DATE	BY	CHK	RTI
08-26-21	1	12-09-21	TSR/TSR	AS SHOWN	



Copyright © 2021  
Vector Structural Engineering, LLC  
This drawing contains proprietary information  
belonging to Vector Structural Engineering, LLC,  
and may be neither wholly nor partially copied or  
reproduced without the prior written permission of  
Vector Structural Engineering, LLC.

KAUAI COUNTY, HAWAII  
TNC: (4) 2-8-021-04  
OHANA  
STRUCTURAL PLANS

PROPRIETARY DO NOT DISTRIBUTE

For Review  
12/24/2025 10:13:22 AM


THIS WORK WAS PREPARED BY  
ME OR UNDER MY SUPERVISION.  
CONSTRUCTION OF THIS  
PROJECT WILL BE UNDER MY  
OBSERVATION WHEN REQUIRED  
BY H.A.R. 16-115-9-9  
EXPIRATION DATE OF LICENSE:  
04/30/2022

U3360-010-211

S08




- FRAMING NOTES:
- ALL FRAMED WALLS TO BE 2x @ 16" O.C. (MAX) PER ARCHITECTURAL PLANS AND SHALL MEET REQUIREMENTS OF WALL TABLE ON SHEET S02.
  - FOR 2x4 FRAMED WALLS AT HEADERS (HDR):
    - PROVIDE (1) 2x4 TRIMMER & (1) 2x4 KING STUD AT OPENINGS < 6'-0" U.N.O.
    - PROVIDE (2) 2x4 TRIMMERS & (2) 2x4 KING STUDS AT OPENINGS ≥ 6'-0" & ≤ 10'-0" U.N.O.
    - PROVIDE (2) 2x4 TRIMMERS & (3) 2x4 KING STUDS AT OPENINGS ≥ 10'-0" & ≤ 18'-0" U.N.O. (1) KING STUD REQUIRED AT BAY WINDOW OPENINGS & AT GARAGE OPENINGS WHERE ADDITIONAL KING STUDS WOULD NOT FIT. NOTE: KINGSTUDS NOT REQUIRED AT BEAMS (BM)
  - FOR 2x6 FRAMED WALLS AT HEADERS (HDR):
    - PROVIDE (1) 2x6 TRIMMER & (1) 2x6 KING STUD AT OPENINGS < 8'-0" U.N.O.
    - PROVIDE (2) 2x6 TRIMMERS & (2) 2x6 KING STUDS AT OPENINGS ≥ 8'-0" & ≤ 12'-0" U.N.O.
    - PROVIDE (2) 2x6 TRIMMERS & (3) 2x6 KING STUDS AT OPENINGS ≥ 12'-0" & ≤ 20'-0" U.N.O. NOTE: KINGSTUDS NOT REQUIRED AT BEAMS (BM)
  - FOR 2x8 FRAMED WALLS AT HEADERS (HDR):
    - PROVIDE (1) 2x8 TRIMMER & (1) 2x8 KING STUD AT OPENINGS < 8'-0" U.N.O.
    - PROVIDE (2) 2x8 TRIMMERS & (2) 2x8 KING STUDS AT OPENINGS ≥ 8'-0" & ≤ 12'-0" U.N.O.
    - PROVIDE (2) 2x8 TRIMMERS & (3) 2x8 KING STUDS AT OPENINGS ≥ 12'-0" & ≤ 20'-0" U.N.O. NOTE: KINGSTUDS NOT REQUIRED AT BEAMS (BM)
  - FACE NAIL MULTIPLE 2x POSTS WITH 16d SINKERS @ 6" O.C.
  - SHADED AREAS ARE TYPICAL OVERFILL, STICK FRAMED PER DETAIL 6/S02 OR OVERBUILD TRUSSES PER TRUSS MANUFACTURER
  - INTERIOR BEARING WALLS
  - ALL GLULAM BEAMS TO HAVE STANDARD CAMBER (R = 2000') U.N.O.
  - PROVIDE (2) 2x POST, EACH END OF ALL BEAMS & GIRDER TRUSSES, U.N.O. PROVIDE CONTINUOUS LOAD PATH TO FOUNDATION WITH POSTS, CRIPPLES, AND SQUASH BLOCKS AS REQUIRED.
  - BEAM AND HEADER SIZES INDICATED ON THE PLANS ARE MINIMUM SIZES. LARGER SIZES MAY BE INSTALLED AT THE CONTRACTOR'S OPTION.
  - CONTINUOUS TOP PLATE MAY BE USED IN LIEU OF ST6224 STRAP FROM BEAM TO PLATE.

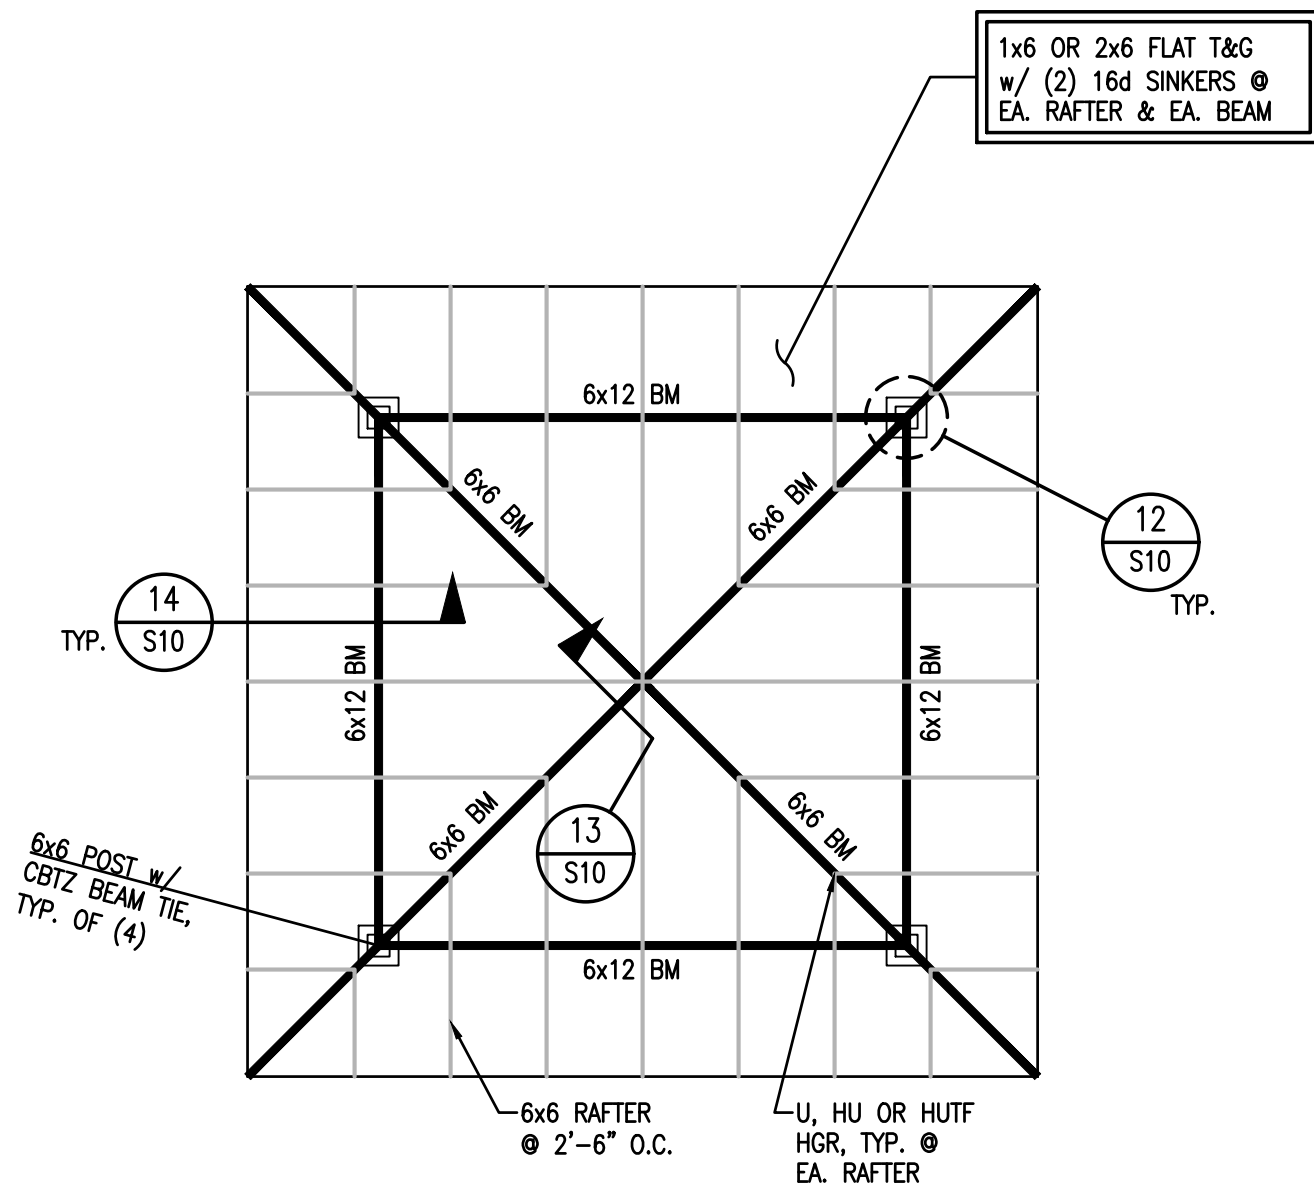

ROOF FRAMING PLAN


1/4" = 1'-0"

- FOUNDATION NOTES:
- ALL DIMENSIONS ARE PER ARCHITECTURAL DRAWINGS.
  - ALL EXTERIOR WALLS, INTERIOR BEARING WALLS & SHEAR WALLS TO BE ATTACHED TO THE FOUNDATION w/ #1/2" x 10" LONG ANCHOR BOLTS (7" EMBED.) AT 48" O.C., U.N.O. SEE THIS PLAN & SHEAR WALL SCHEDULE FOR ANCHOR BOLT REQUIREMENTS AT SHEAR WALLS. ANCHOR BOLTS AT SHEAR WALLS TO HAVE WASHERS PER SHEAR WALL SCHEDULE (S02). ALL OTHER ANCHOR BOLTS TO HAVE WASHERS PER NOTE "E" IN GENERAL NOTES (S1).
  - ALL HOLDOWNS SHALL BE INSTALLED AS SHOWN ON DETAIL 7/S10.
  - ISOLATED FOOTINGS & INTERIOR STRIP FOOTINGS TO BE CENTERED BELOW POSTS & BEARING/SHEAR WALLS, RESPECTIVELY.
  - SEE SHEET S02 FOR FOOTING SCHEDULE.
  - MSA MUJSILL ANCHORS MAY BE USED IN PLACE OF ANCHOR BOLTS, INSTALLED AT THE SAME SPACING INDICATED FOR ANCHOR BOLTS, INCLUDING REDUCED SPACING AT SHEAR WALLS.
  - STRIP & REMOVE EXISTING VEGETATION, REMOVE UNCONTROLLED FILL, OVEREXCAVATE AND REPLACE w/ PROPERLY COMPACTED FILL AS REQUIRED.

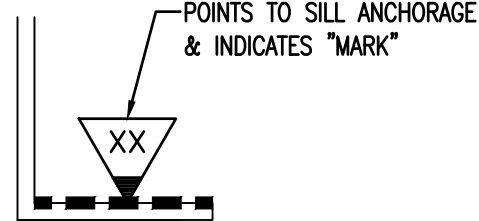

NOTE:  
SEE SHEET S02 FOR SILL ANCHORAGE SCHEDULE

SILL ANCHORAGE KEY

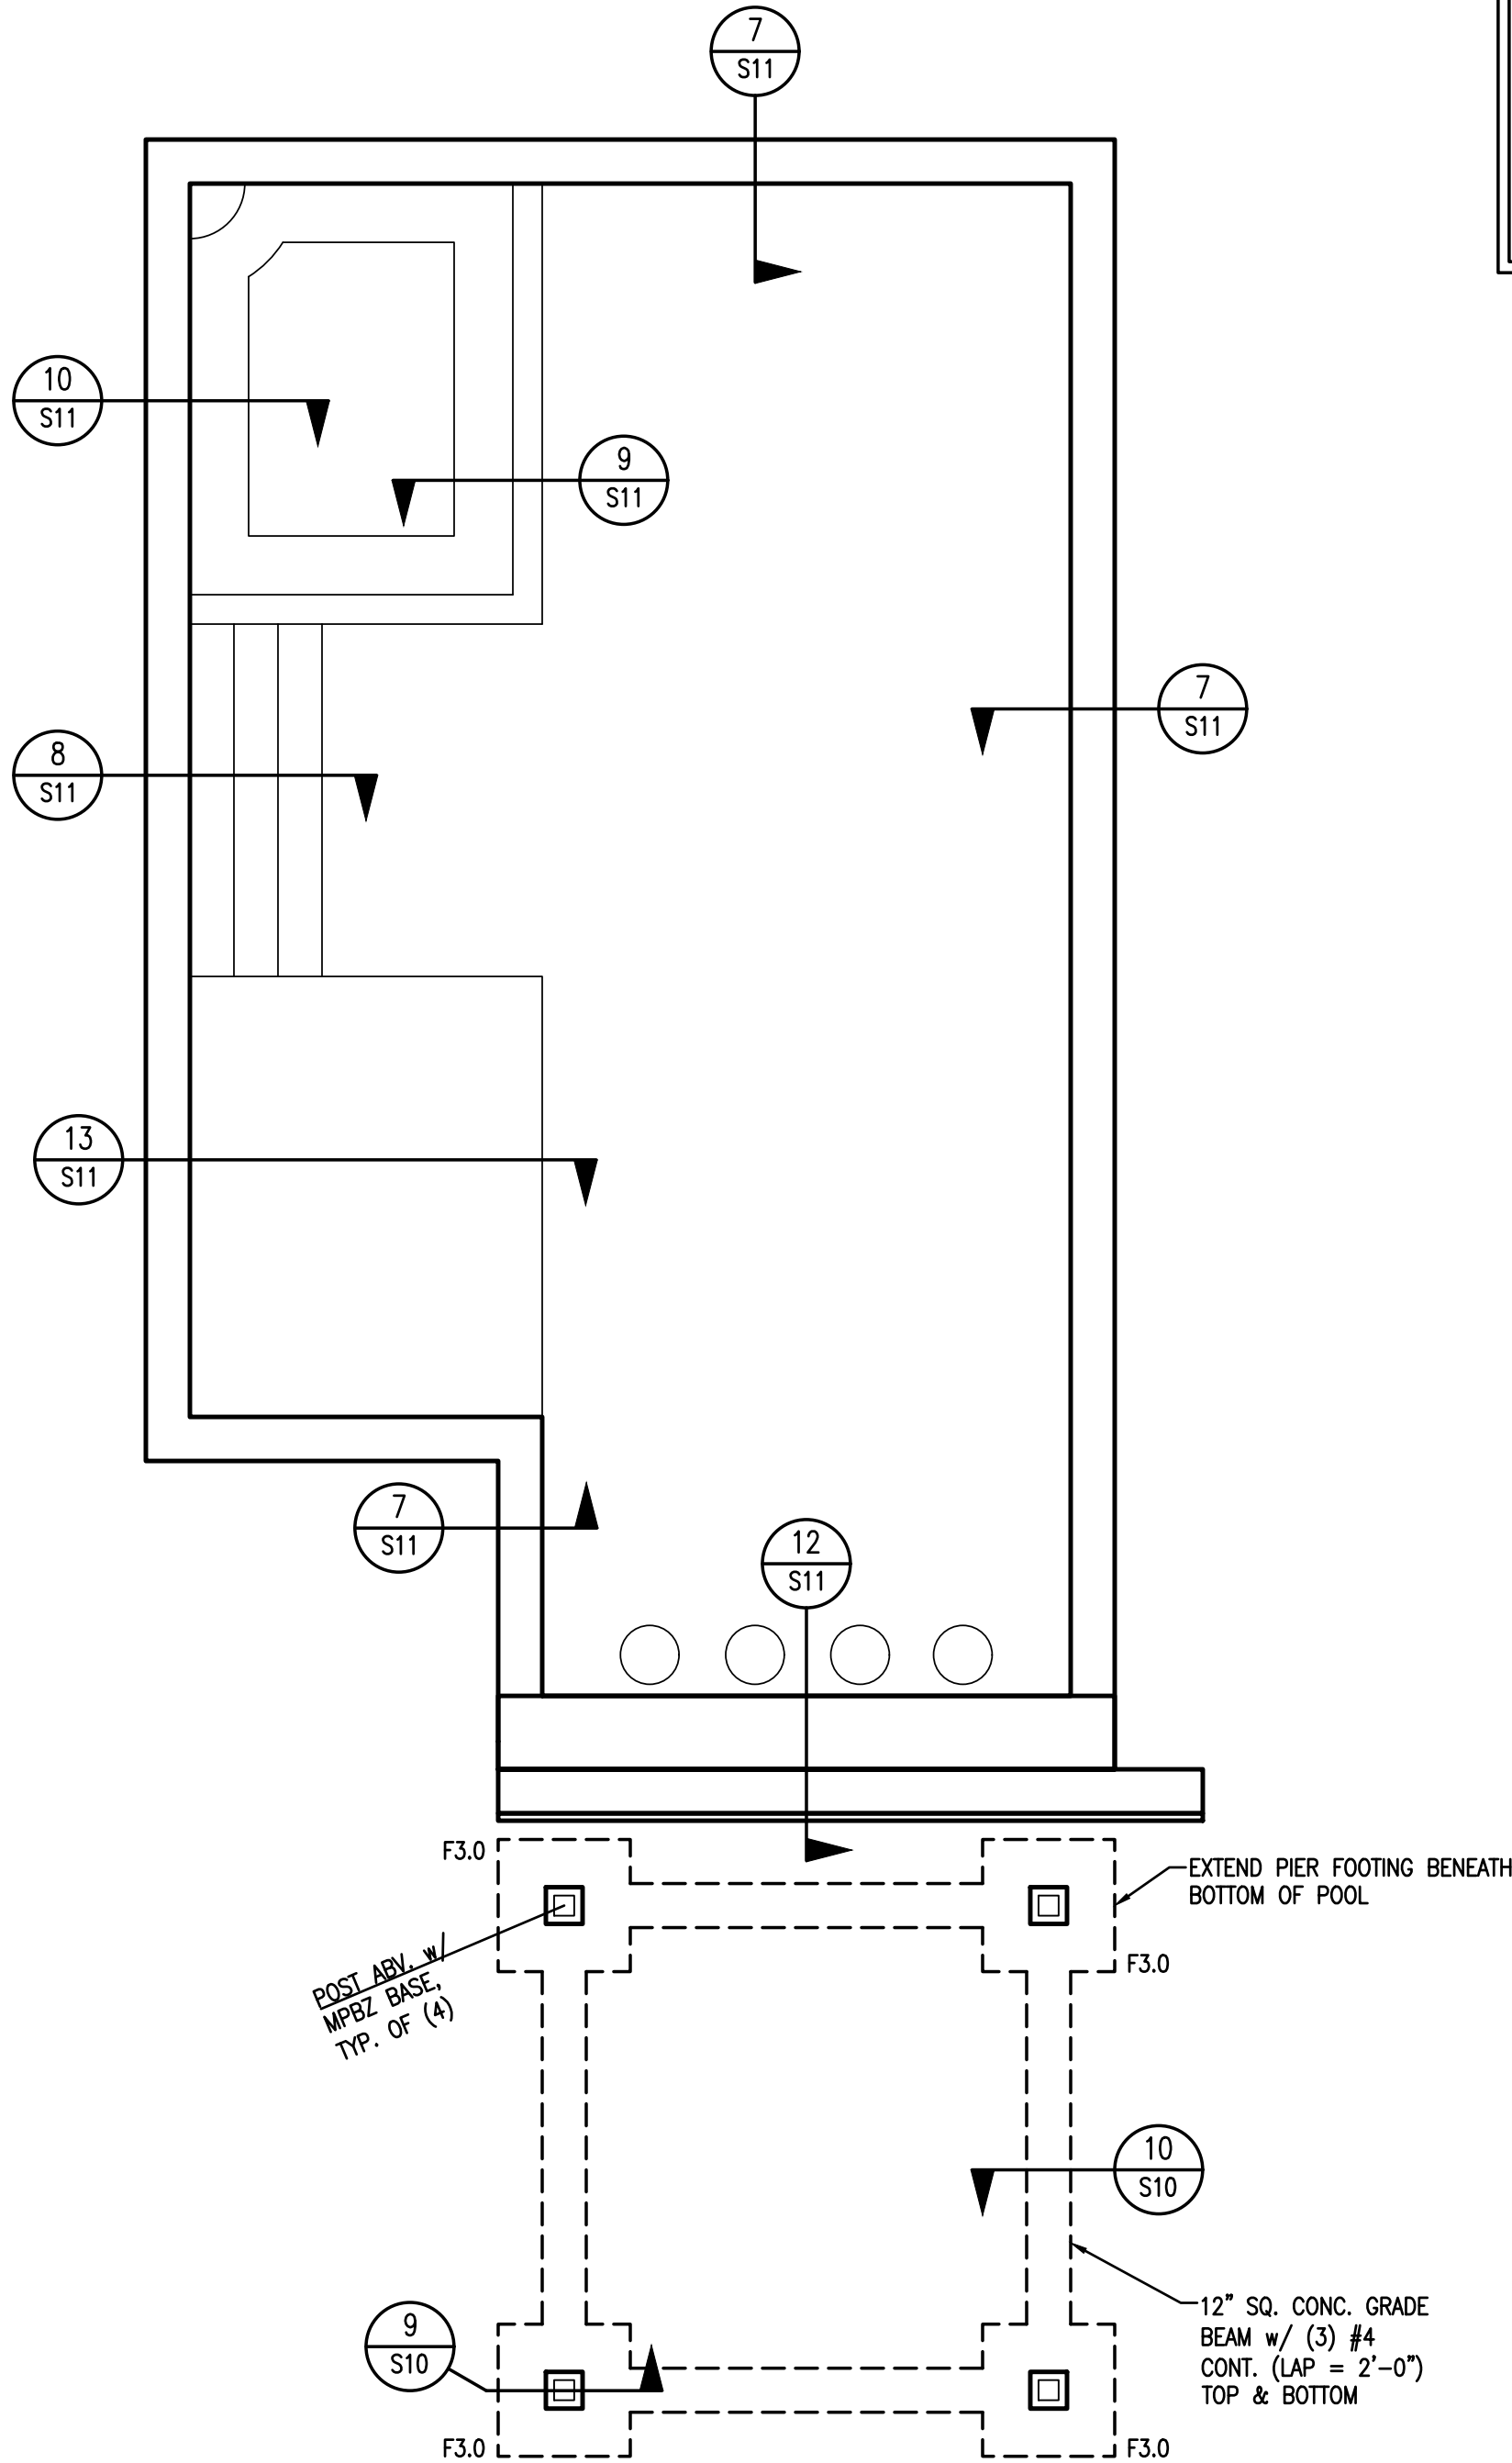

FOUNDATION PLAN

1/4" = 1'-0"

DATE:	08-26-21	ENG: COB	DWN: BAD	CHK: RTI
REV. #		BY:		DESCRIPTION

**VECTOR**  
ENGINEERS  
DRAPER, UTAH  
(801) 225-7777  
WWW.VECTORSE.COM

Copyright © 2021  
Vector Structural Engineering, LLC  
This drawing contains proprietary information  
belonging to Vector Structural Engineering, LLC,  
and may be neither wholly nor partially copied or  
reproduced without the prior written permission of  
Vector Structural Engineering, LLC.

CABANA  
STRUCTURAL PLANS

PROPRIETARY DO NOT DISTURB

For Review  
02/24/2025 10:13:22 AM

THIS WORK WAS PREPARED BY  
ME OR UNDER MY SUPERVISION.  
CONSTRUCTION OF THIS  
PROJECT WILL BE UNDER MY  
OBSERVATION WHEN REQUIRED  
BY H.A.R. 16-115-9  
EXPIRATION DATE OF LICENSE:  
04/30/2022

U3360-010-211


S09



NOT USED

N.T.S.


11

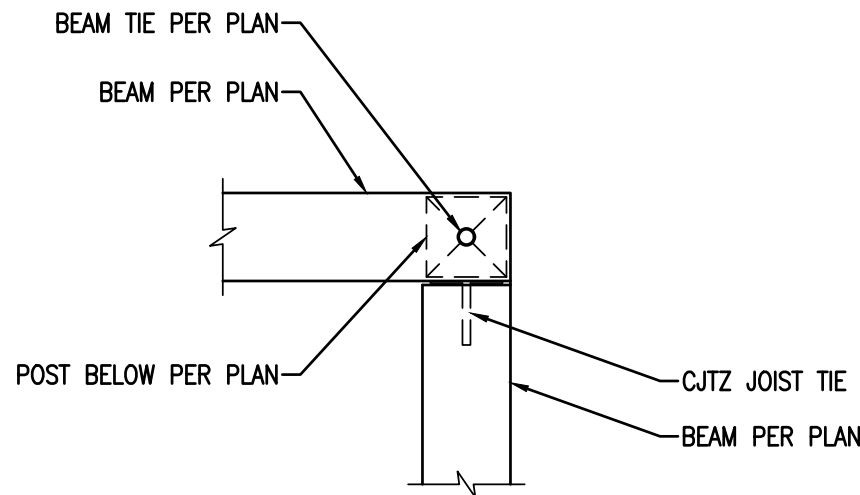

PLAN VIEW


N.T.S.

12

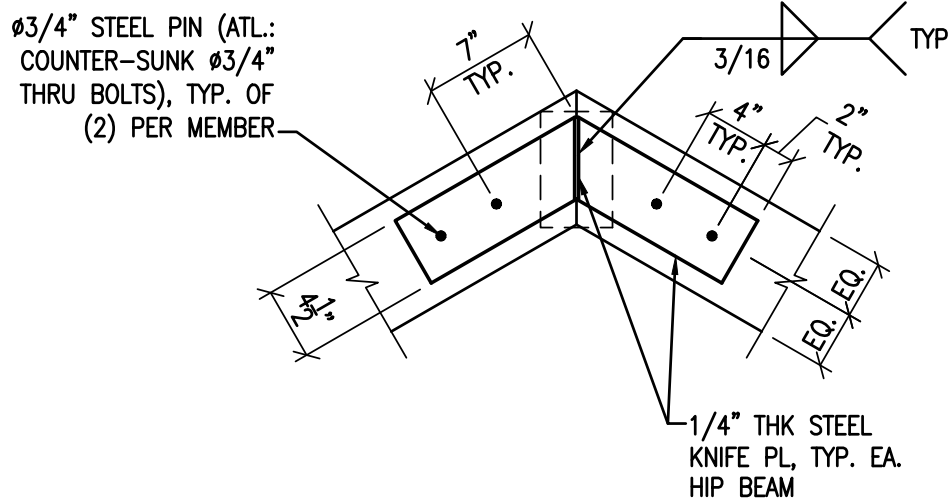


N.T.S.

13

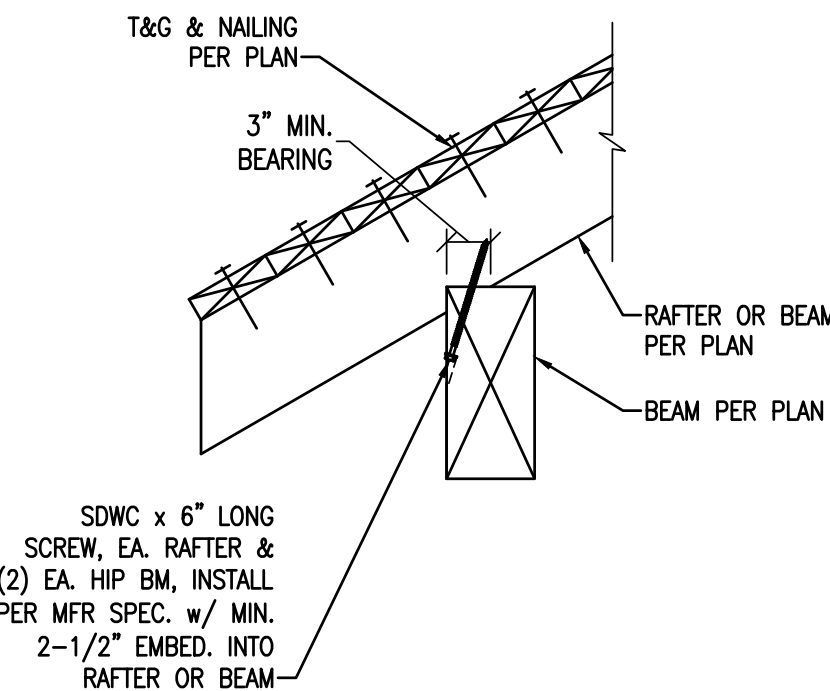


14

NOTE: WHERE PONY WALL IS ABOVE  
HEADER PROVIDE 3/8" PLYWOOD OR  
O.S.B. WITH 8d COMMON NAILS @ 4" O.C.  
EDGE/BOUNDARY NAILING AND 16d  
SINKERS AT 4" O.C. SOLE PLATE NAILING

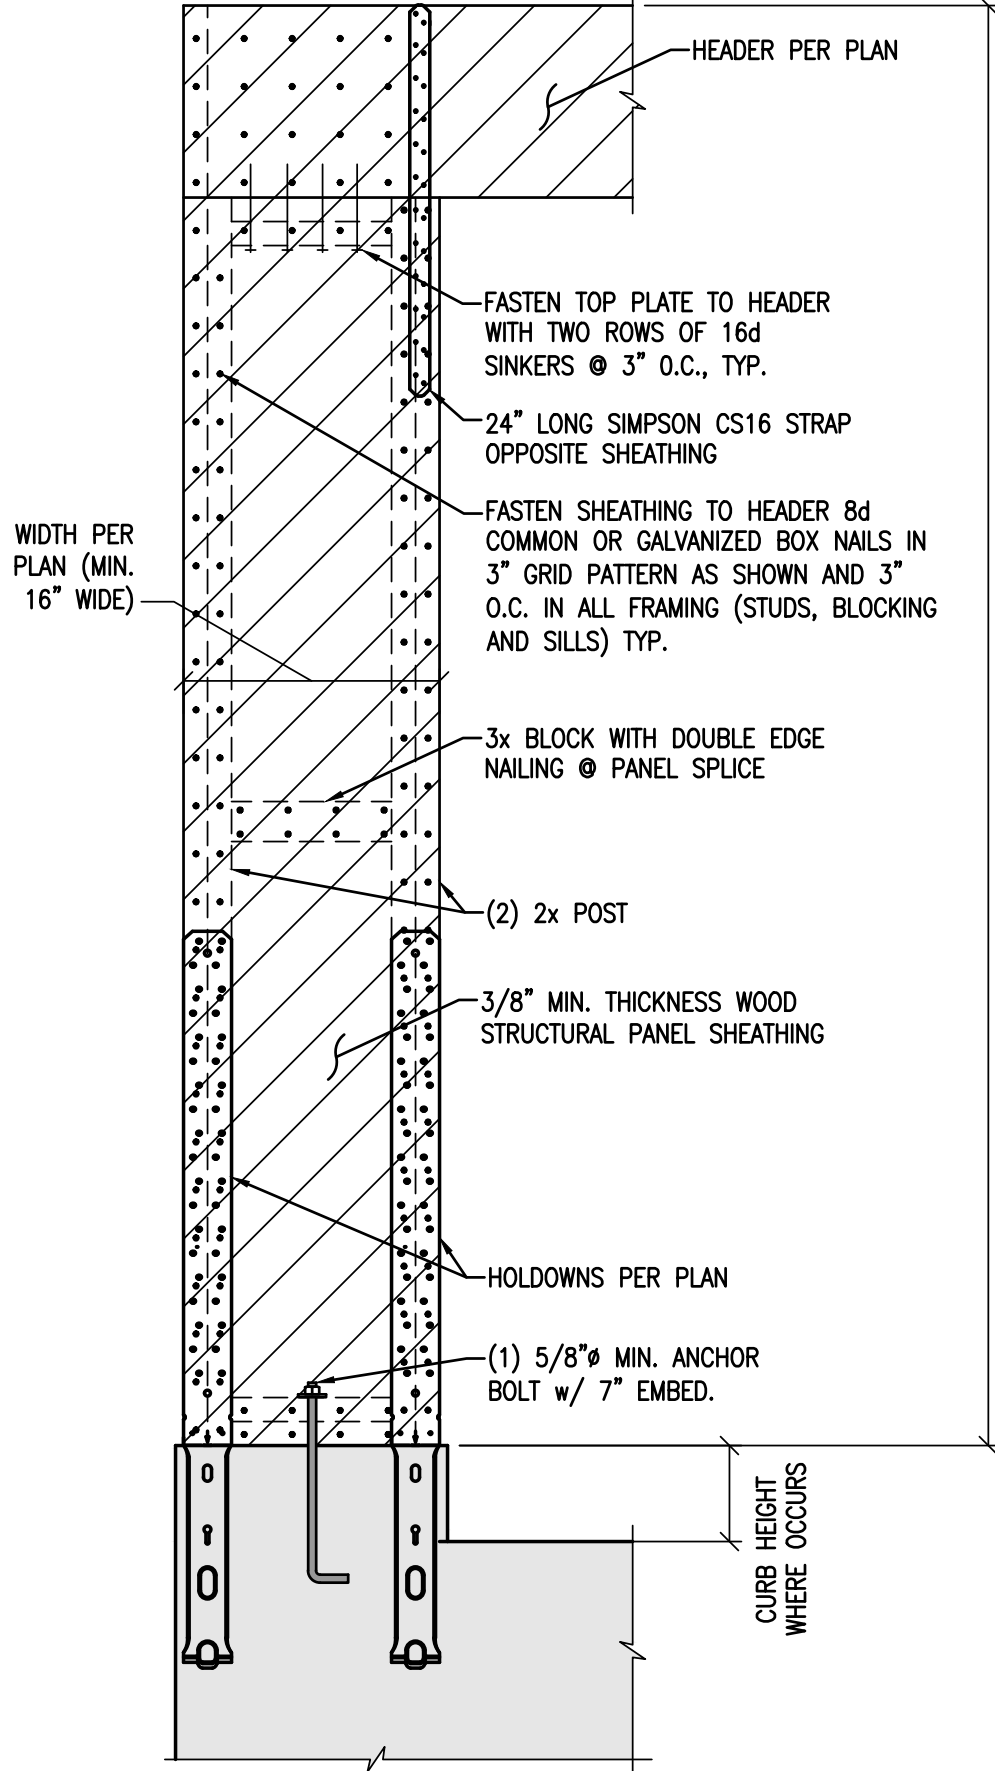


MAX. HEIGHT 10'-0"

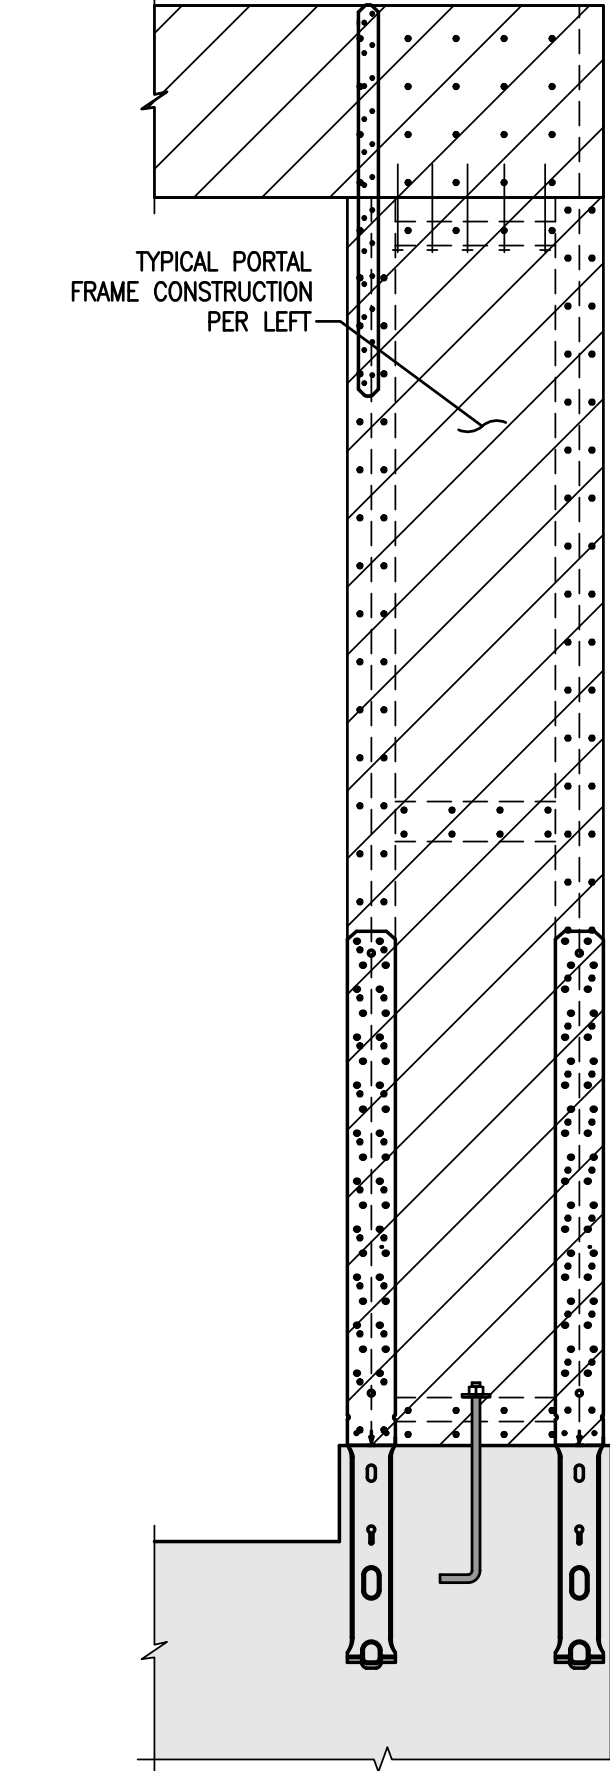


N.T.S.

8

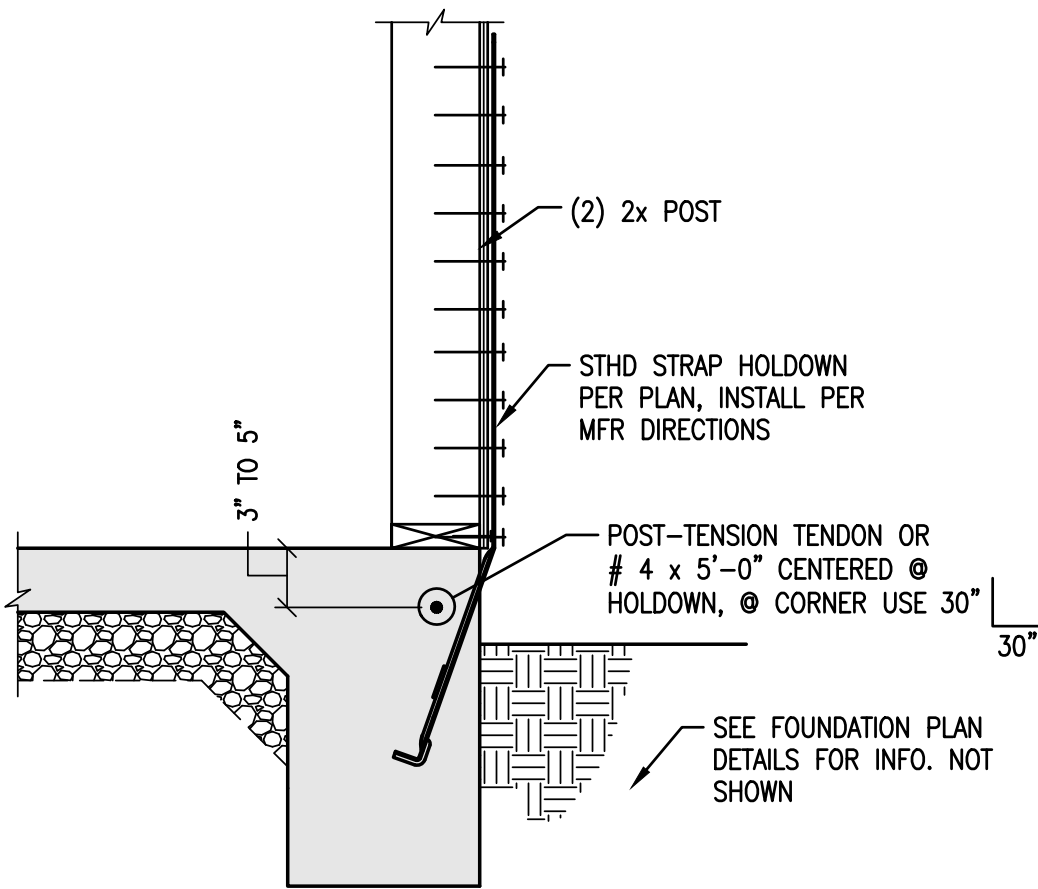

STRAP HOLDOWN

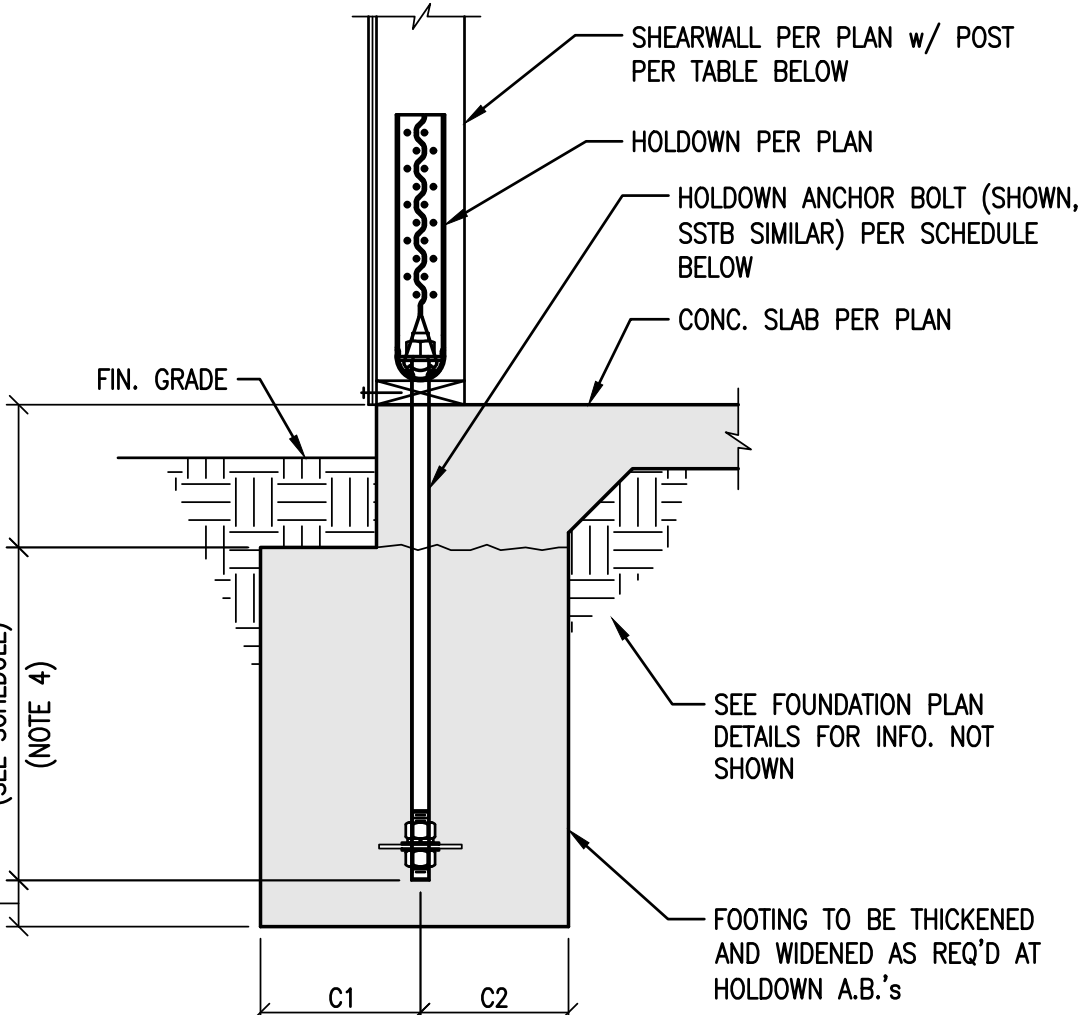

HDU HOLDOWN

N.T.S.

7


		ANCHORAGE							
		ANCHORAGE (CAST IN PLACE)		ANCHORAGE (RETROFIT)		CAST IN PLACE OR RETROFIT			
		SSTB	ALL THREAD ROD (NOTE 1)	ALL THREAD ROD (NOTE 2 & 3)	HOLE DIAMETER	EMBEDMENT	C1	C2	FOOTING
HOLDOWN									
HDU2 - SDS2.5	SSTB24	5/8" A307	5/8" A307	3/4"	10"	6"	6"	(2) 2x	PER FOUNDATION DETAILS
HDU4 - SDS2.5	SSTB24	5/8" A307	5/8" A307	3/4"	10"	8"	8"	(2) 2x	PER FOUNDATION DETAILS
HDU5 - SDS2.5	NONE	5/8" A307	5/8" A307	3/4"	13"	12"	12"	(2) 2x	SPREAD FOOTING REQUIRED
HDU8 - SDS2.5	NONE	7/8" A307	7/8" A307	1"	15"	15"	15"	(3) 2x	SPREAD FOOTING REQUIRED
HDU11 - SDS2.5	NONE	1" A307	1" A307	1-1/4"	18"	18"	18"	6x6	SPREAD FOOTING REQUIRED

NOTES:

- PROVIDE 2-1/8"x2-1/8"x3/8" STEEL PLATE w/ (2) NUTS @ CAST IN PLACE ANCHORS.
- RETROFIT ALL-THREAD ROD IN HOLES w/ SIMPSON SET-XP EPOXY. PREPARE HOLES & INSTALL EPOXY PER MFR DIRECTIONS w/ EMBEDMENT AND EDGE DISTANCES AS SHOWN.
- SIMPSON SET-XP EPOXY PER ICC-ES 2508.
- INCREASE FOOTING DEPTH AS REQUIRED FOR 3" MIN. COVER BELOW BOLT & COORDINATE EXACT LOCATIONS WITH THE FRAMING CONTRACTOR.
- HOLDOWNS MAY BE INSTALLED 4" MAX. FROM SHEAR WALL EDGE. BOUNDARY NAILING MUST BE PROVIDED @ STUDS ALIGNED WITH HOLDOWNS.

N.T.S.


7

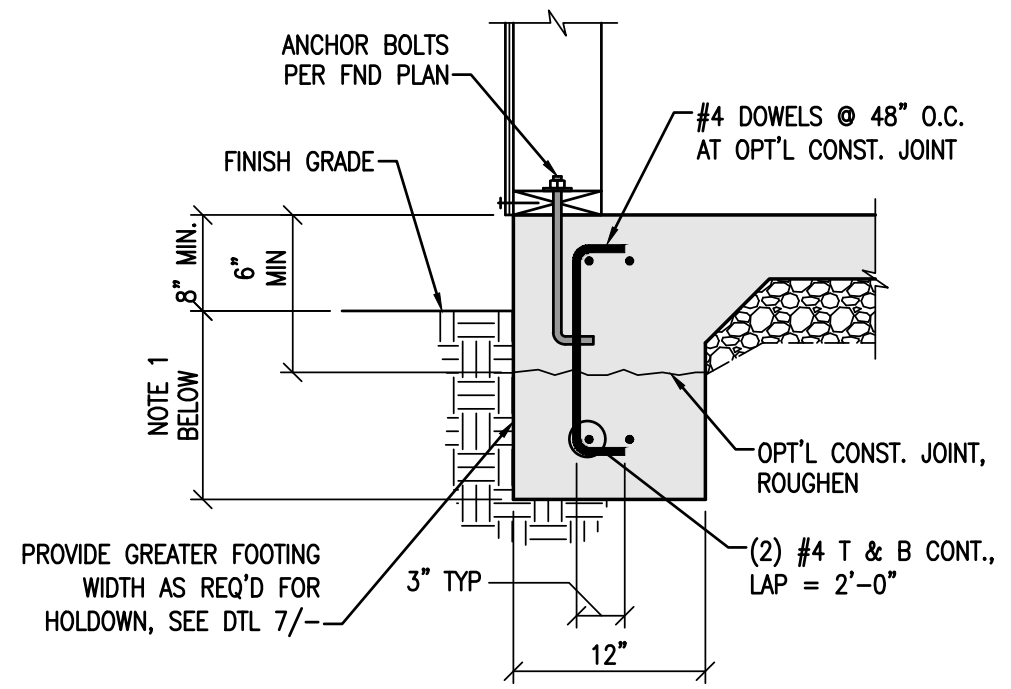

NOTE 1:  
BOTTOM OF FOOTING TO BE 12" MIN.  
BELOW LOWEST ADJACENT PAD GRADE.  
PROVIDE GREATER DEPTH AS REQ'D FOR  
HOLDOWN ANCHOR BOLTS.


N.T.S.

1

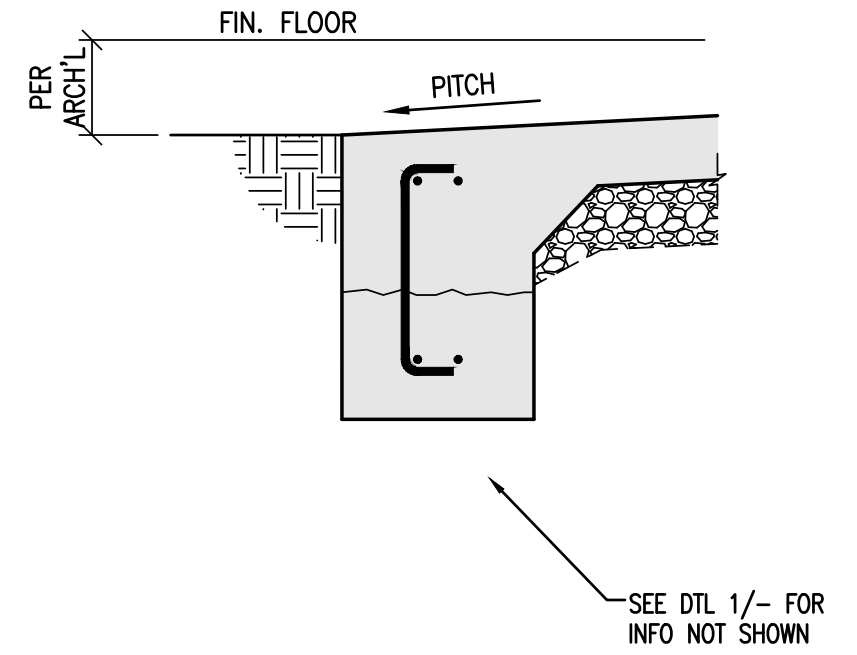


N.T.S.

2

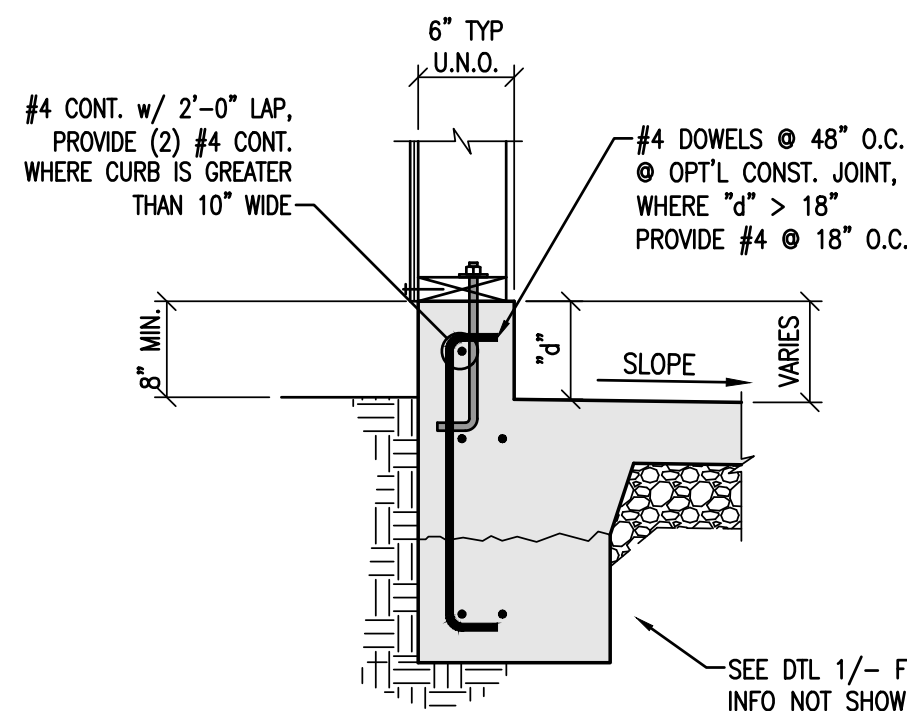

N.T.S.

3

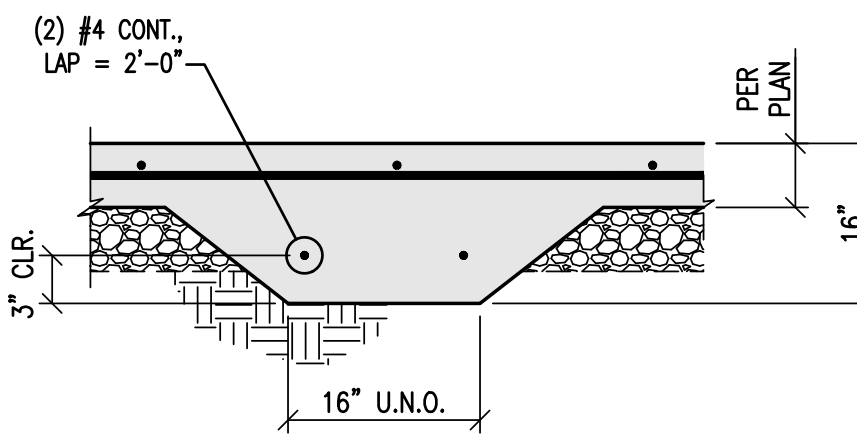

NOTE: DEEPEN AS REQ'D FOR HOLDOWN ANC. BOLTS

N.T.S.

4

DATE	REV. #	DATE	BY	ENG. COB	DWN. BAD	CHK. RTI	DESCRIPTION
08-26-21							



Copyright © 2021  
Vector Structural Engineering, LLC  
This drawing contains proprietary information  
belonging to Vector Structural Engineering, LLC,  
and may be neither wholly nor partially copied or  
reproduced without the prior written permission of  
Vector Structural Engineering, LLC.

STRUCTURAL DETAILS

PROPRIETARY DO NOT DISSEMINATE

For Review  
2/24/2025 10:13:22 AM

THIS WORK WAS PREPARED BY  
ME OR UNDER MY SUPERVISION.  
CONSTRUCTION OF THIS  
PROJECT WILL BE UNDER MY  
OBSERVATION WHEN REQUIRED  
BY H.A.R. 16-115-9  
EXPIRATION DATE OF LICENSE:  
04/30/2022

U3360-010-211


S10



NOT USED


N.T.S.

14

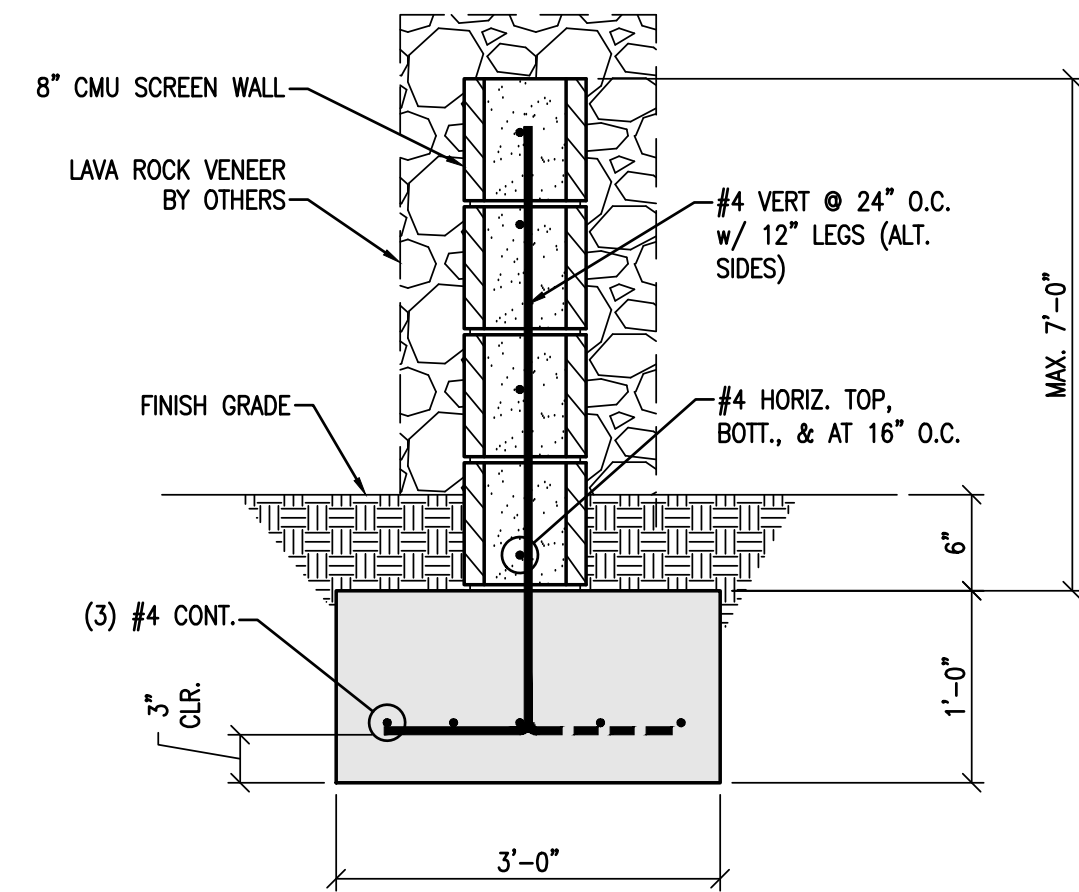


N.T.S.

15

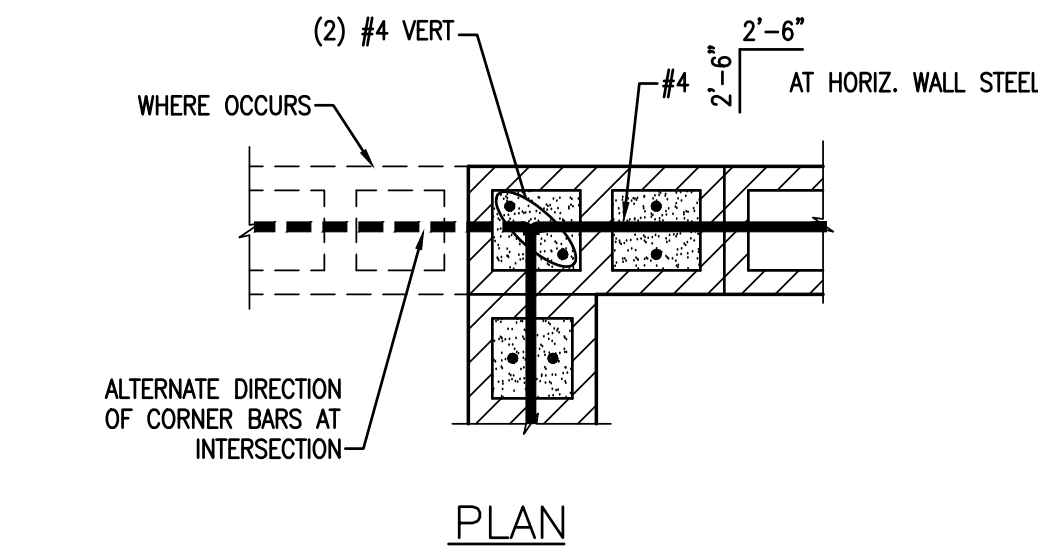


TYPICAL CORNER / INTERSECTION DETAIL

16

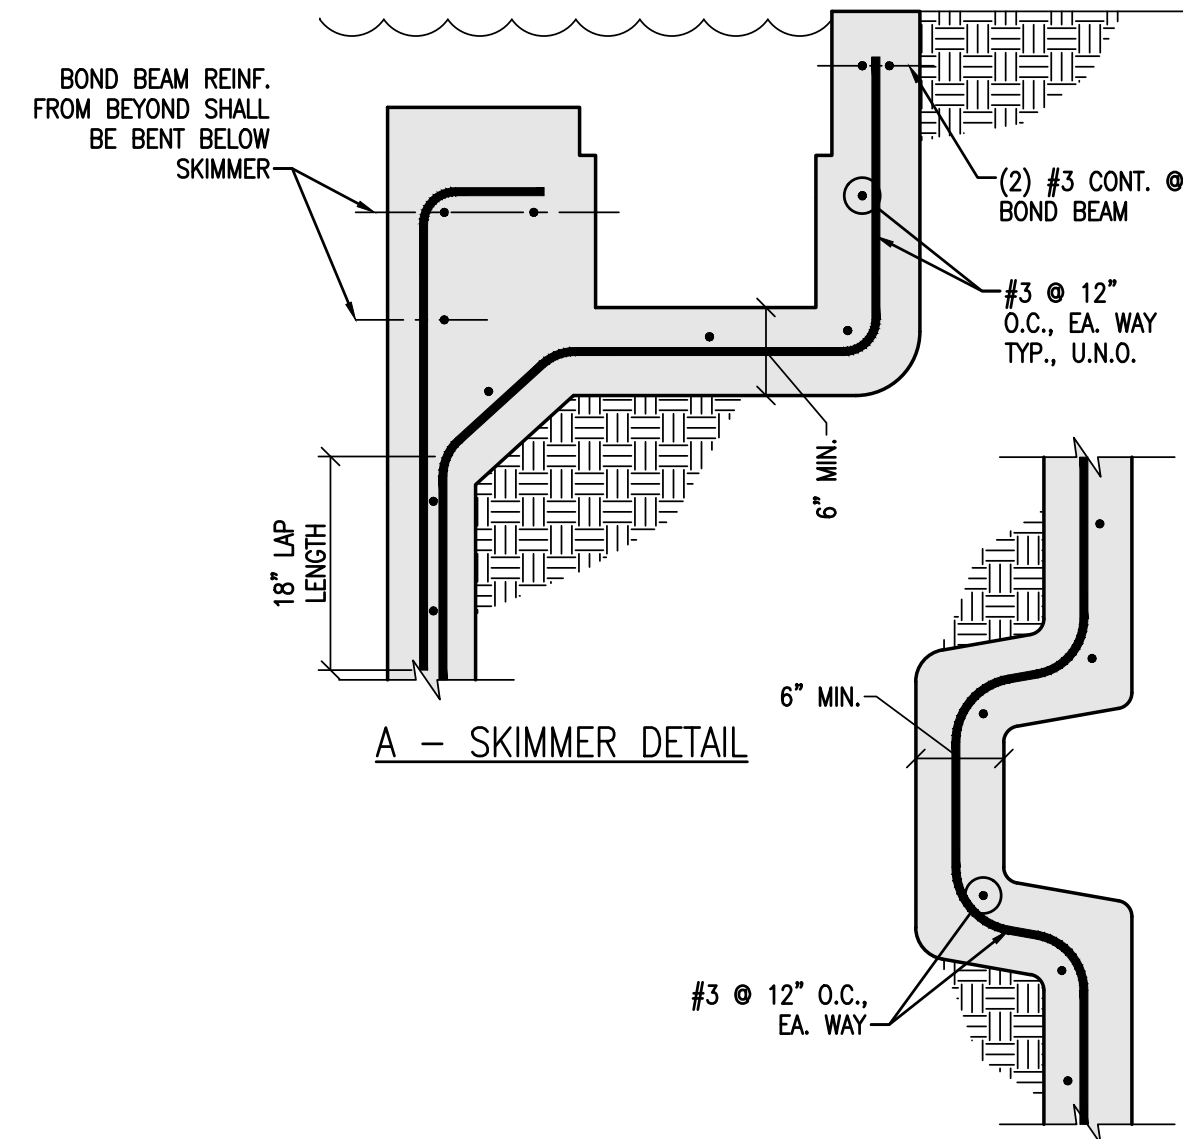


N.T.S.

11

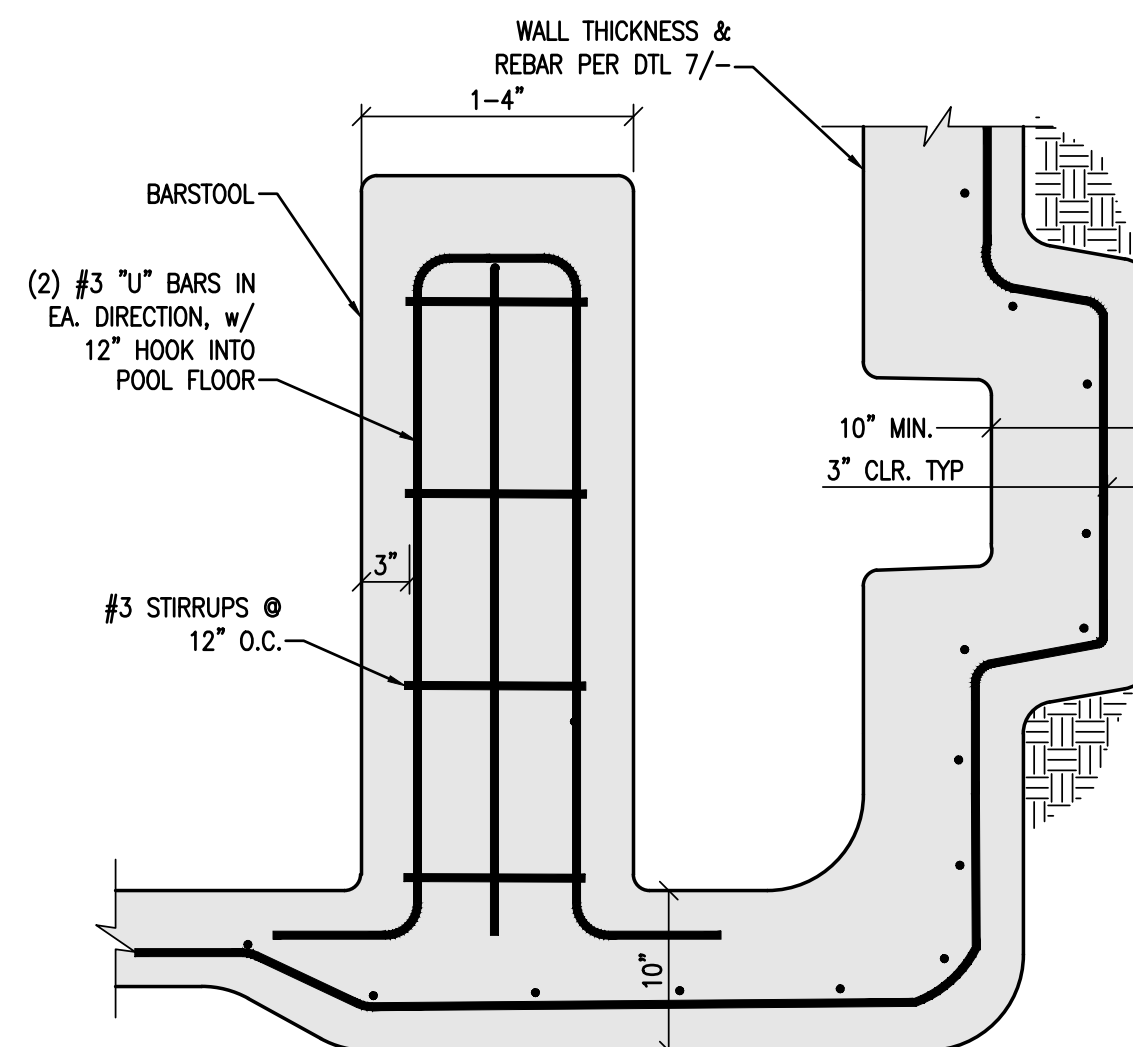


N.T.S.

12

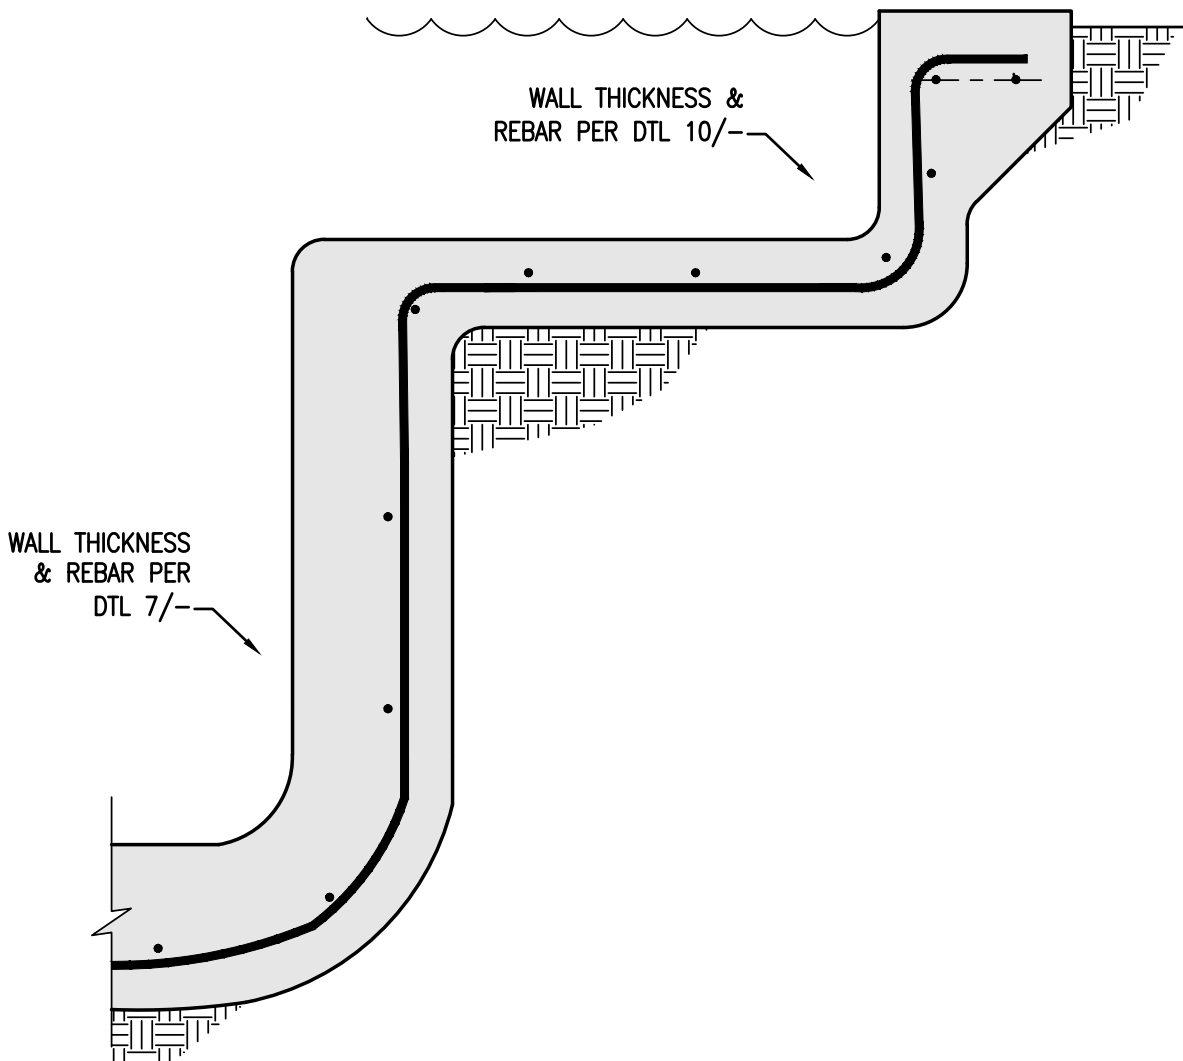


N.T.S.

13

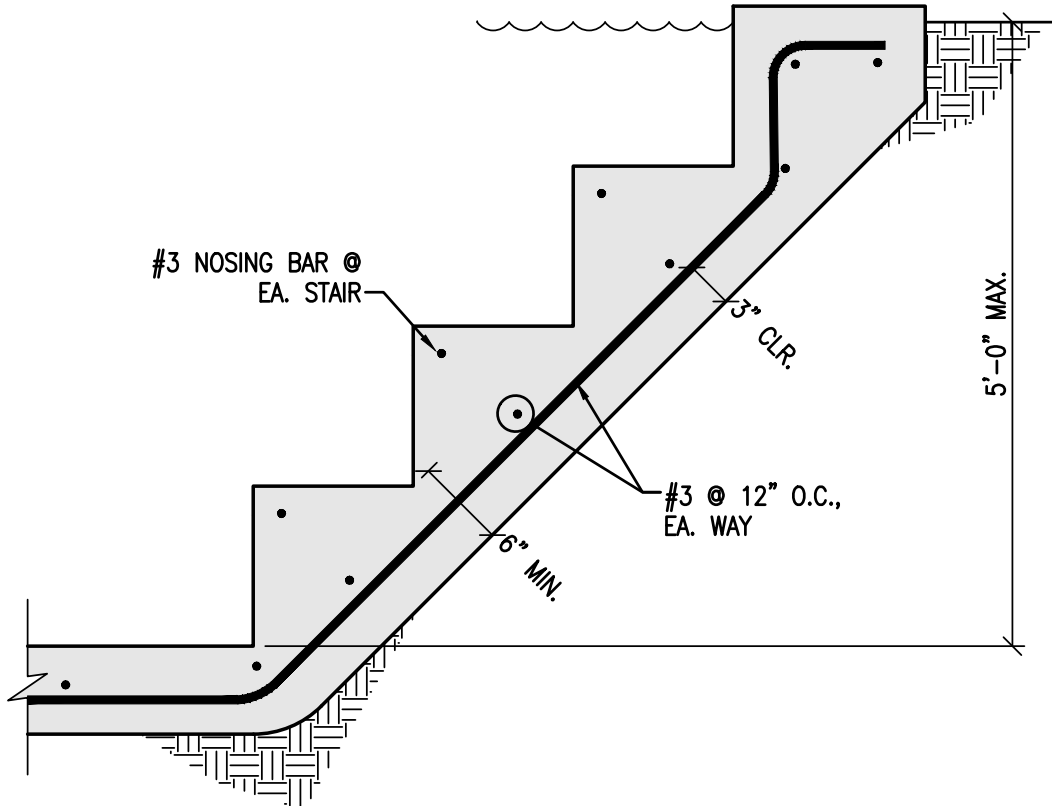


N.T.S.

8

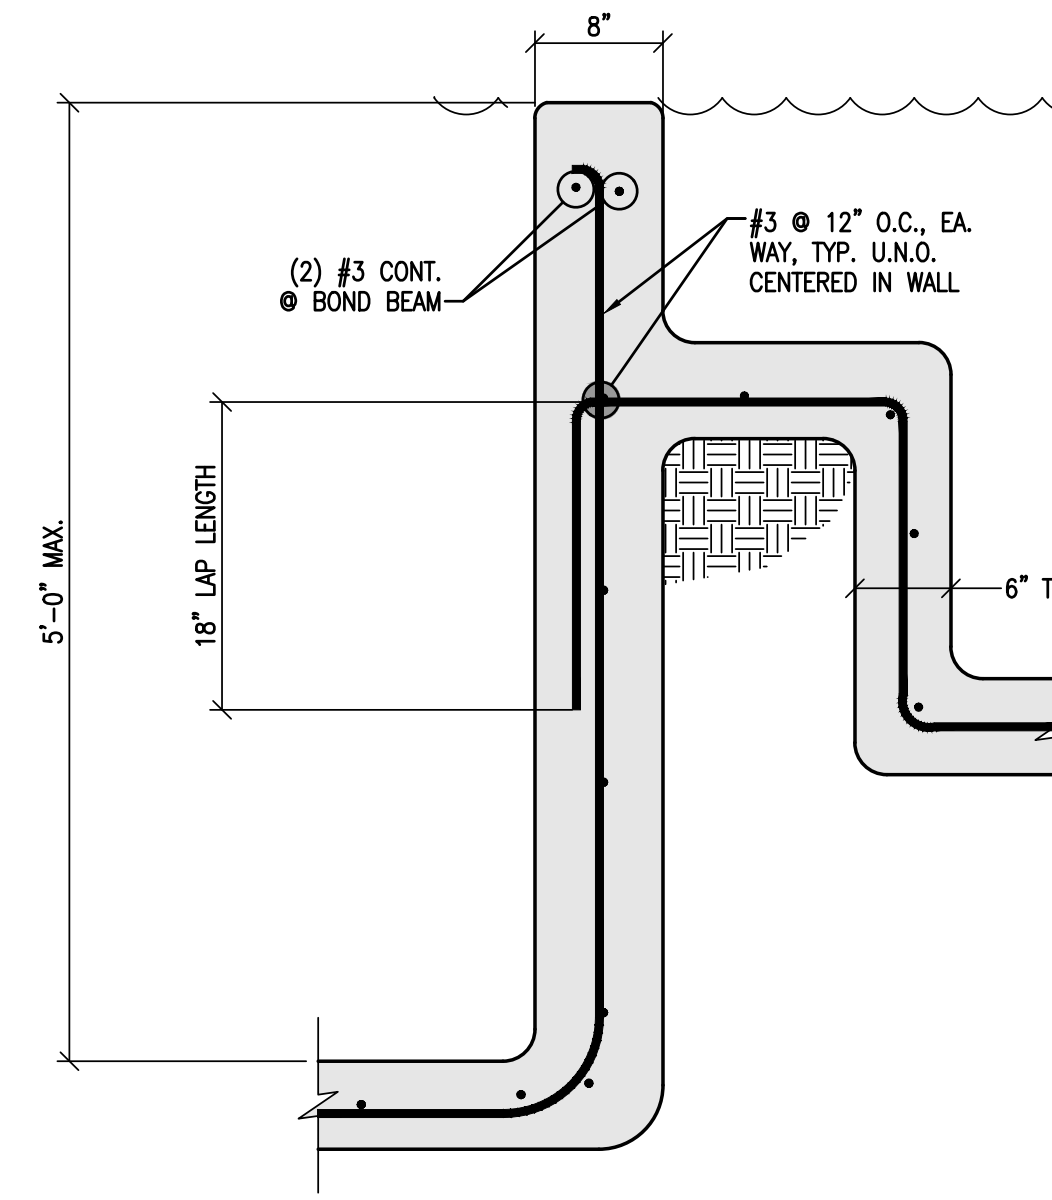


N.T.S.

9

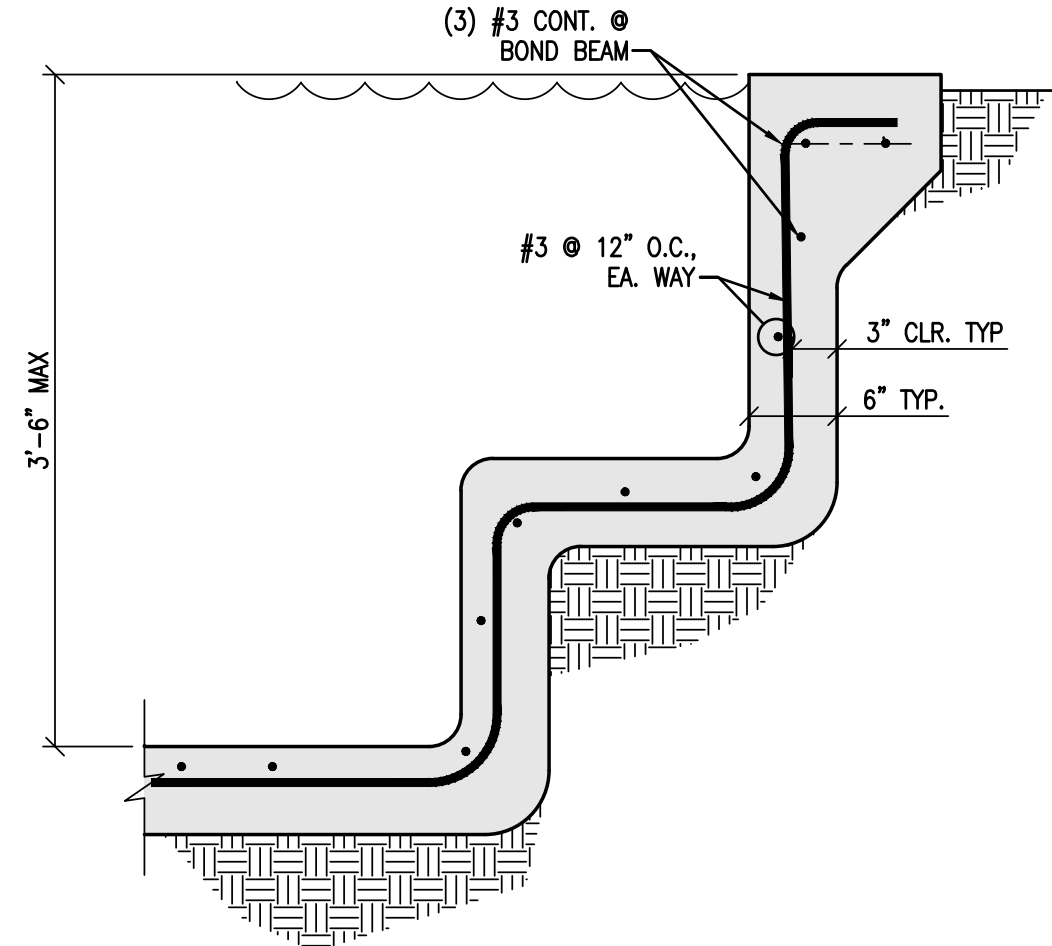


N.T.S.

10

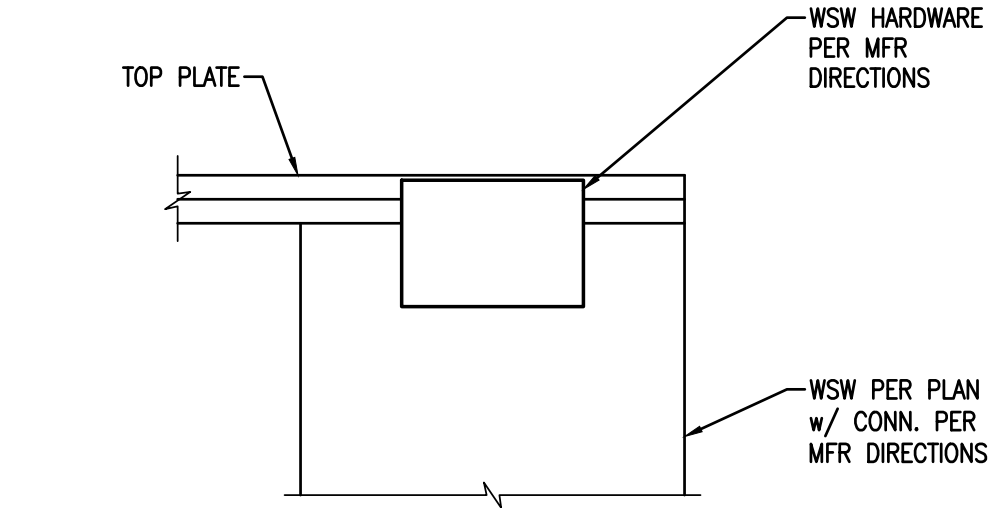


N.T.S.

5

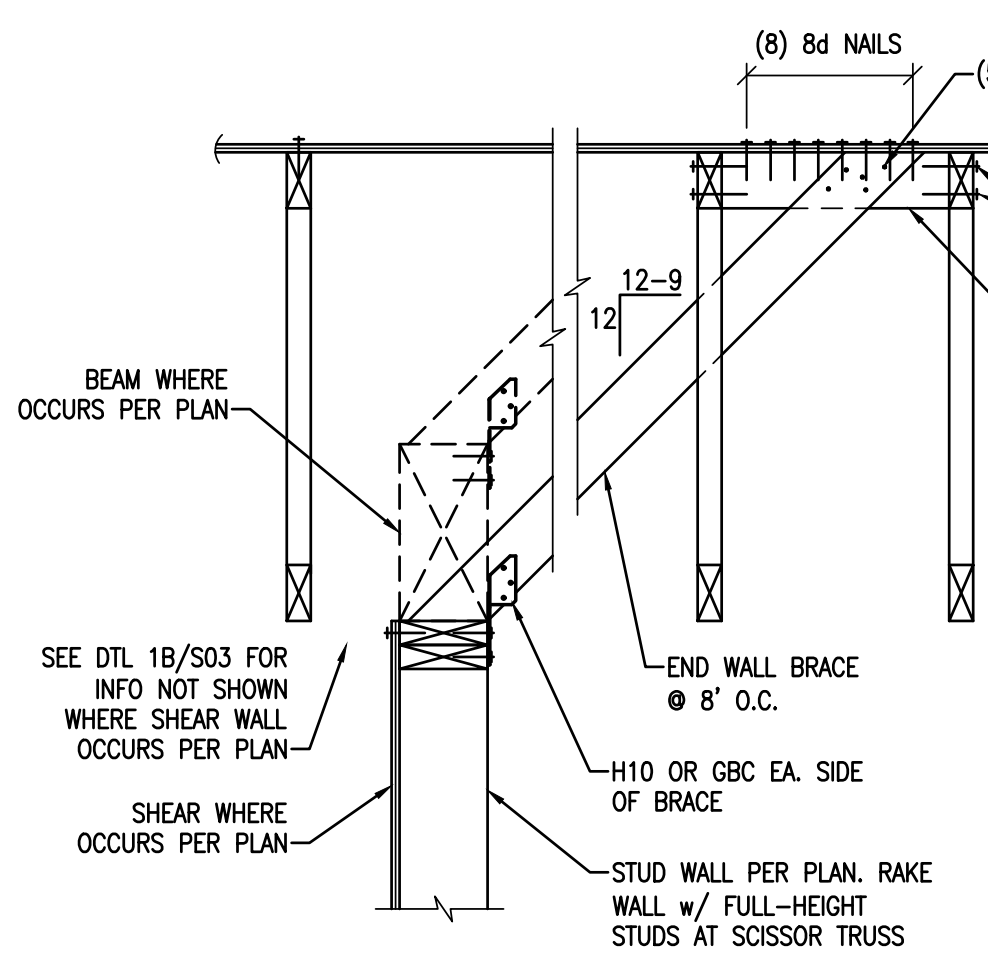


N.T.S.

6

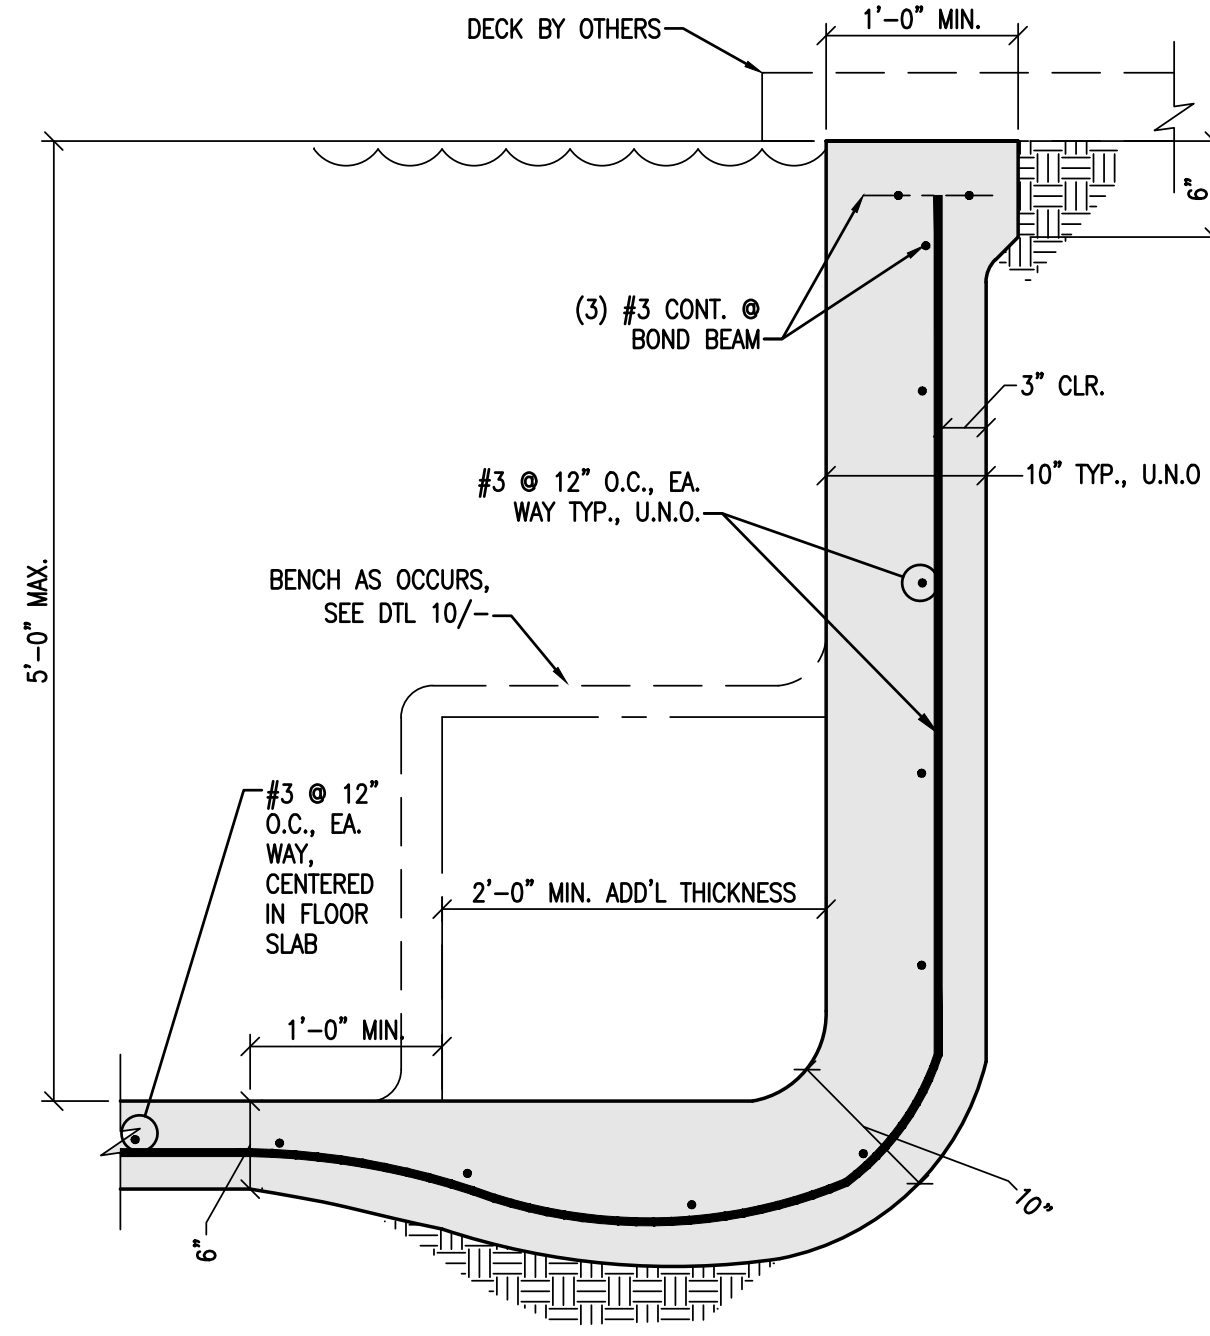


N.T.S.

7

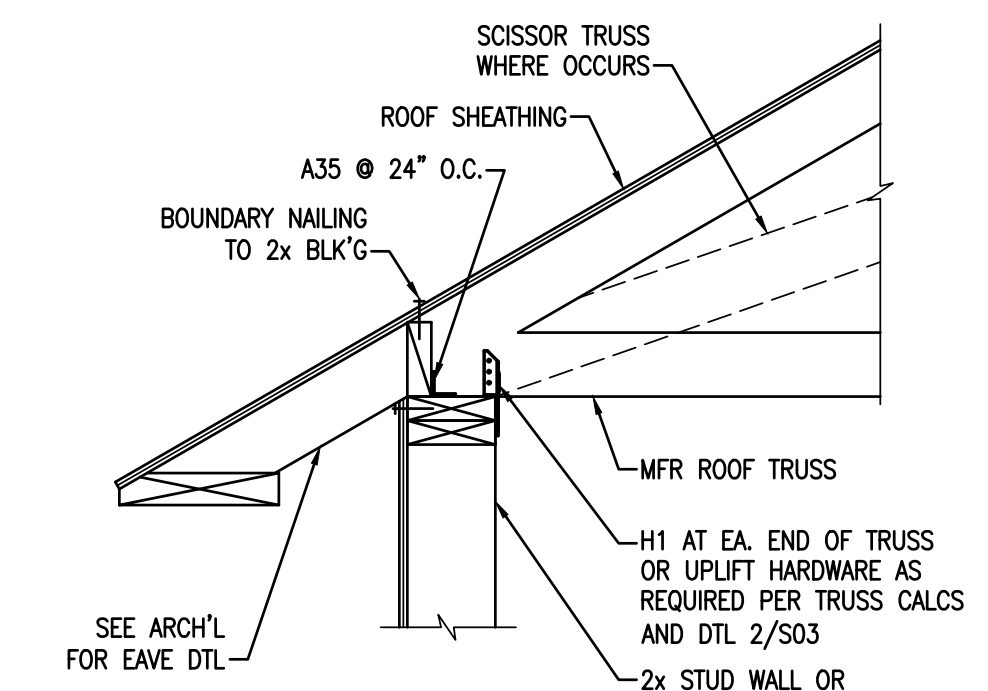


N.T.S.

1

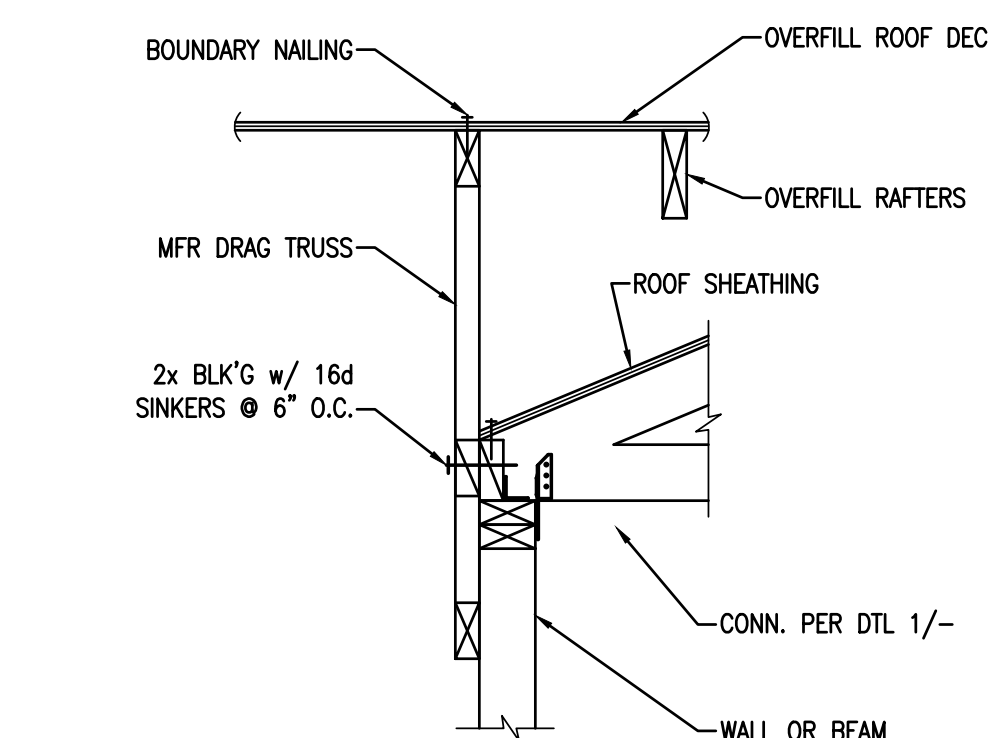


N.T.S.

2

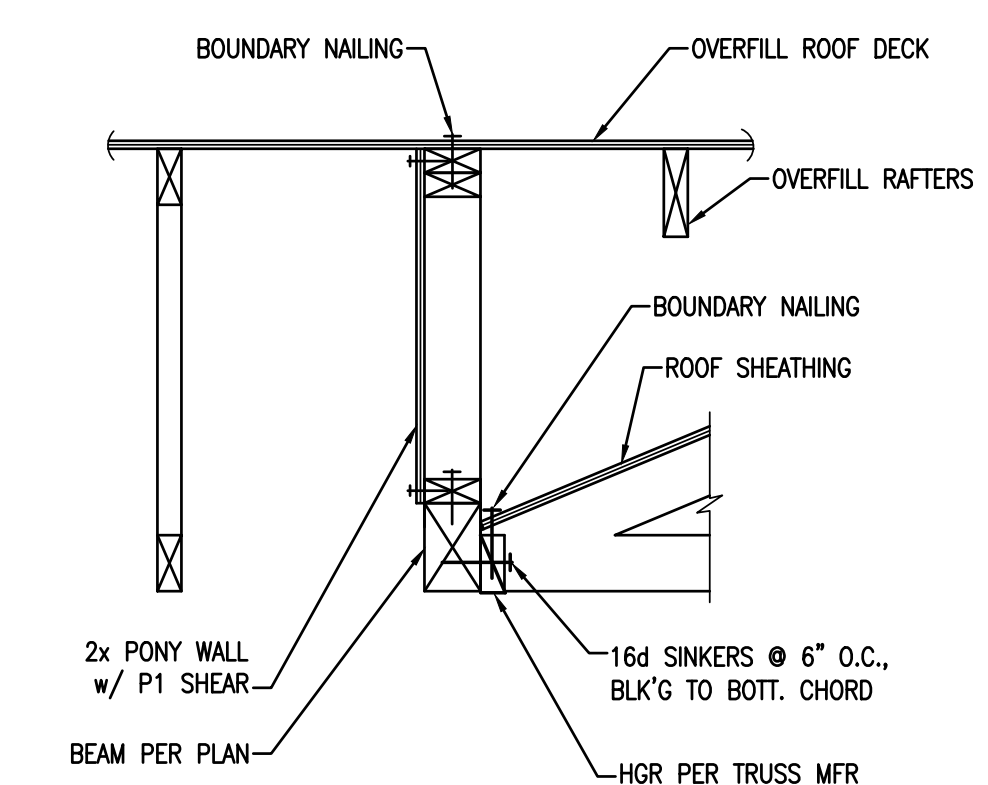

N.T.S.

3

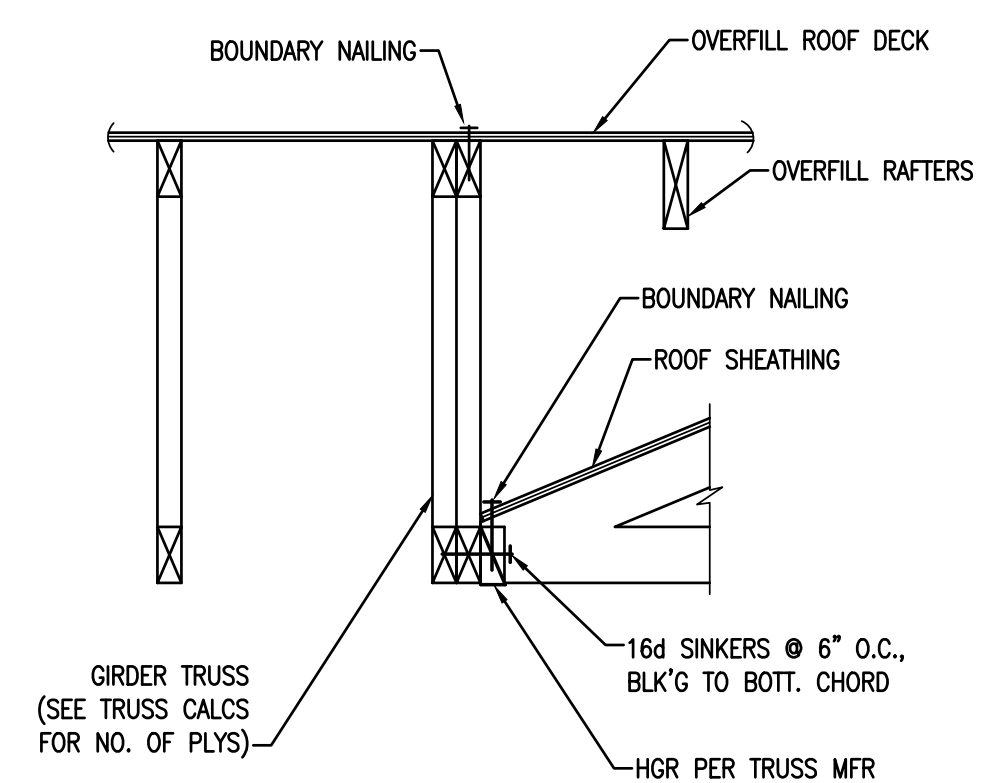

N.T.S.

4

DATE	REV	BY	CHK	DESCRIPTION
08-26-21				



Copyright © 2021  
Vector Structural Engineering, LLC  
This drawing contains proprietary information  
belonging to Vector Structural Engineering, LLC,  
and may be neither wholly nor partially copied or  
reproduced without the prior written permission of  
Vector Structural Engineering, LLC.

STRUCTURAL DETAILS

PROPRIETARY DO NOT DISSEMINATE


For Review  
12/24/2025 10:13:22 AM

THIS WORK WAS PREPARED BY  
ME OR UNDER MY SUPERVISION.  
CONSTRUCTION OF THIS  
PROJECT WILL BE UNDER MY  
OBSERVATION WHEN REQUIRED  
BY H.A.R. 16-115-9  
EXPIRATION DATE OF LICENSE:  
04/30/2022

U3360-010-211

S11



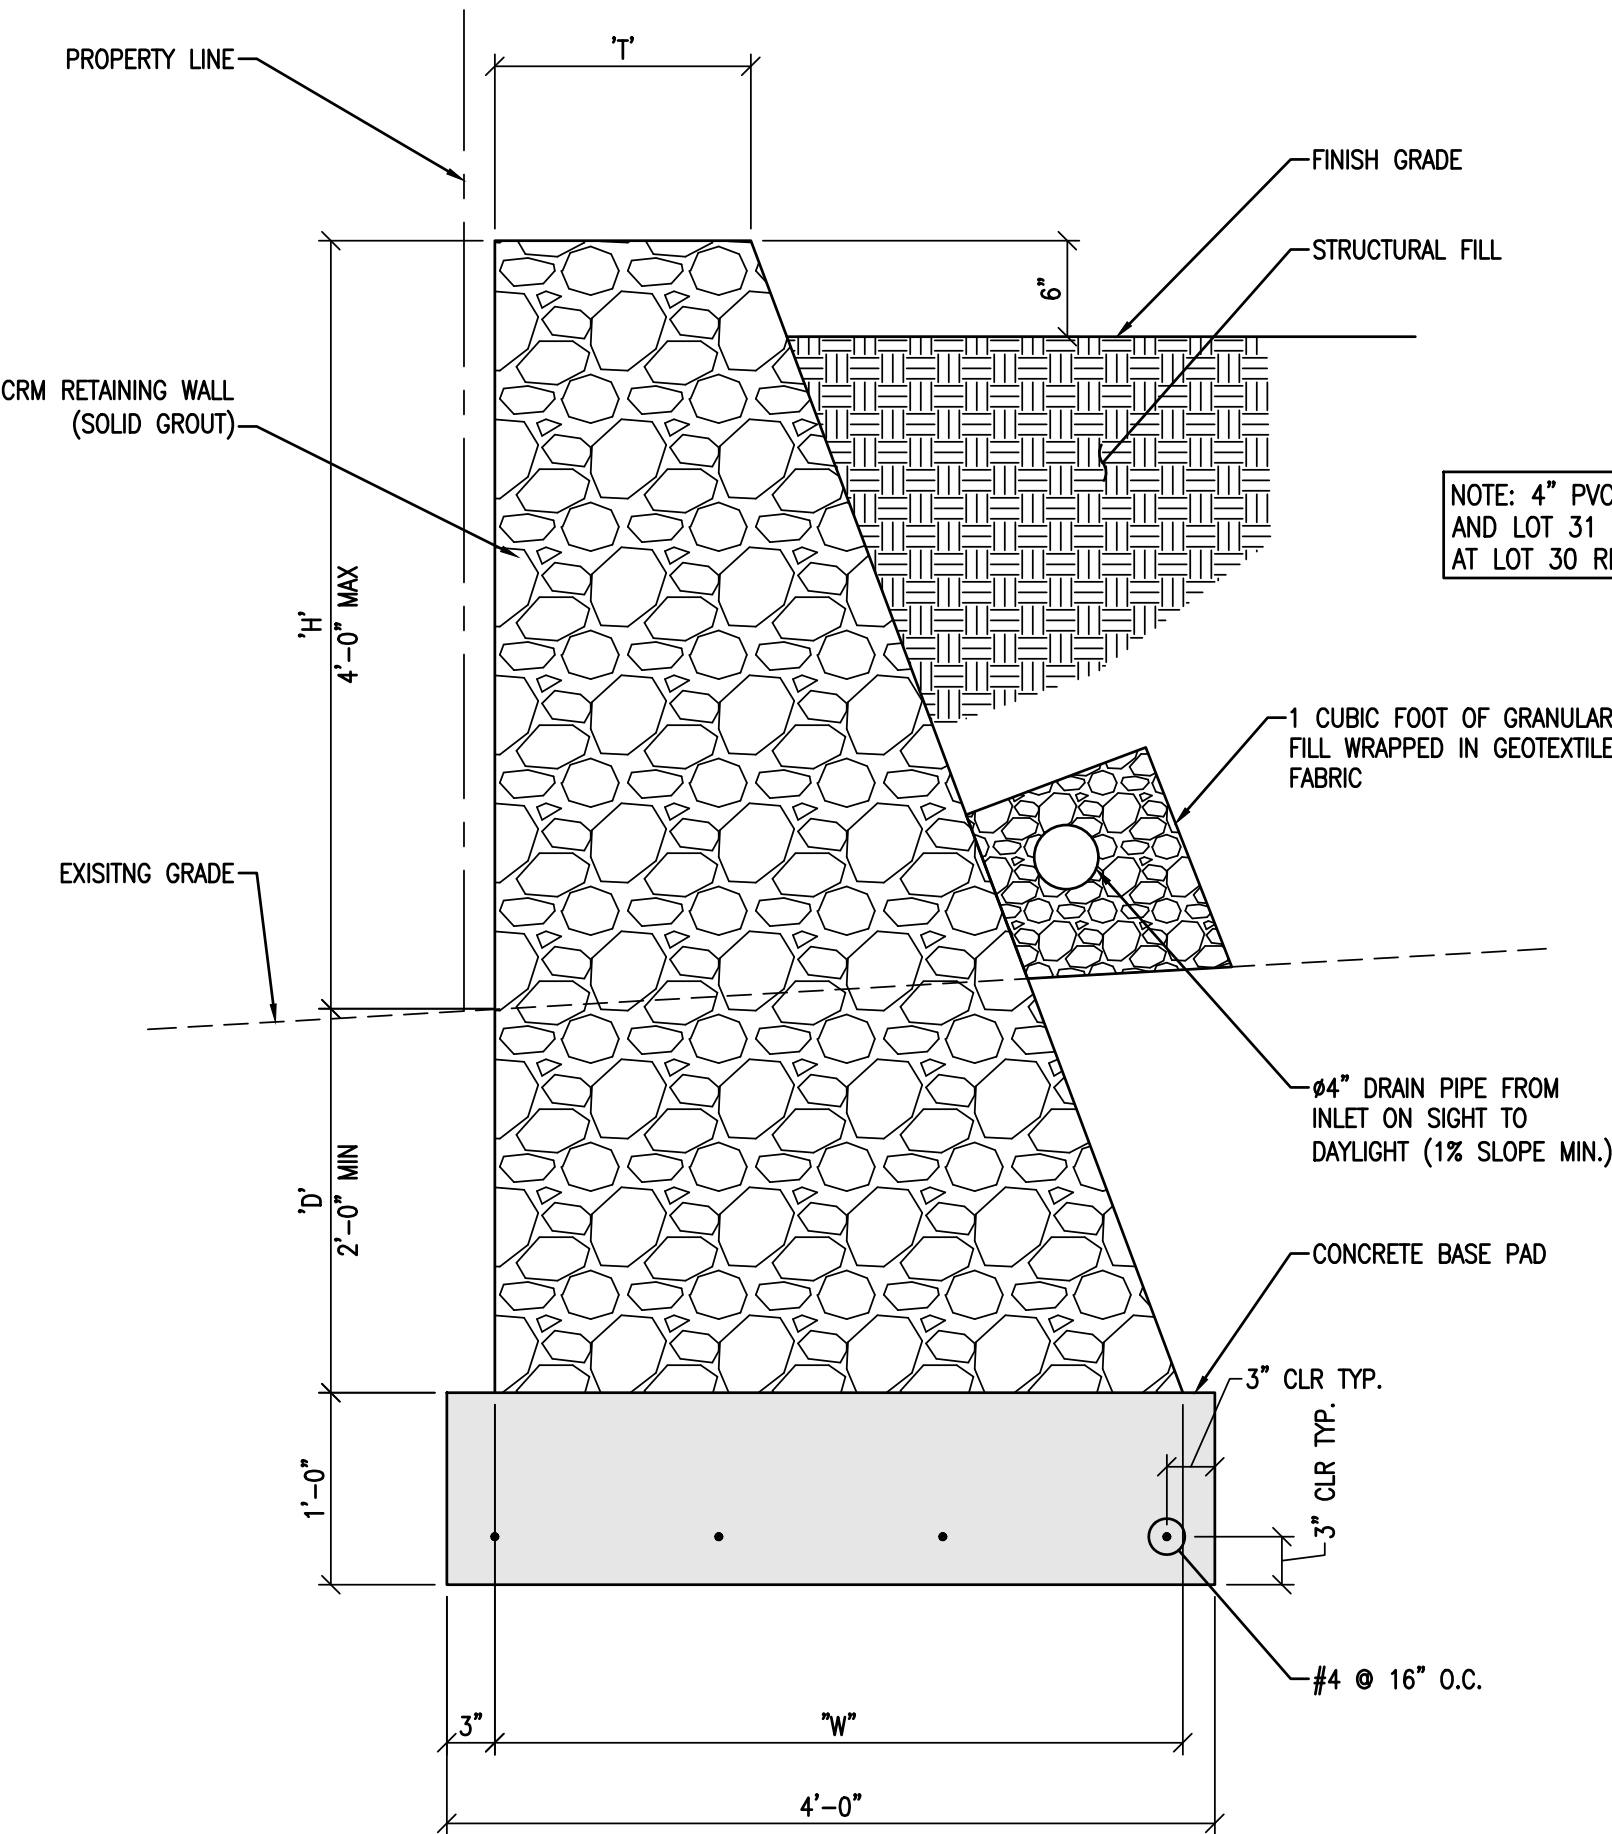

CRM RETAINING WALL SCHEDULE			
'H'	'D' (IN)	'W' (IN)	'T' (IN)
H < 4'	24	40	14
*NOTE: A SOILS REPORT WAS NOT PROVIDED FOR THE PROJECT. VALUES ARE ASSUMED FOR WAIKOMO VERY ROCKY SILTY CLAY (WV) OBTAINED FROM THE USDA NRCS WEB SOIL SURVEY, TABLE 1806.2 OF THE INTERNATIONAL BUILDING CODE, AND TYP. VALUES FOR THE SOIL TYPE.			
VERTICAL PRESSURE (PSF) (+ 500 PSF/FT OF 'D')			1500
LATERAL SLIDING RESISTANCE - COHESION (PSF)			130
SOIL DENSITY (PSF)			100
FRICTION ANGLE - ASSUMED (DEG)			18
CRM WT. (PCF)			150

CRM RETAINING WALL

N.T.S.

1



Copyright © 2021  
Vector Structural Engineering, LLC  
This drawing contains proprietary information  
belonging to Vector Structural Engineering, LLC,  
and may be neither wholly nor partially copied or  
reproduced without the prior written permission of  
Vector Structural Engineering, LLC.

STRUCTURAL DETAILS

PROPRIETARY DO NOT DISCLOSE

For Review

02/24/2025 10:13:22 AM

THIS WORK WAS PREPARED BY  
ME OR UNDER MY SUPERVISION.  
CONSTRUCTION OF THIS  
PROJECT WILL BE UNDER MY  
OBSERVATION WHEN REQUIRED  
BY H.A.R. 16-115-9  
EXPIRATION DATE OF LICENSE:  
04/30/2022

U3360-010-211

S12